Standard Detail Drawings & Sample Test Report Forms

Appendix A

Note:
1) Per PWDS 1.10.b.9, the applicable City standard details shall be included on construction drawings submitted for City review and approval.

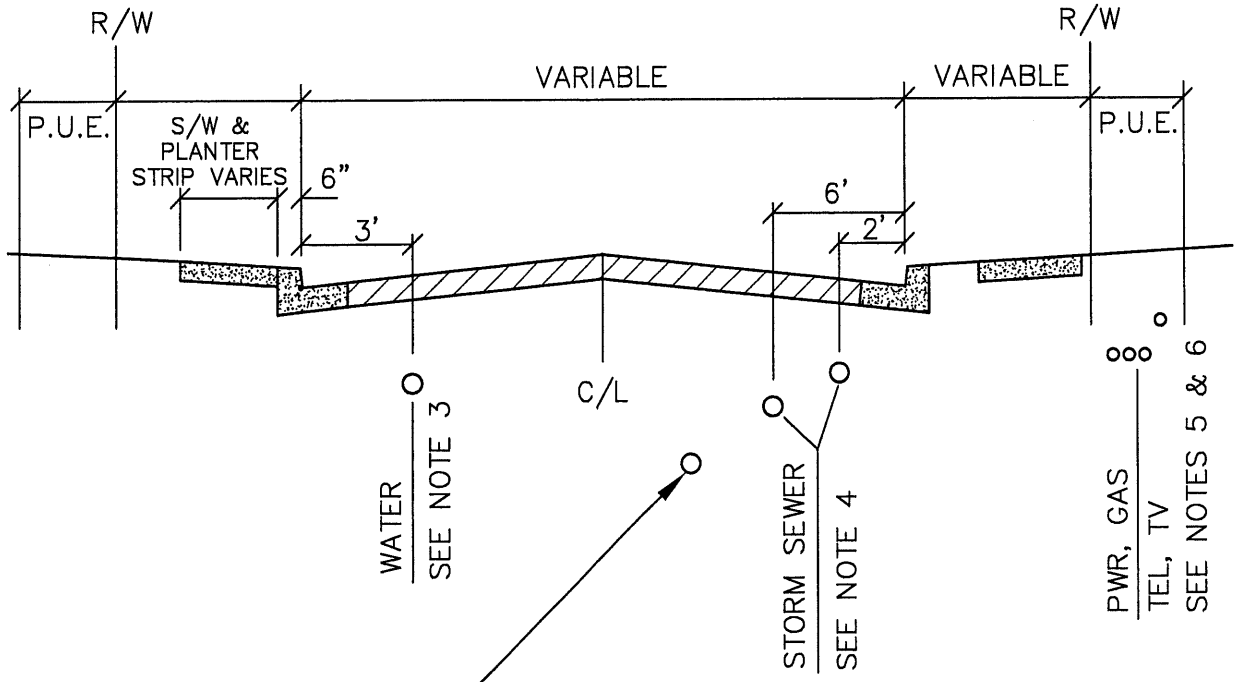

CURBED STREETS

NTS

NOTES:

1. 6' MIN COVER REQUIRED FOR SANITARY SEWER MAINS (4' MIN. COVER TYPICALLY REQUIRED FOR LATERALS).
2. LATERALS AND P/L CLEANOUTS TO BE INSTALLED DURING CONSTRUCTION OF SANITARY SEWER & STORM MAINS (TO AVOID FUTURE STREET CUTS).
3. WATER TO BE INSTALLED 3' IN FRONT OF FACE OF CURB ON HIGH SIDE OF STREET. 36" MIN. COVER ON ALL WATERLINES. 10' MINIMUM SEPARATION TYPICAL BETWEEN PARALLEL WATER & SEWER MAINS.
4. STORM SEWER TO BE INSTALLED ON LOW SIDE OF STREET:
   a) 2' FROM FACE OF CURB FOR <4' RIM TO INVERT
   b) 6' FROM FACE OF CURB FOR >4' RIM TO INVERT (MH SYSTEM)
5. MAINTAIN MIN. 3' HORIZ. SEPARATION BETWEEN PUBLIC UTILITIES & PARALLEL PRIVATE UTILITIES. OTHER VERTICAL AND HORIZONTAL SEPARATION DISTANCES SHALL BE AS SPECIFIED BY DEQ, ODWP, OR OTHER PUBLIC/PRIVATE UTILITY COMPANIES.
6. UNITY TRENCH PER UTILITY COMPANY REQIREMENTS.

LAST REVISION DATE: JUNE 2016	
TYP. UTILITY LOCATIONS (CURBED STREETS) (NTS)	
PHILOMATH, OR	DETAIL NO. 101

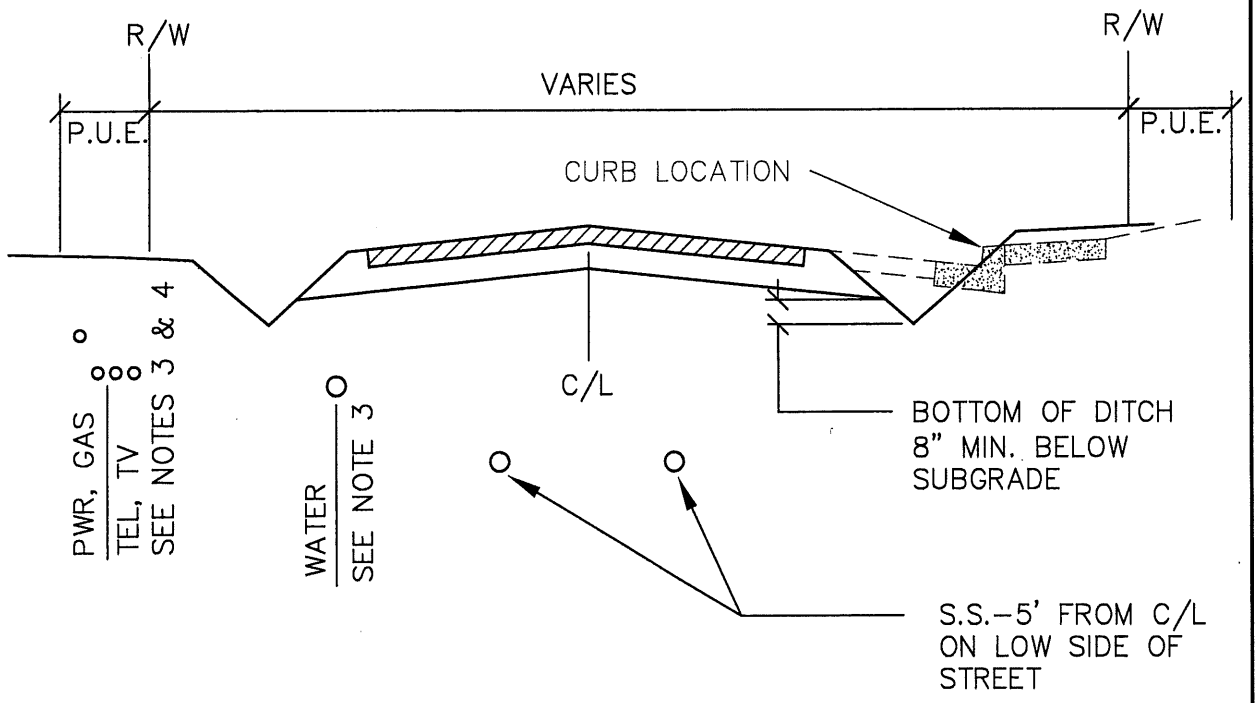

NOTE:

UTILITIES FOR TURNPIKE STREETS OR 3/4 STREET IMPROVEMENTS SHALL BE LOCATED TO ALLOW FUTURE CONSTRUCTION OF CURBED STREETS WITHOUT RELOCATING UTILITIES. SEE DETAIL 101.

TURNPIKE STREETS

NTS

NOTES:

1. 6' MIN COVER REQUIRED FOR SANITARY SEWER MAINS (4' MIN. COVER TYPICALLY REQUIRED FOR LATERALS).
2. LATERALS AND P/L CLEANOUTS TO BE INSTALLED DURING CONSTRUCTION OF SANITARY SEWER & STORM MAINS (TO AVOID FUTURE STREET CUTS).
3. WATER TO BE INSTALLED ON HIGH SIDE OF STREET, 3' IN FRONT OF FACE OF CURB ON IMPROVED SIDE OR 3' IN FRONT OF FUTURE FACE OF CURB LOCATION, UNLESS OTHERWISE DIRECTED BY THE CITY ENGINEER AND/OR PUBLIC WORKS DIRECTOR. 10' MINIMUM SEPARATION TYPICAL BETWEEN PARALLEL WATER & SEWER MAINS.
4. MAINTAIN MIN. 3' HORIZ. SEPARATION BETWEEN PUBLIC UTILITIES & PARALLEL PRIVATE UTILITIES. OTHER VERTICAL AND HORIZONTAL SEPARATION DISTANCES SHALL BE AS SPECIFIED BY DEQ, ODWP, OR OTHER PUBLIC/PRIVATE UTILITY COMPANIES.
5. UNITY TRENCH PER UTILITY COMPANY REQUIREMENTS.

LAST REVISION DATE: JUNE 2016	
TYP. UTILITY LOCATIONS (TURNPIKE AND 3/4 STREETS) (NTS)	
PHILOMATH, OR	DETAIL NO. 102

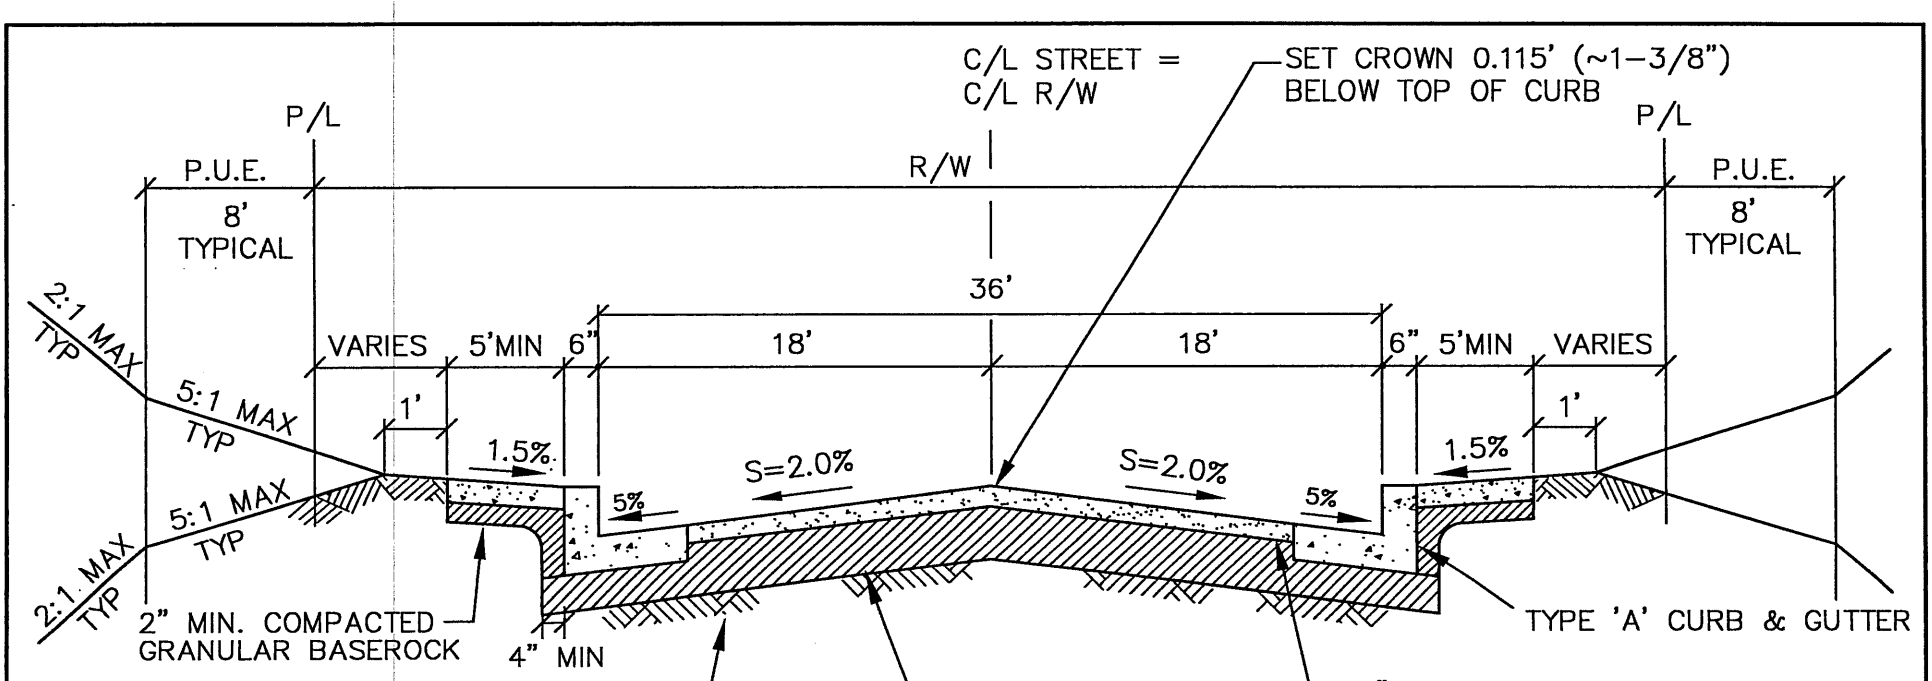

NOTES:

1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF-ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
2. IF SUBGRADE FAILS THE PROOF-ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12-INCHES. NO RUBBER TIRED EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
3. IF SUBGRADE PASSES PROOF-ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T-180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON-WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL). SEPARATION FABRIC: NON-WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

PHILOMATH, OR

36' RESIDENTIAL (LOCAL) STREET MINIMUM SECTION

(NTS)

LAST REVISION DATE: DEC 2015

DETAIL NO. 201

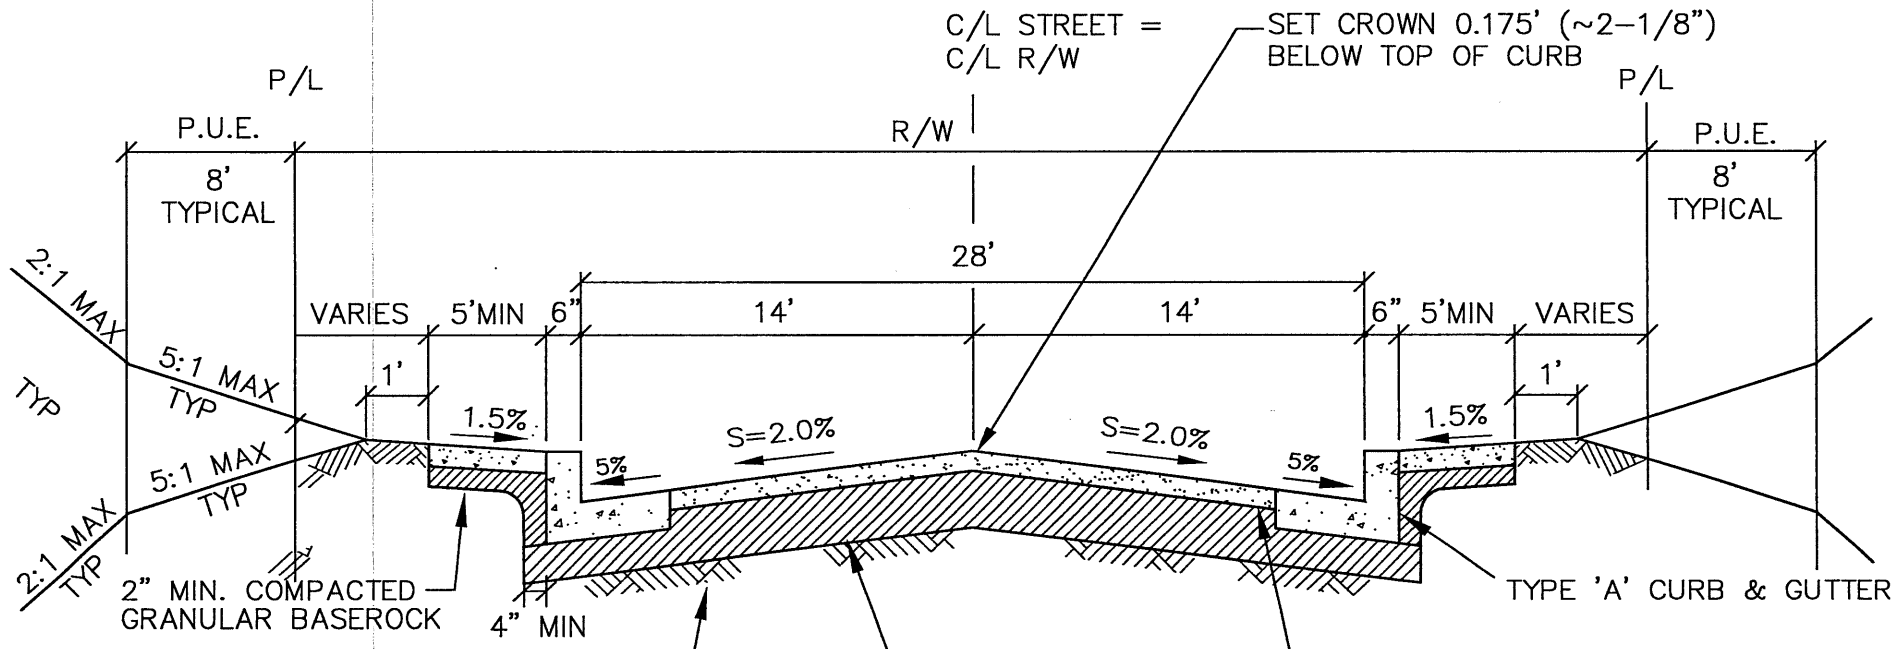

ALT: 2" OF 3/4"-0" GRANULAR BASEROCK OVER
7" OF 1-1/2"-0" GRANULAR BASEROCK.

NOTES:

1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF-ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
2. IF SUBGRADE FAILS THE PROOF-ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12-INCHES. NO RUBBER TIRED EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
3. IF SUBGRADE PASSES PROOF-ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T-180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON-WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL). SEPARATION FABRIC: NON-WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

28' RESIDENTIAL CUL-DE-SAC
MINIMUM SECTION

(NTS)

PHILOMATH, OR

DETAIL NO. 201A

LAST REVISION DATE: DEC 2015

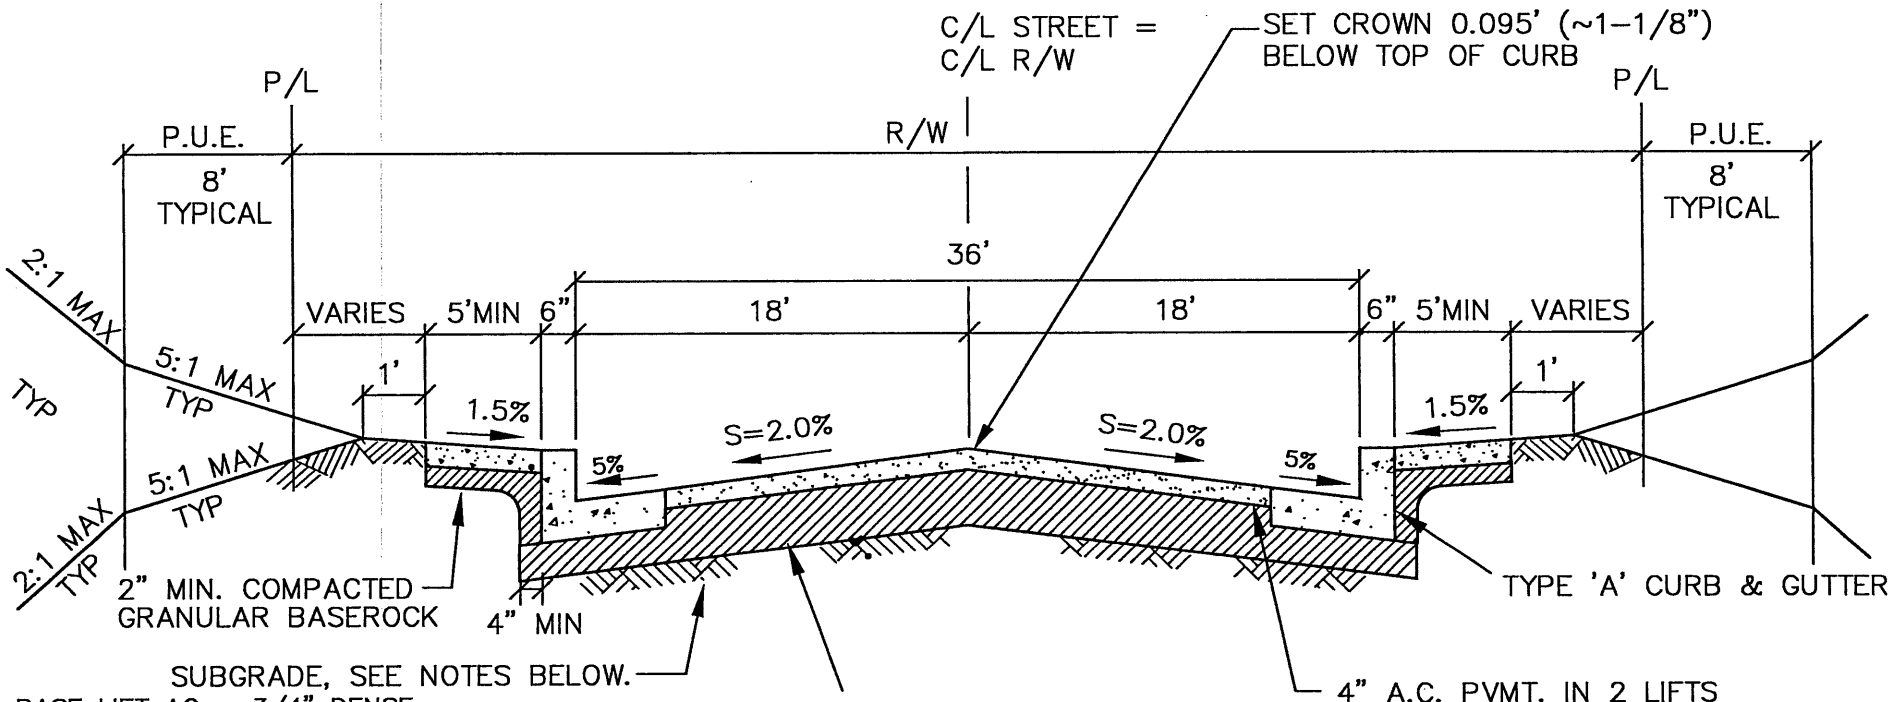

-BASE LIFT AC – 3/4" DENSE GRADED MIX (LEVEL 2 JMF).
-TOP LIFT AC – 1/2" DENSE GRADED MIX (LEVEL 2 JMF).

12" OF 1"–0" GRANULAR BASEROCK
(COMPACT TO 95% OPTIMUM PER AASHTO T–180)

ALT: 2" OF 3/4"–0" GRANULAR BASEROCK OVER
10" OF 1–1/2"–0" GRANULAR BASEROCK.

4" A.C. PVMT. IN 2 LIFTS
2" CL.'C' OVER 2" CL.'B'
(COMPACT TO 91% OPTIMUM PER
RICE STANDARD METHOD)

NOTES:

1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF–ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
2. IF SUBGRADE FAILS THE PROOF–ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12–INCHES. NO RUBBER TIRED EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
3. IF SUBGRADE PASSES PROOF–ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T–180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON–WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL).
   SEPARATION FABRIC: NON–WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

36' MINOR COLLECTOR STREET MINIMUM SECTION

(NTS)

PHILOMATH, OR

DETAIL NO. 202

LAST REVISION DATE: DEC 2015

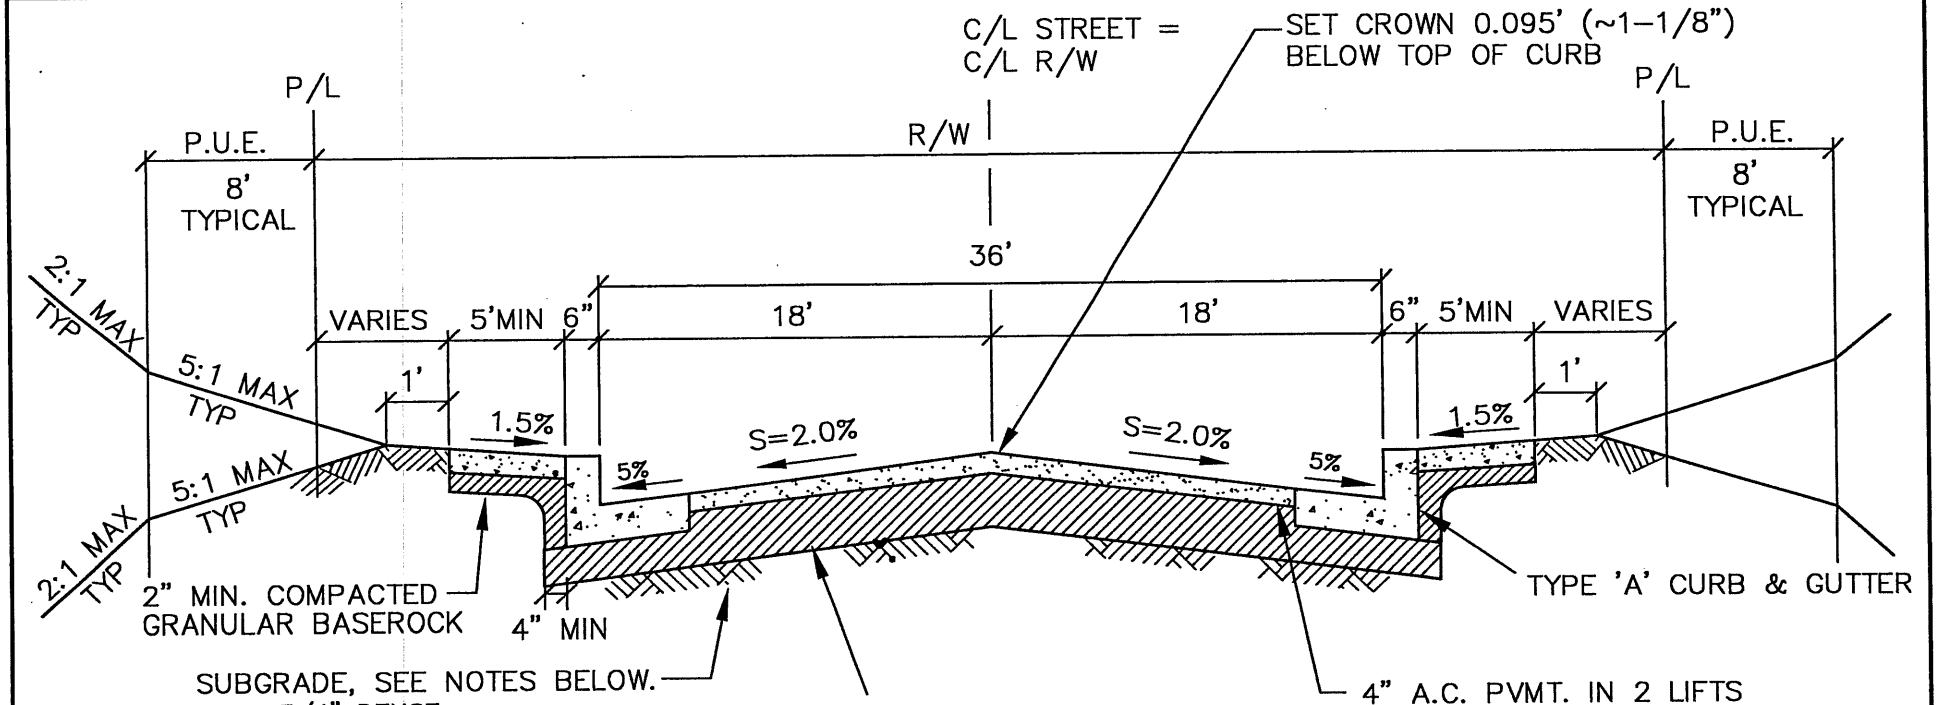

-BASE LIFT AC – 3/4" DENSE GRADED MIX (LEVEL 3 JMF).
-TOP LIFT AC – 1/2" DENSE GRADED MIX (LEVEL 3 JMF).

15" OF 1"–0" GRANULAR BASEROCK
(COMPACT TO 95% OPTIMUM PER AASHTO T–180)

ALT: 2" OF 3/4"–0" GRANULAR BASEROCK OVER
13" OF 1–1/2"–0" GRANULAR BASEROCK.

4" A.C. PVMT. IN 2 LIFTS
2" CL.'C' OVER 2" CL.'B'
(COMPACT TO 91% OPTIMUM PER RICE STANDARD METHOD)

NOTES:

1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF–ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
2. IF SUBGRADE FAILS THE PROOF–ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12–INCHES. NO RUBBER TIRED EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
3. IF SUBGRADE PASSES PROOF–ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T–180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON–WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL).
   SEPARATION FABRIC: NON–WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

36' MAJOR COLLECTOR STREET
MINIMUM SECTION
(NTS)

PHILOMATH, OR

DETAIL NO. 202A

LAST REVISION DATE: DEC 2015

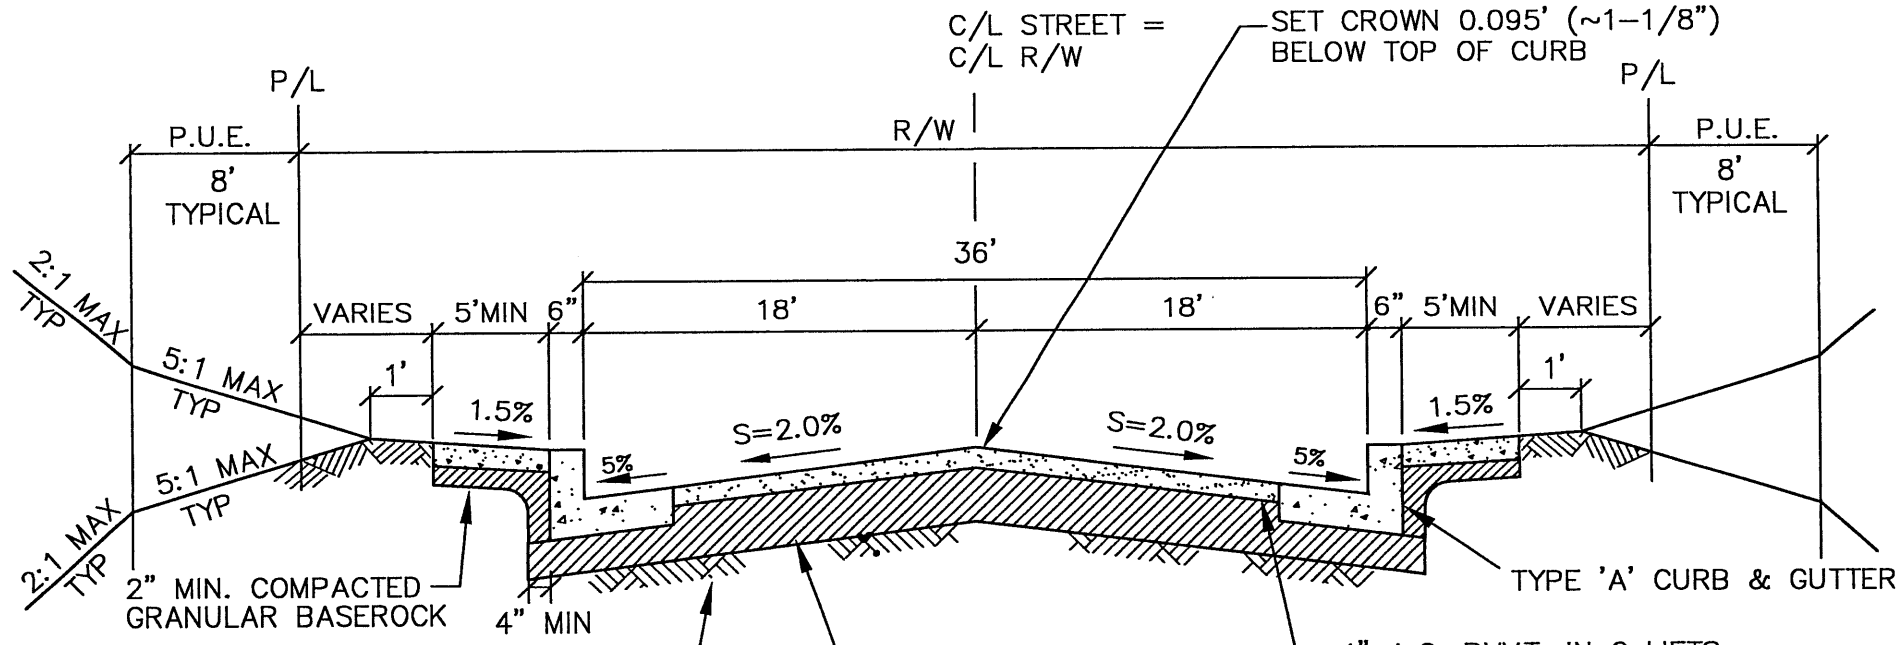

-BASE LIFT AC – 3/4" DENSE GRADED MIX (LEVEL 2 JMF).
-TOP LIFT AC – 1/2" DENSE GRADED MIX (LEVEL 2 JMF).

15" OF 1"–0" GRANULAR BASEROCK
(COMPACT TO 95% OPTIMUM PER AASHTO T–180)

ALT: 2" OF 3/4"–0" GRANULAR BASEROCK OVER
13" OF 1–1/2"–0" GRANULAR BASEROCK.

NOTES:

1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF–ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
2. IF SUBGRADE FAILS THE PROOF–ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12–INCHES. NO RUBBER TIRED EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
3. IF SUBGRADE PASSES PROOF–ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T–180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON–WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL).
   SEPARATION FABRIC: NON–WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

36' COMMERCIAL/INDUSTRIAL STREET MINIMUM SECTION

(NTS)

PHILOMATH, OR

DETAIL NO. 203

LAST REVISION DATE: DEC 2015

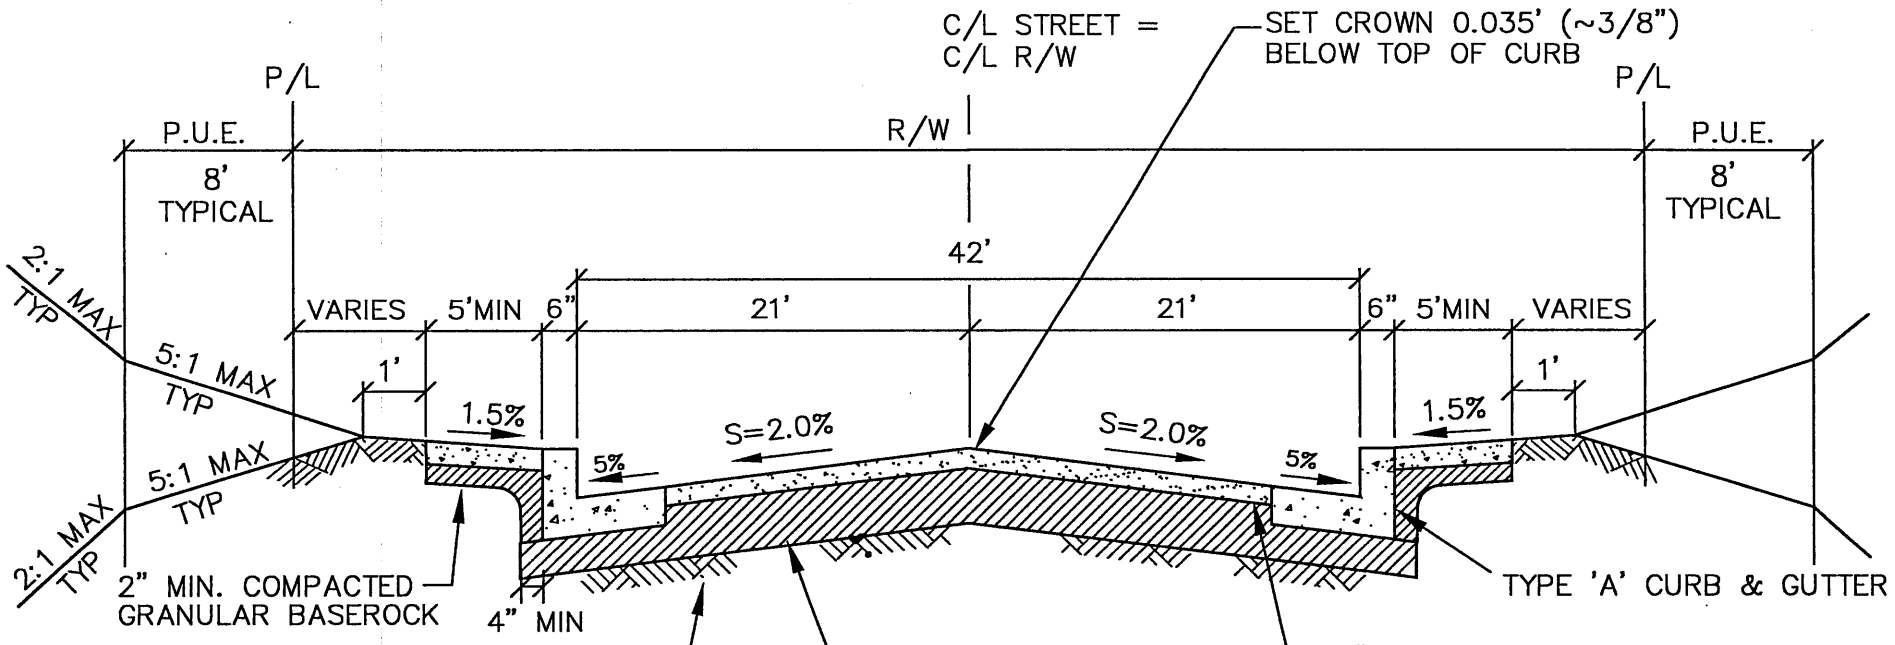

NOTES:

1. ALL DESIGN SUBGRADES SHALL BE COMPACTED AND PROOF-ROLLED PRIOR TO PLACEMENT OF BASEROCK. COMPACTION TESTING OF SUBGRADE MAY BE WAIVED AS OUTLINED UNDER NOTE 3.
2. IF SUBGRADE FAILS THE PROOF-ROLL, SUBGRADE SHALL BE OVEREXCAVATED TO UNDISTURBED SOIL AND BACKFILLED WITH BASEROCK OVER GEOTEXTILE REINFORCEMENT FABRIC (AS SPECIFIED) TO ALLOW COMPACTION OF UPPER (DESIGN) BASEROCK SECTION AND TO MAINTAIN STRUCTURAL INTEGRITY OF NATIVE SUBGRADE SOILS. TYPICAL MIN. OVEREXCAVATION REQUIRED IS 12-INCHES. NO RUBBER TIRED EQUIPMENT ALLOWED ON SUBGRADE FOLLOWING OVEREXCAVATION.
3. IF SUBGRADE PASSES PROOF-ROLL BUT CANNOT BE COMPACTED TO 95% OPTIMUM DENSITY PER AASHTO T-180 (OR IF CONTRACTOR CHOOSES NOT TO TEST), GEOTEXTILE SEPARATION FABRIC (AS SPECIFIED) SHALL BE PLACED ON THE SUBGRADE PRIOR TO PLACEMENT OF THE BASEROCK.
4. REINFORCEMENT FABRIC (FOR USE W/OVEREXCAVATION): NON-WOVEN (MIRAFI 1000N, GEOTEX 1001, LINQ 250EX OR EQUAL), WOVEN (MIRAFI 550X, GEOTEX 250ST, LINQ GTF250 OR EQUAL). SEPARATION FABRIC: NON-WOVEN (MIRAFI 160N, GEOTEX 601, LINQ 150EX OR EQUAL), WOVEN (MIRAFI 500X, GEOTEX 200ST, LINQ GTF200 OR EQUAL).

42' ARTERIAL STREET
MINIMUM SECTION

(NTS)

PHILOMATH, OR

DETAIL NO. 204

LAST REVISION DATE: DEC 2015

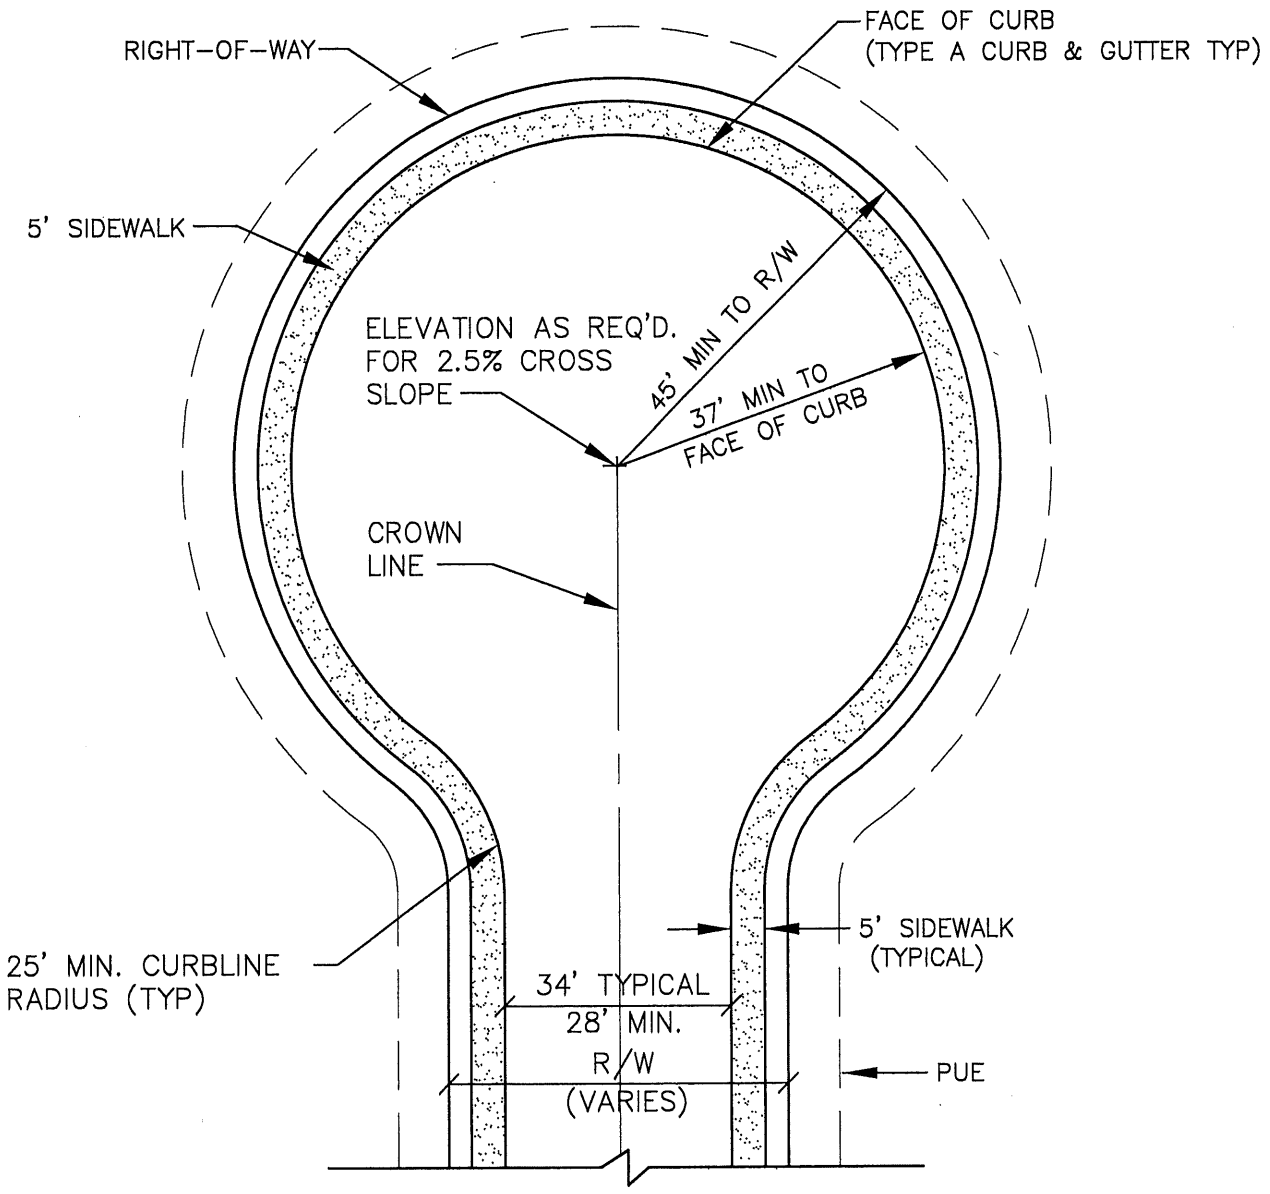

NOTES:

1. 2.5% MIN. CROSS SLOPE REQUIRED FROM CENTER OF BULB TO GUTTER.
2. MAINTAIN CROWN LINE TO CENTER OF CUL-DE-SAC BULB.

LAST REVISION DATE: DEC 2015	
STANDARD CUL-DE-SAC (RESIDENTIAL) (NTS)	
PHILOMATH, OR	DETAIL NO. 205

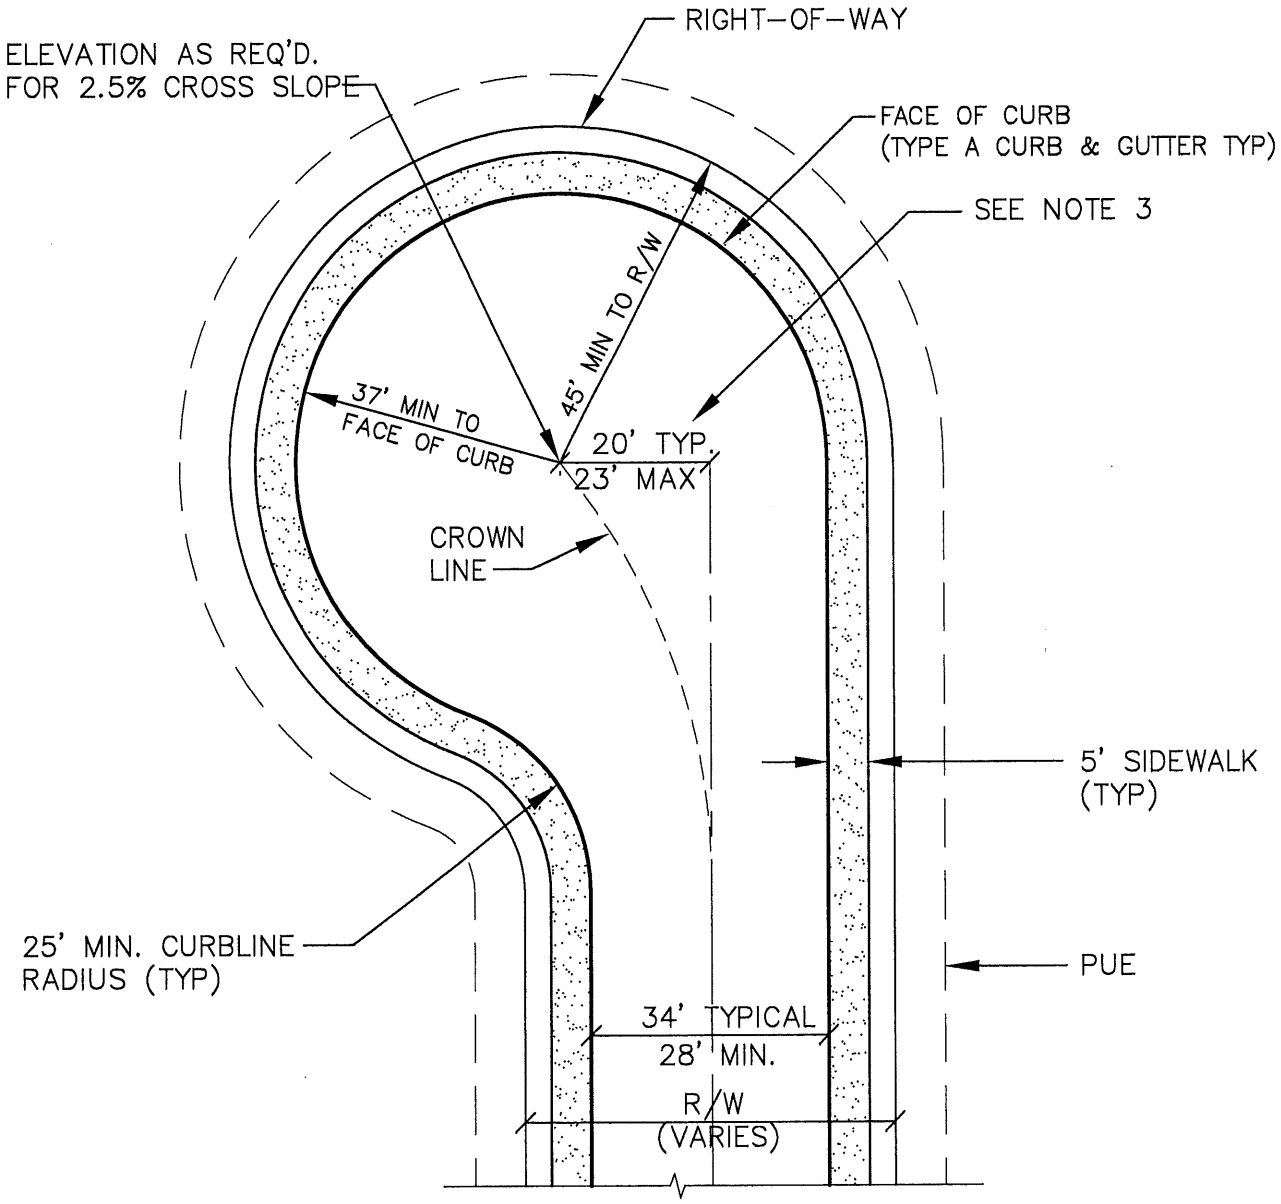

NOTES:

1. 2.5% MIN. CROSS SLOPE REQUIRED FROM CENTER OF BULB TO GUTTER.
2. MAINTAIN CROWN LINE TO CENTER OF CUL-DE-SAC BULB.
3. OFFSET FROM ROADWAY CENTERLINE TO CENTER OF BULB = CURB RADIUS MINUS ONE-HALF STREET WIDTH.

LAST REVISION DATE: DEC 2015	
OFFSET CUL-DE-SAC (RESIDENTIAL) (NTS)	
PHILOMATH, OR	DETAIL NO. 206

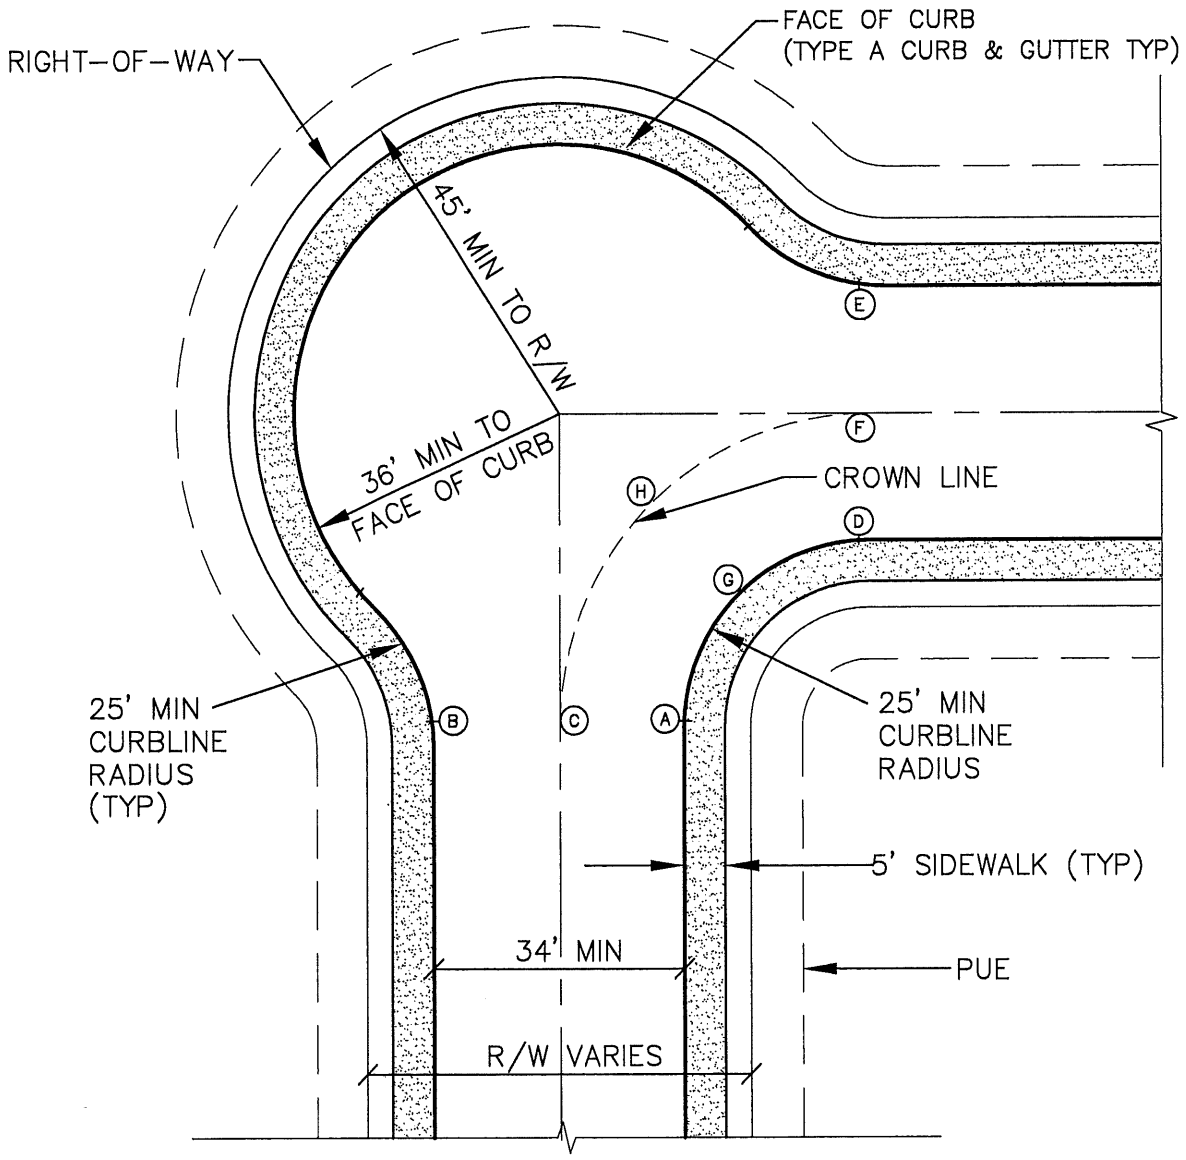

NOTES:

1. TOP CURB @ A = TOP CURB @ B = CROWN @ C
2. TOP CURB @ D = TOP CURB @ E = CROWN @ F
3. MIN. GUTTER SLOPE FROM E TO B = 0.75%
4. SET CROWN @ H 0.25' MIN. ABOVE TOP CURB @ G (4% MIN. CROSS SLOPE FROM H TO G)

LAST REVISION DATE: DEC 2015	
EYEBROW CUL-DE-SAC (RESIDENTIAL) (NTS)	
PHILOMATH, OR	DETAIL NO. 207

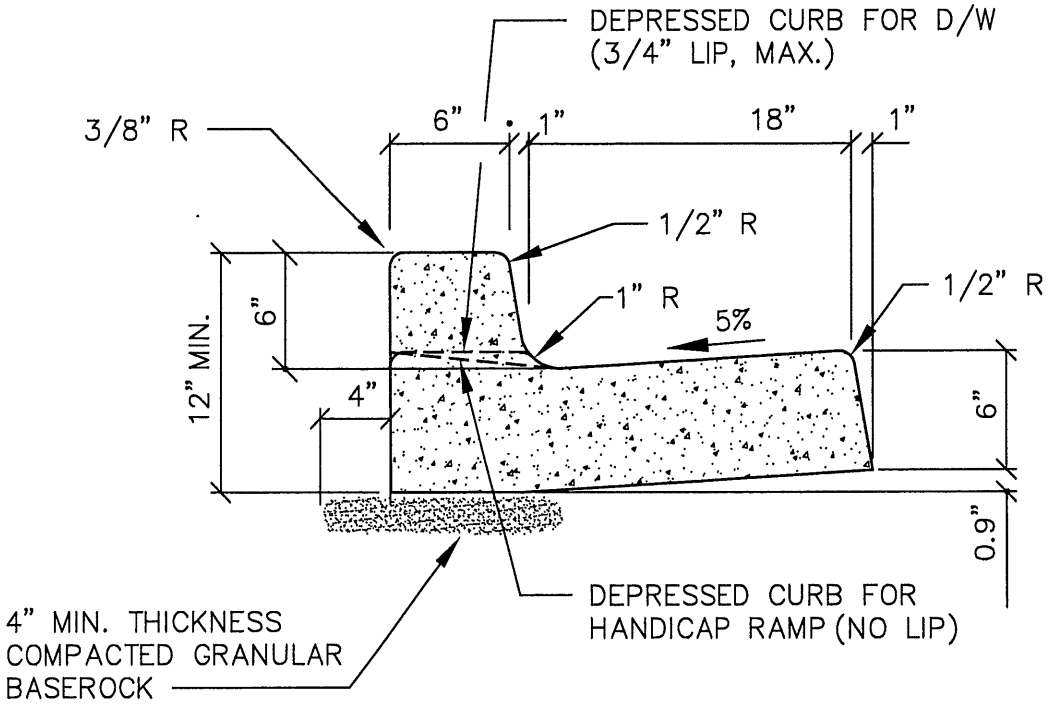

TYPE A CURB & GUTTER

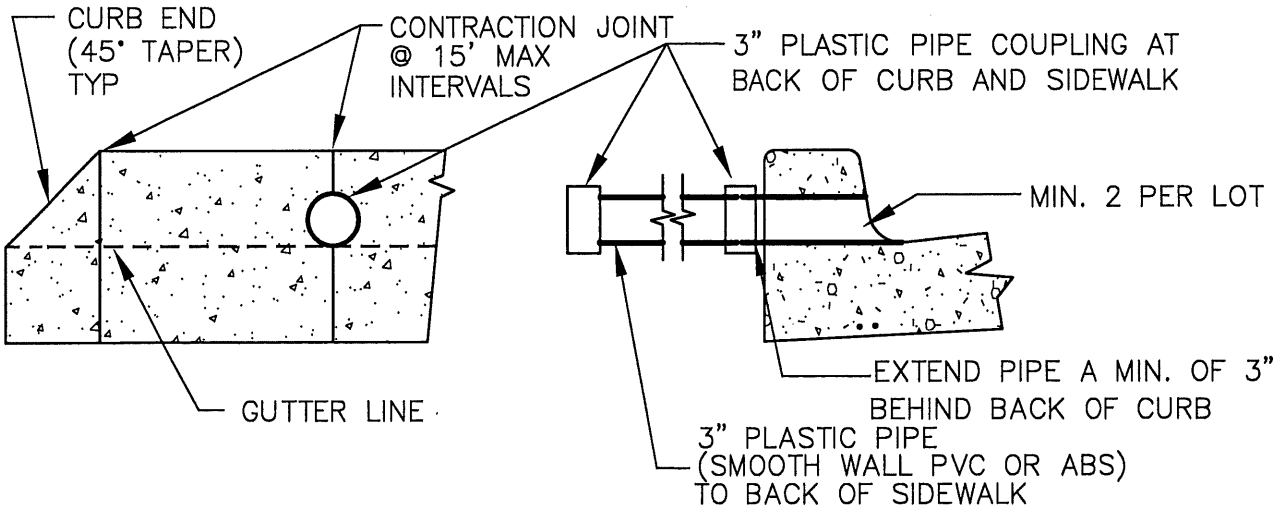

WEEP HOLE THROUGH CURB

NOTES:

1. CONTRACTION JOINTS SHALL BE PLACED AT 15' MIN. INTERVALS AND SHALL EXTEND AT LEAST 50% THROUGH THE CURB OR CURB AND GUTTER.
2. A CONTRACTION JOINT SHALL BE PLACED ALONG AND OVER WEEP HOLE THROUGH THE SIDEWALK.
3. ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
4. WHERE SIDEWALKS ARE TO BE CONSTRUCTED, EXTEND 3" PIPE TO BACK OF SIDEWALK LOCATION & INSTALL COUPLING.
5. INSTALL MIN. 2 WEEP HOLES ON ALL LOTS. ONE WEEP HOLE TO BE AT LOW POINT OF LOT, 5' FROM P/L. WEEPHOLES IN EXISTING CURBS SHALL BE CORE DRILLED.

LAST REVISION DATE: APR 2014	
TYPE 'A' CURB AND GUTTER AND WEEP HOLE (NTS)	
PHILOMATH, OR	DETAIL NO. 210

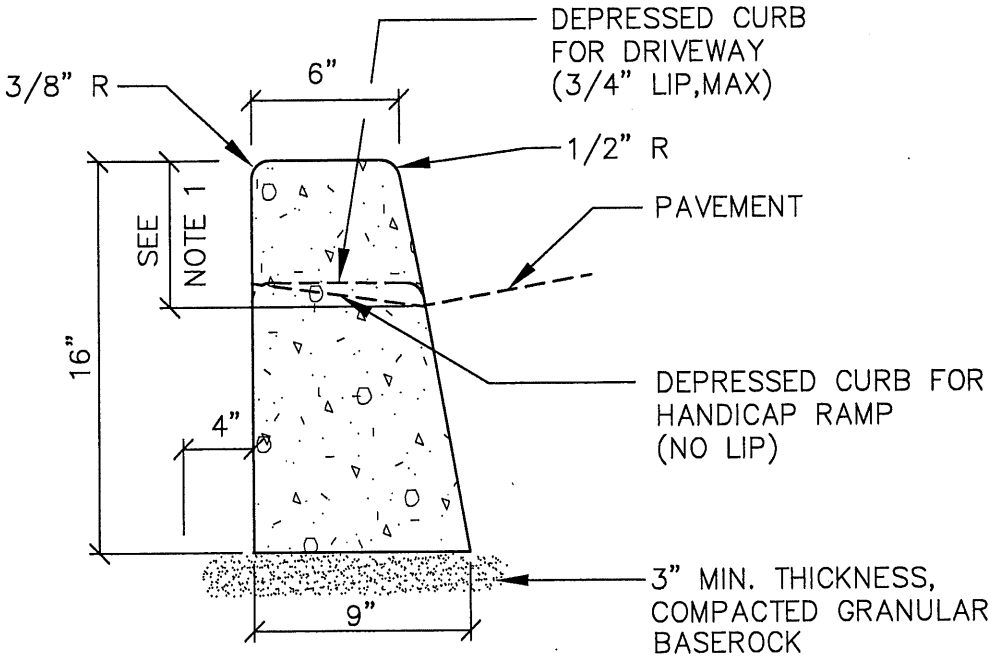

TYPE 'C' CURB

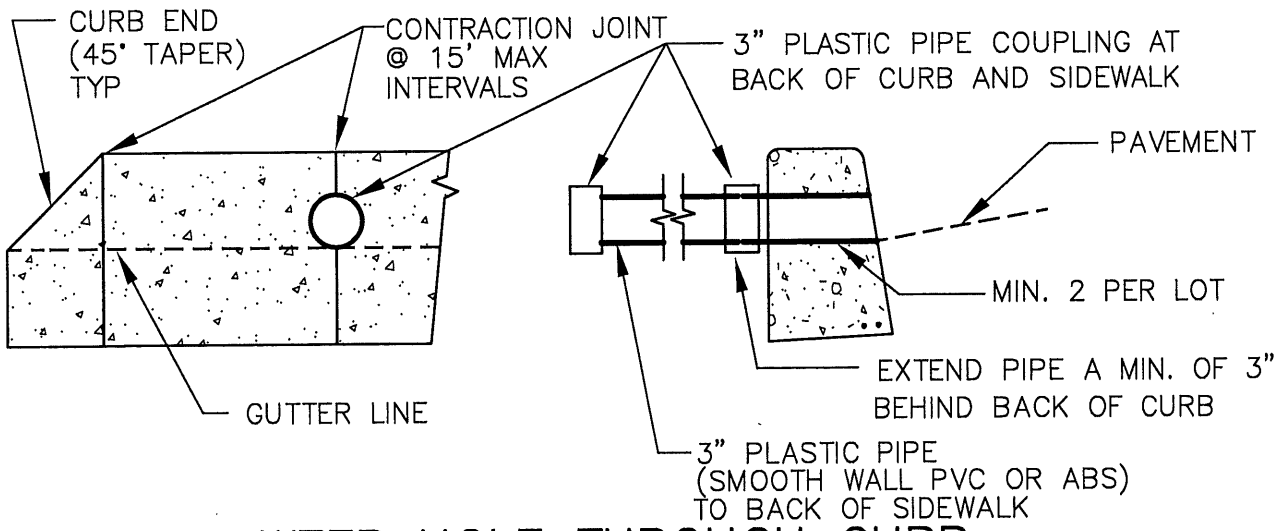

WEEP HOLE THROUGH CURB

NOTES

1. 7" CURB EXPOSURE FOR ARTERIAL & COLLECTOR STREETS WHERE TYPE C CURB ALLOWED. 6" EXPOSURE ALL OTHER PUBLIC STREETS, PRIVATE STREETS & PARKING LOTS.
2. A CONTRACTION JOINT SHALL BE PLACED ALONG AND OVER WEEP HOLE THROUGH THE SIDEWALK.
3. ALL CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
4. WHERE SIDEWALKS ARE TO BE CONSTRUCTED, EXTEND 3" PIPE TO BACK OF SIDEWALK LOCATION & INSTALL COUPLING.
5. INSTALL MIN. 2 WEEP HOLES ON ALL LOTS. ONE WEEP HOLE TO BE AT LOW POINT OF LOT, 5' FROM P/L. WEEP HOLES IN EXISTING CURBS SHALL BE CORE DRILLED.

LAST REVISION DATE: NOV 2011	
TYPE 'C' CURB AND WEEPHOLE (NTS)	
PHILOMATH, OR	DETAIL NO. 211

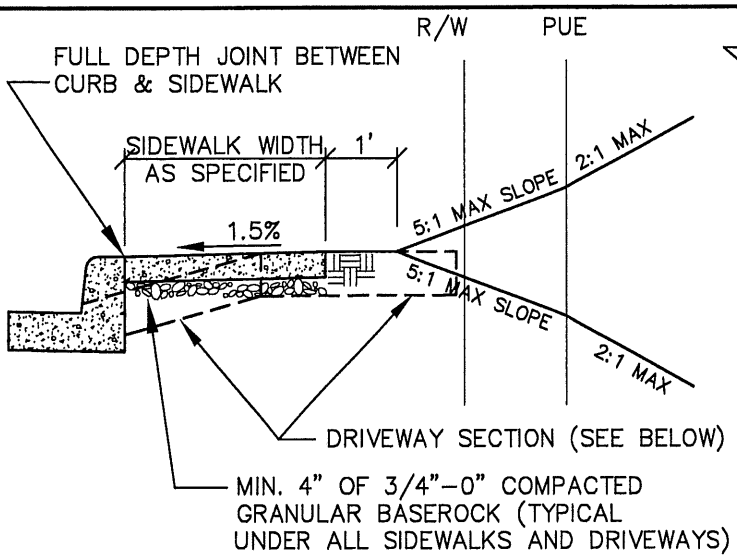

TYP. CROSS SECTION

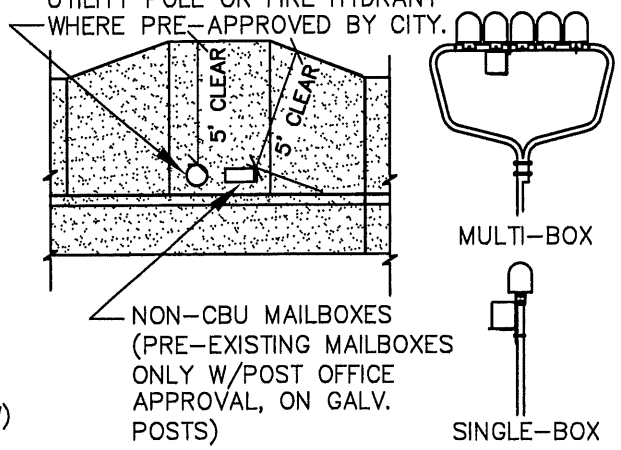

S/W AT OBSTRUCTION

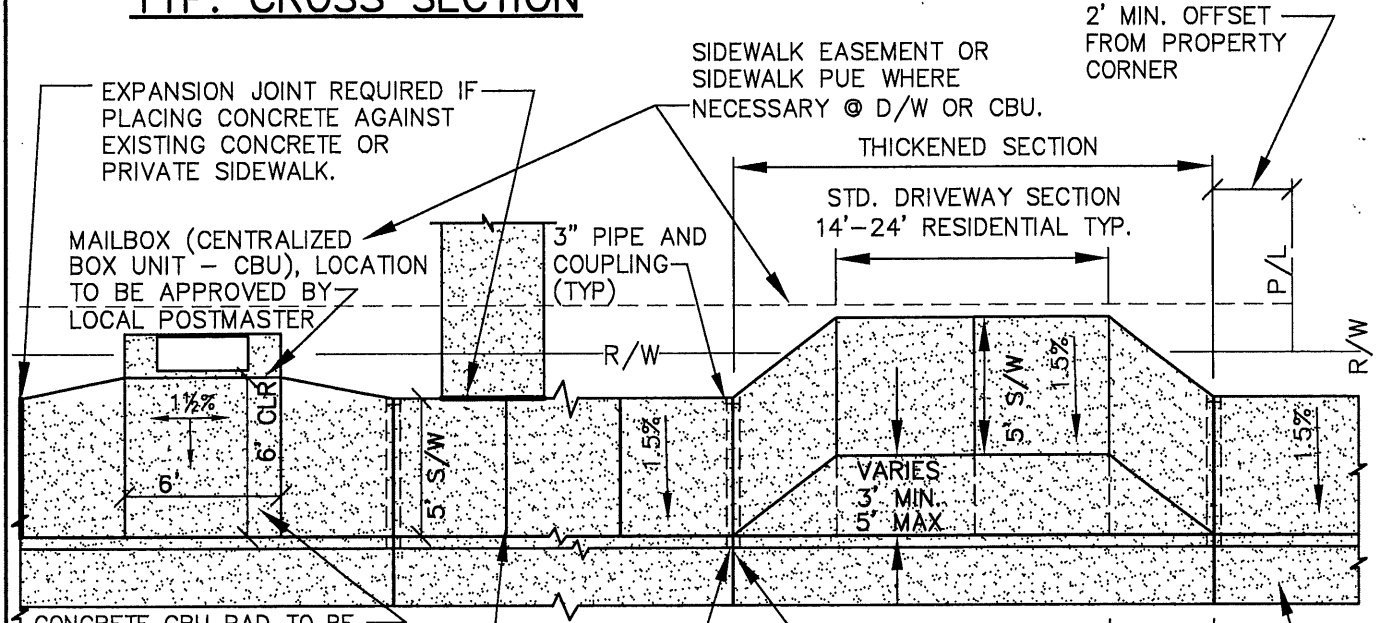

TYP. PLAN VIEW

NOTES:

1. CONCRETE DEPTH FOR STANDARD SIDEWALKS SHALL BE 4" MIN.
2. MONOLITHIC STREET CURB & SIDEWALK PLACEMENT IS PROHIBITED FOR PUBLIC SIDEWALKS.
3. SIDEWALKS THROUGH RESIDENTIAL DRIVEWAYS (INCLUDING WINGS) SHALL BE 6" MIN. THICKNESS. COMMERCIAL DRIVEWAYS SHALL BE 8" MIN. THICK.
4. SIDEWALKS 8' & WIDER SHALL HAVE A LONGITUDINAL CONTRACTION JOINT AT MIDPOINT.
5. CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
6. PCC APRONS JOINTED TO MATCH SIDEWALK PATTERN.
7. SIDEWALKS SHALL BE LOCATED ENTIRELY WITHIN PUBLIC RIGHT-OF-WAY OR SIDEWALK EASEMENTS, INCLUDING AT DRIVEWAYS & INTERSECTIONS.
8. ADA ACCESS TO CBU MAILBOXES SHALL CONFORM WITH SECTION 1111 OF OSSC (OREGON STRUCTURAL SPECIALTY CODE), INCLUDING AN ADA PEDESTRIAN CURB RAMP LOCATED WITHIN 50 FEET OF THE CBU. PROWAG REQUIRED 6'x6' TURING SPACE IN FRONT OF CBU SHALL NOT EXCEED 2% IN ANY DIRECTION. **CBU LAYOUT ABOVE ASSUMES STREET & CURB GRADE DOES NOT EXCEED 2%.**

LAST REVISION DATE: APR 2015	
CURBLINE SIDEWALKS AND DRIVEWAY APRONS (NTS)	
PHILOMATH, OR	DETAIL NO. 212

SEE DETAIL 212 FOR STANDARD MAILBOX LOCATION & MOUNTING DETAILS & INFORMATION.

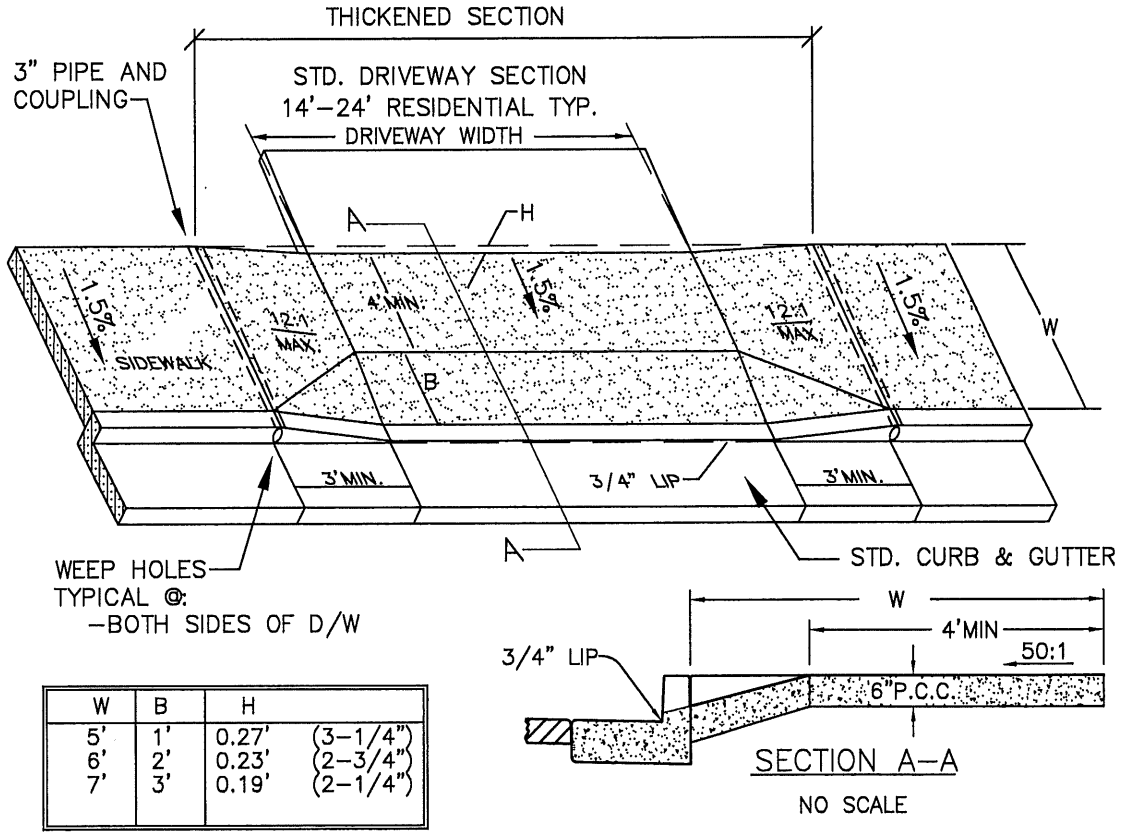

W	B	H	
5'	1'	0.27'	(3-1/4")
6'	2'	0.23'	(2-3/4")
7'	3'	0.19'	(2-1/4")

NOTES:

1. SEE DETAIL 212 FOR STANDARD APRON & SIDEWALK DETAILS. USE OF THIS DETAIL REQUIRES SPECIFIC APPROVAL BY PUBLIC WORKS PRIOR TO FORMING.
2. CONCRETE DEPTH FOR STANDARD SIDEWALKS SHALL BE 4" MIN.
3. SF & DUPLEX RESIDENTIAL DRIVEWAY SECTIONS INCLUDING SIDEWALKS THROUGH DRIVEWAYS SHALL BE 6" MIN. THICKNESS.
4. CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
5. PCC APRONS SHALL BE JOINTED TO MATCH SIDEWALK PATTERN.
6. PUBLIC SIDEWALKS SHALL BE LOCATED ENTIRELY WITHIN RIGHT-OF-WAY OR SIDEWALK EASEMENTS, INCLUDING SIDEWALKS THROUGH DRIVEWAY APRONS & AT CORNERS.
7. CROSS SLOPE IS MEASURED FROM HORIZONTAL.
8. RUNNING SLOPE OF SIDEWALK APPROACH TO LANDINGS SHALL TYPICALLY NOT EXCEED 1V:12H (8.33%), BUT SHALL NOT REQUIRE THE LENGTH TO EXCEED 15 FEET.

LAST REVISION DATE: APR 2015	
RESIDENTIAL D/W APRON CURBLINE SIDEWALK STEEP UPHILL LOTS ONLY (NTS)	
PHILOMATH, OR	DETAIL NO. 212A

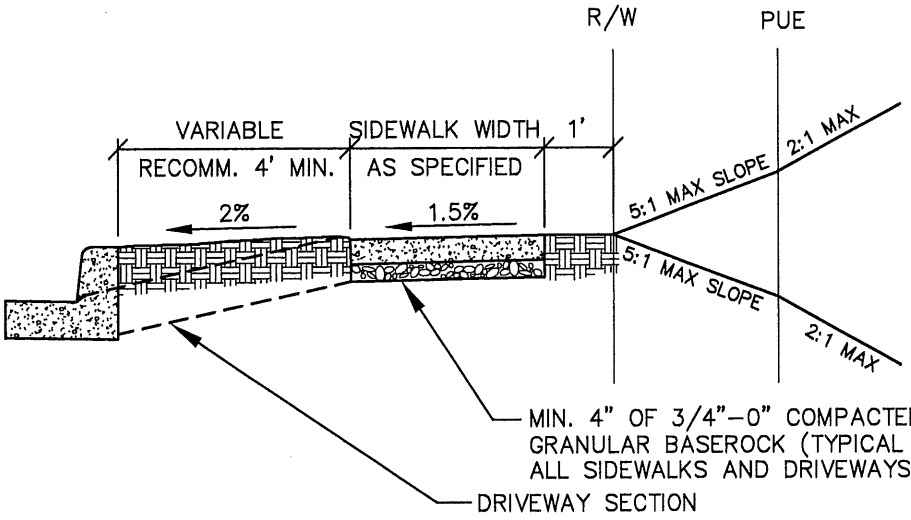

TYP. CROSS SECTION

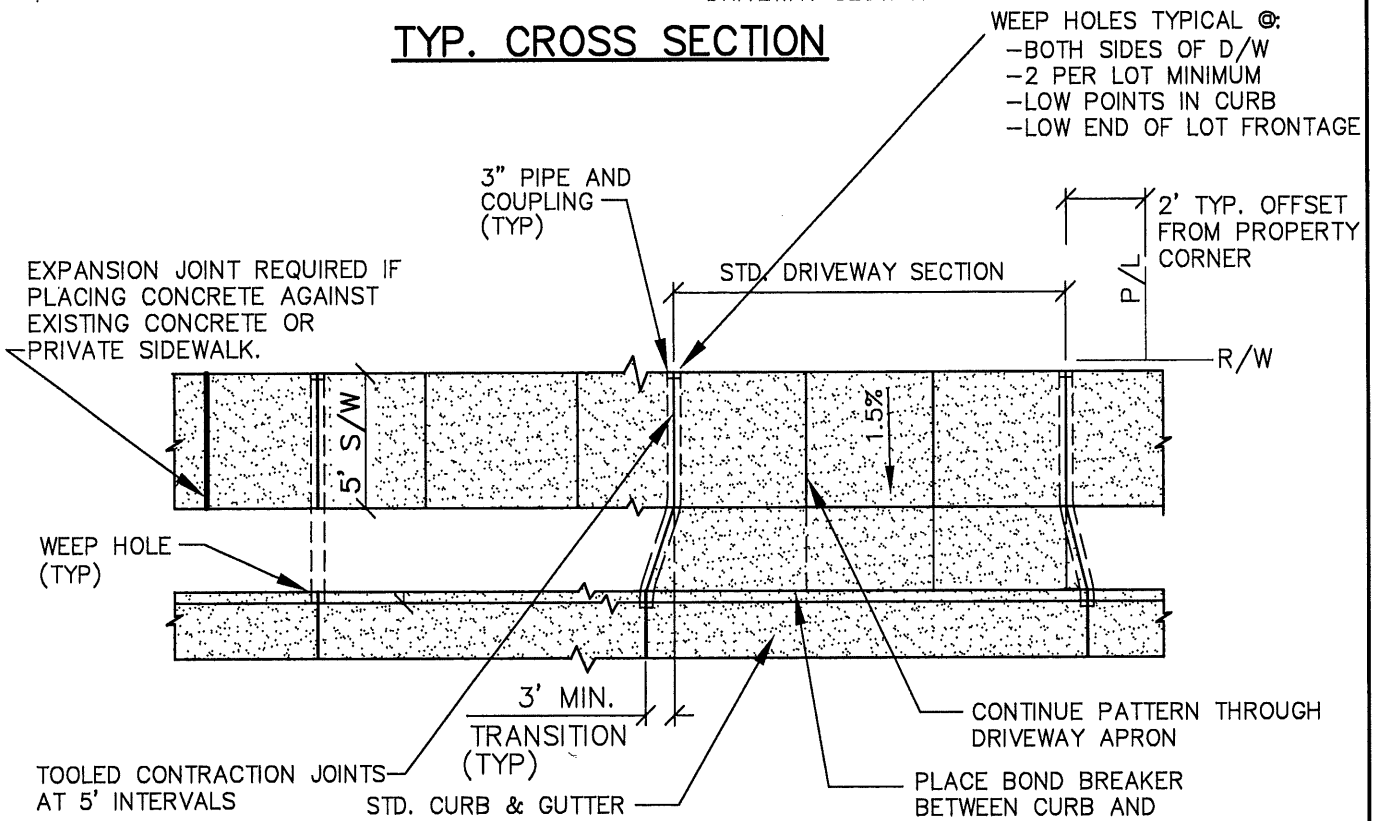

TYP. PLAN VIEW

NOTES:

1. CONCRETE DEPTH FOR STANDARD SIDEWALKS SHALL BE 4" MIN.
2. MONOLITHIC STREET CURB & DRIVEWAY PLACEMENT IS PROHIBITED FOR PUBLIC STREETS.
3. RESIDENTIAL DRIVEWAY SECTIONS WITHIN R.O.W, INCLUDING SIDEWALKS THROUGH DRIVEWAYS SHALL BE 6" MIN. THICKNESS. COMMERCIAL D/W & ALLEY APPROACHES SHALL BE 8" MIN. THICKNESS.
4. SIDEWALKS 10' & WIDER SHALL HAVE A LONGITUDINAL CONTRACTION JOINT 5' MAX. ON CENTER.
5. JOINT PCC APRONS TO MATCH SIDEWALK PATTERN.
6. CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
7. CBU MAILBOXES ON PROPERTY LINE SIDEWALKS SHALL MEET PROWAG STANDARDS, INCLUDING TURNING SPACE/ LANDING FRONTING CBU (6'x6' MIN, 1½% SLOPE), LANDING APPROACH WIDTHS/SLOPES/LENGTHS, AND CONCRETE THICKNESS AS SHOWN ON DETAILS 212 & 214C, AND PEDESTRIAN CURB RAMP LOCATED WITHIN 50 FEET OF THE CBU.

LAST REVISION DATE: APR 2015	
PROPERTY LINE SIDEWALKS AND DRIVEWAY APRONS (NTS)	
PHILOMATH, OR	DETAIL NO. 213

DOMES SHALL BE RED CONCRETE INSET PANELS
(CASTInTACT 3 OR EQUAL)

INSTALL TRUNCATED DOME DETECTABLE WARNING SURFACE AS SPECIFIED

SPACING: D=1.6" MIN. TO 2.40" MAX
0.65" MIN CLEAR BETWEEN DOME BASES

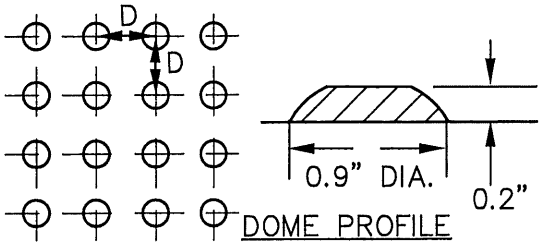

FIGURE A: TRUNCATED DOME DETAIL

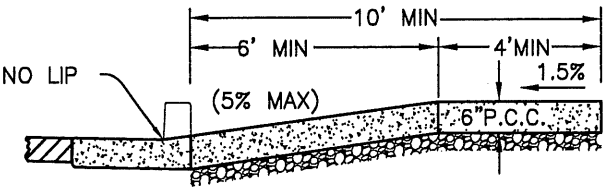

SECTION A

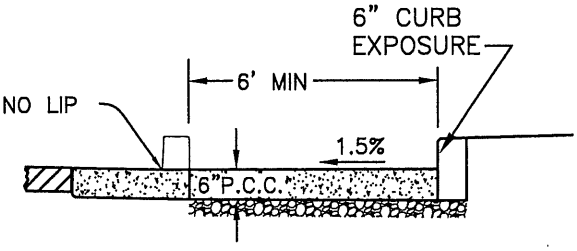

SECTION B

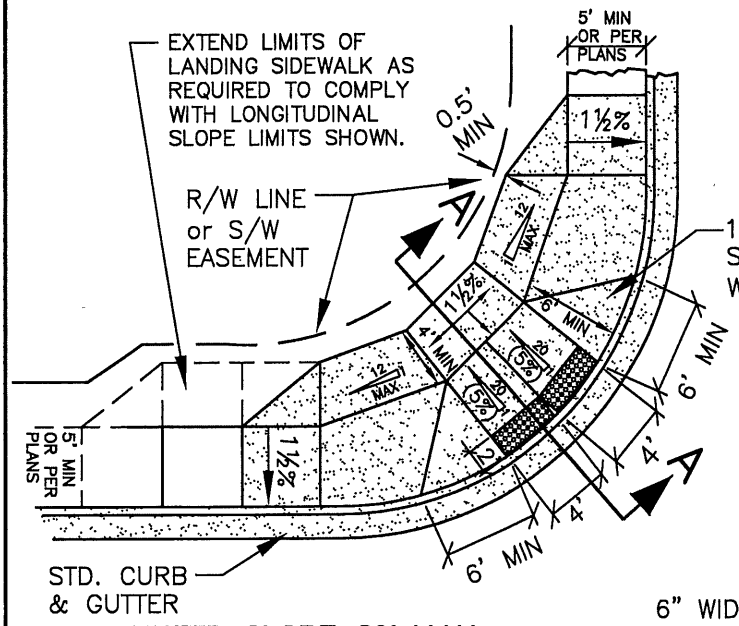

GUTTER SLOPE 2% MAX AT CURB RAMP
(SEE SECTION A)

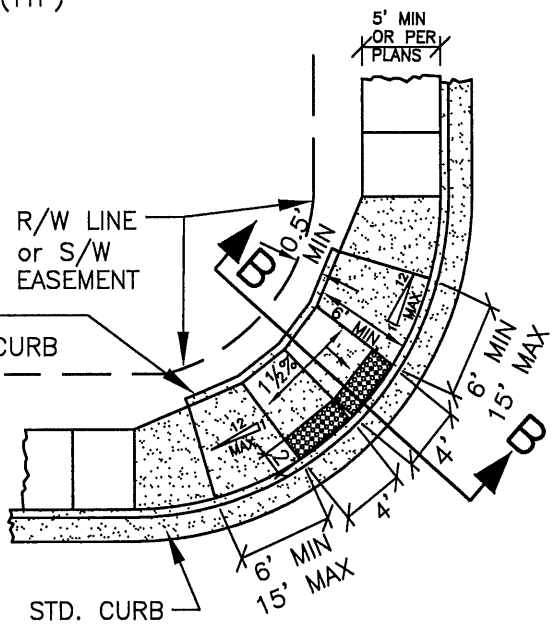

GUTTER SLOPE AROUND RADIUS 2% MAX
(SEE SECTION B)

GENERAL NOTES:

1. SEE FIGURE A FOR RAMP TEXTURE DETAIL.
2. SEE TYPICAL STREET SECTIONS FOR SIDEWALK WIDTH.
3. ALL RAMPS AND TRANSITIONS SHALL BE ADA & PROWAG COMPLIANT.
4. LANDINGS & TURNING AREAS SHALL HAVE A MIN. WIDTH & DEPTH OF 4 FEET.
5. CROSS SLOPES SHOWN ARE MEASURED FROM HORIZONTAL.
6. **SHADED SIDEWALK & RAMP AREAS TO BE CONSTRUCTED W/STREET IMPROVEMENTS, AND SHALL BE 6" THICK CONCRETE.**
7. DROP CURBS FOR HANDICAP RAMPS SHALL BE CONSTRUCTED WITH NO LIP AT THE GUTTER LINE.
8. PROVIDE 6-INCH WIDE CONCRETE LANDSCAPE CURB SHOWN AT BACK OF RAMP ON DOWNHILL SIDE OF STREET, OR AS REQUIRED TO CONTAIN LANDSCAPING.
9. DOMES PANELS TO BE MASCO CASTINTACT OR EQUAL.
10. PROVIDE 4" MIN. COMPACTED BASEROCK UNDER ALL S/W.
11. **WHERE GRADE LIMITS SHOWN CANNOT BE SATISFIED (IE. APPROACH, LANDING OR WINGS), CONSTRUCT RAMP SHOWN ON DETAIL 214B & TRANSITION TO CURBLINE SIDEWALK.**
12. RUNNING SLOPE OF SIDEWALK APPROACH TO LANDINGS SHALL TYPICALLY NOT EXCEED 1V:12H (8.33%), BUT SHALL NOT REQUIRE THE LENGTH TO EXCEED 15 FEET.

LAST REVISION DATE: MAR 2016	
INTERSECTION CURB RAMPS CURB LINE SIDEWALKS LOCAL STREETS (NTS)	
PHILOMATH, OR	DETAIL NO. 214A

DOMES SHALL BE RED CONCRETE INSET PANELS
(CASTInTACT 3 OR EQUAL)

INSTALL TRUNCATED DOME DETECTABLE WARNING SURFACE AS SPECIFIED

SPACING: D=1.6" MIN. TO 2.40" MAX
0.65" MIN CLEAR BETWEEN DOME BASES

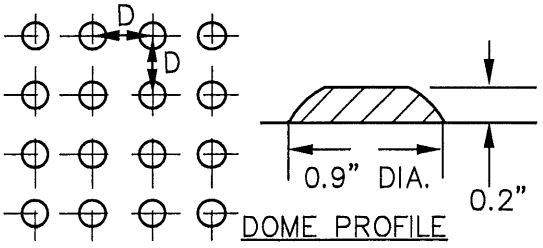

FIGURE A: TRUNCATED DOME DETAIL

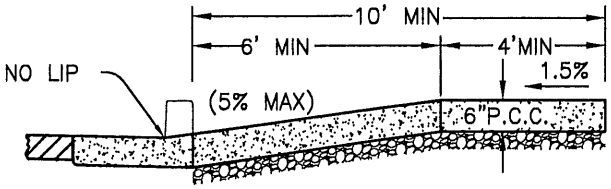

SECTION

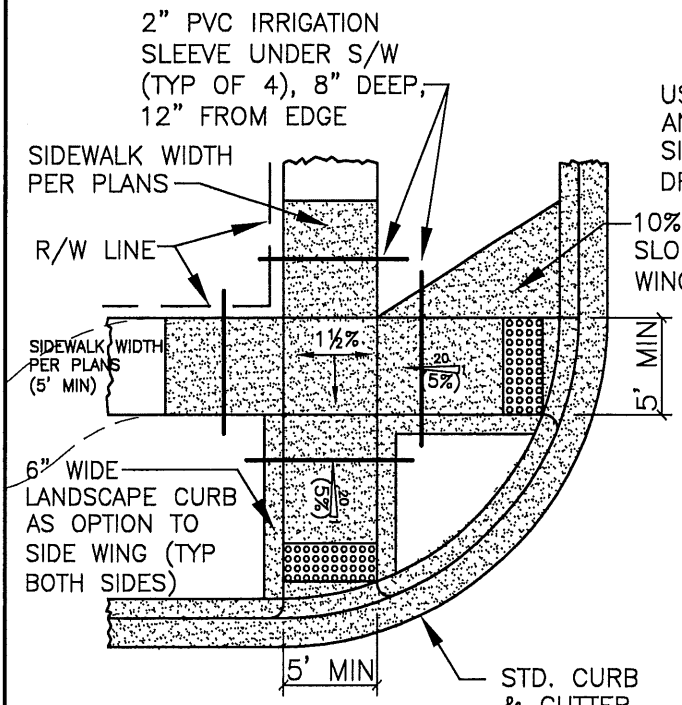

SEPARATE RAMP FOR PROPERTY LINE SIDEWALKS

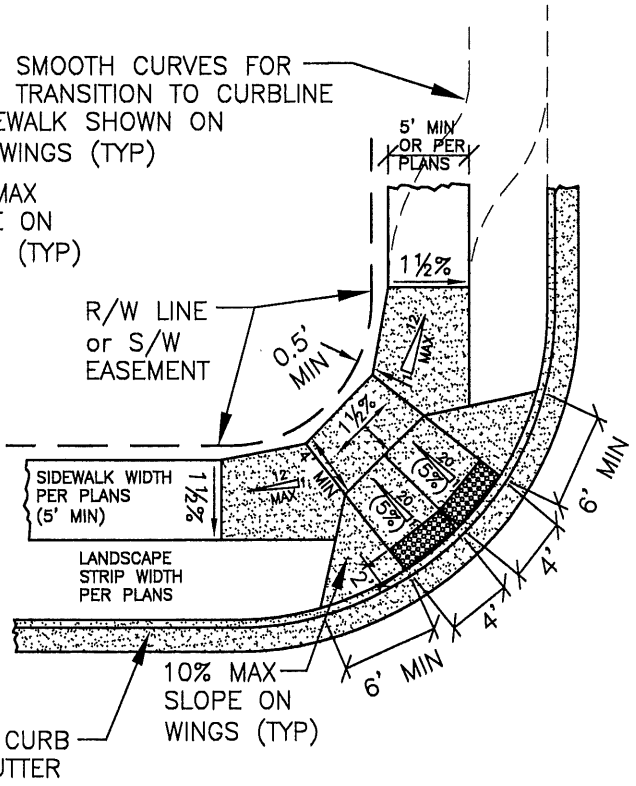

DOUBLE RAMPS FOR PROPERTY LINE OR CURBLINE SIDEWALKS
(SEE SECTION A)

GENERAL NOTES:

1. SEE FIGURE A FOR RAMP TEXTURE DETAIL.
2. SEE TYPICAL STREET SECTIONS FOR SIDEWALK WIDTH.
3. ALL RAMPS AND TRANSITIONS SHALL BE ADA & PROWAG COMPLIANT.
4. LANDINGS & TURNING AREAS SHALL HAVE A MIN. WIDTH & DEPTH OF 4 FEET.
5. CROSS SLOPES SHOWN ARE MEASURED FROM HORIZONTAL.
6. **SHADED SIDEWALK & RAMP AREAS TO BE CONSTRUCTED W/STREET IMPROVEMENTS, AND SHALL BE 6" THICK CONCRETE.**
7. DROP CURBS FOR HANDICAP RAMPS SHALL BE CONSTRUCTED WITH NO LIP AT THE GUTTER LINE.
8. PROVIDE 4–INCH MIN RADIUS ON ALL RETURNED CURBS.
9. DOMES PANELS TO BE MASCO CASTINTACT OR EQUAL.
10. PROVIDE 4" MIN. COMPACTED BASEROCK UNDER ALL S/W.
11. RUNNING SLOPE OF SIDEWALK APPROACH TO LANDINGS SHALL TYPICALLY NOT EXCEED 1V:12H (8.33%), BUT SHALL NOT REQUIRE THE LENGTH TO EXCEED 15 FEET.

LAST REVISION DATE: DEC 2015	
INTERSECTION CURB RAMPS PROPERTY LINE SIDEWALKS LOCAL STREETS (NTS)	
PHILOMATH, OR	DETAIL NO. 214B

DOMES SHALL BE RED CONCRETE INSET PANELS
(CASTInTACT 3 OR EQUAL)

INSTALL TRUNCATED DOME DETECTABLE WARNING SURFACE AS SPECIFIED

SPACING: D=1.6" MIN. TO 2.40" MAX
0.65" MIN CLEAR BETWEEN DOME BASES

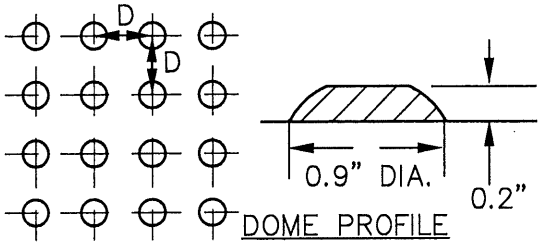

FIGURE A: TRUNCATED DOME DETAIL

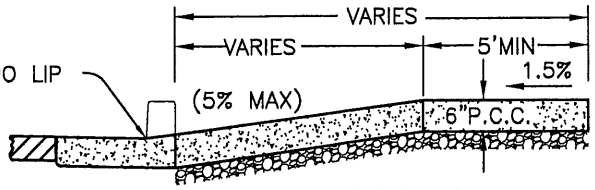

SECTION A

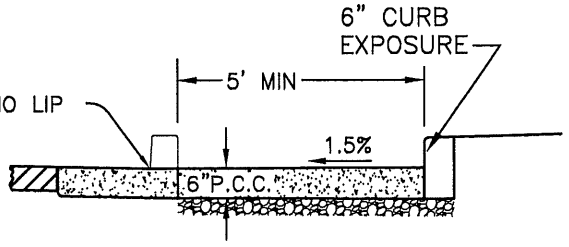

SECTION B

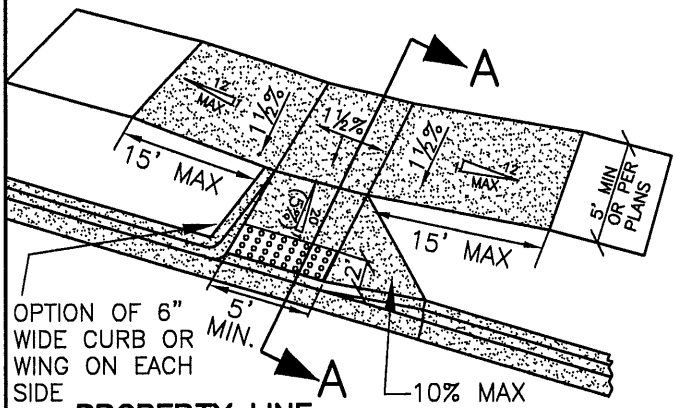

PROPERTY LINE SIDEWALK RAMP
(SEE SECTION A)

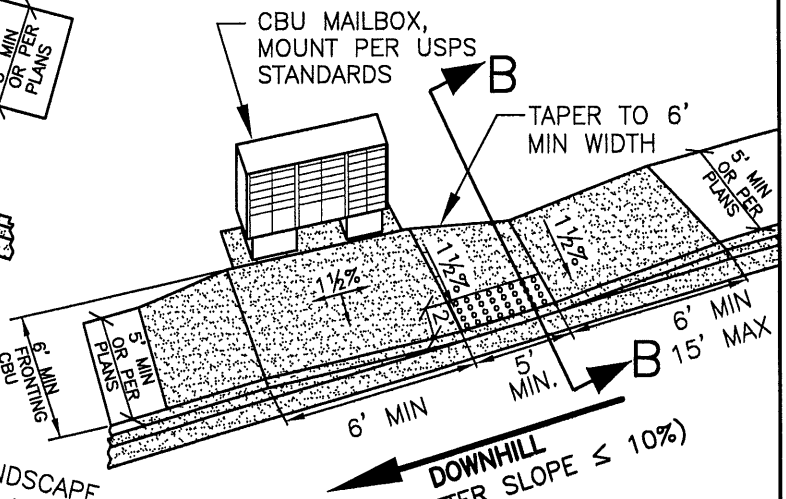

CURBLINE SIDEWALK RAMP W/ADJACENT CBU
(GUTTER SLOPE 10% MAX)
(SEE SECTION B)

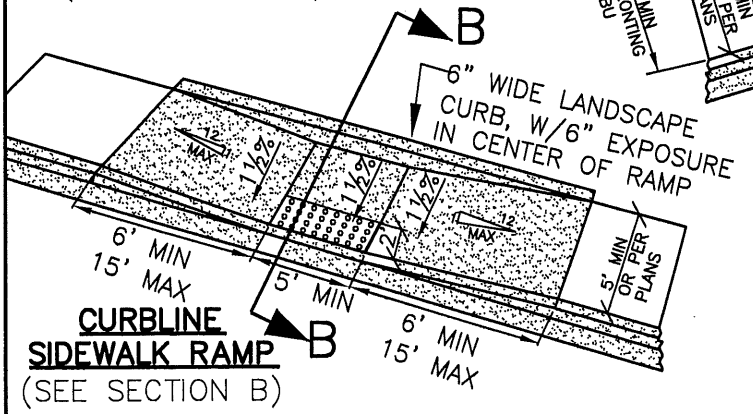

CURBLINE SIDEWALK RAMP
(SEE SECTION B)

GENERAL NOTES:

1. SEE FIGURE A FOR RAMP TEXTURE DETAIL.
2. SEE TYPICAL STREET SECTIONS FOR SIDEWALK WIDTH.
3. ALL RAMPS AND TRANSITIONS SHALL BE ADA & PROWAG COMPLIANT.
4. LANDINGS & TURNING AREAS SHALL HAVE A MIN. WIDTH & DEPTH OF 4 FEET.
5. CROSS SLOPES SHOWN ARE MEASURED FROM HORIZONTAL.
6. **SHADED SIDEWALK & RAMP AREAS TO BE CONSTRUCTED W/STREET IMPROVEMENTS, AND SHALL BE 6" THICK CONCRETE.**
7. DROP CURBS FOR HANDICAP RAMPS SHALL BE CONSTRUCTED WITH NO LIP AT THE GUTTER LINE.
8. PROVIDE 4–INCH MIN RADIUS ON ALL RETURNED CURBS.
9. DOMES PANELS TO BE MASCO CASTINTACT OR EQUAL.
10. PROVIDE 4" MIN. COMPACTED BASEROCK UNDER ALL S/Ws.
11. RUNNING SLOPE OF SIDEWALK APPROACH TO LANDINGS SHALL TYPICALLY NOT EXCEED 1V:12H (8.33%), BUT SHALL NOT REQUIRE THE LENGTH TO EXCEED 15 FEET.

LAST REVISION DATE: DEC 2015	
CURB RAMPS BETWEEN INTERSECTIONS (NTS)	
PHILOMATH, OR	DETAIL NO. 214C

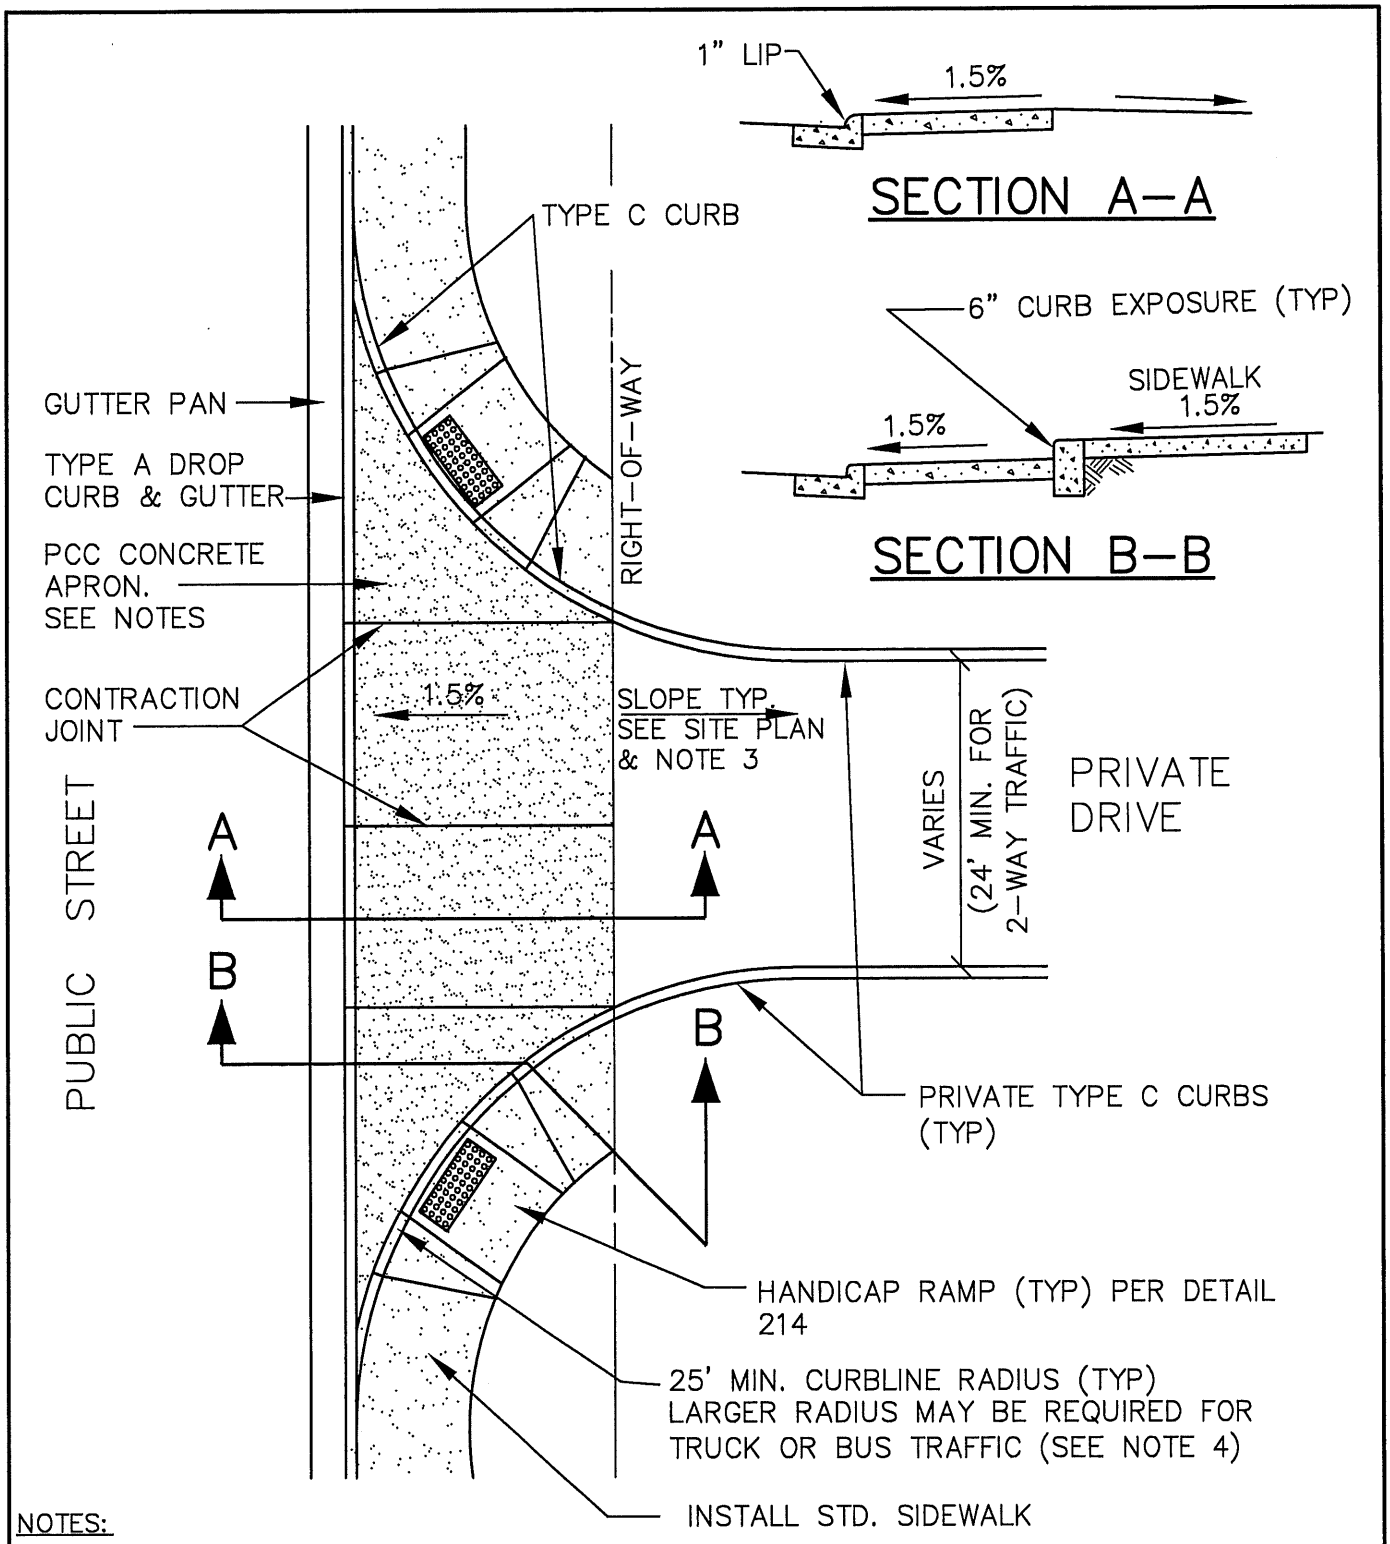

NOTES:

1. CONCRETE APRON BE 8" MIN. THICK 3300 PCC WITH #3 REBAR @ 12" O.C. EACH WAY, OR 6"X6" 10 GA. WELDED WIRE MESH, SET ON 3" DOBIES.
2. MIN. 4" OF 3/4"–0" COMPACTED GRANULAR BASEROCK (TYPICAL UNDER ALL SIDEWALKS AND CONCRETE DRIVEWAY APPROACHES).
3. PRIVATE CATCH BASINS ARE REQUIRED BEHIND DRIVEWAY APRON IF THE DRIVEWAY OR THE PARKING LOT BEYOND DRIVEWAY APRON SLOPES & DRAINS TOWARD THE STREET (IE. ACROSS THE PEDESTRIAN PATH).
4. TURNING RADIUS OF ANTICIPATED LARGEST VEHICLE TO BE VERIFIED DURING DESIGN.

LAST REVISION DATE: JUNE 2016	
COMMERCIAL/INDUSTRIAL STYLE DRIVEWAY APPROACH (NTS)	
PHILOMATH, OR	DETAIL NO. 216

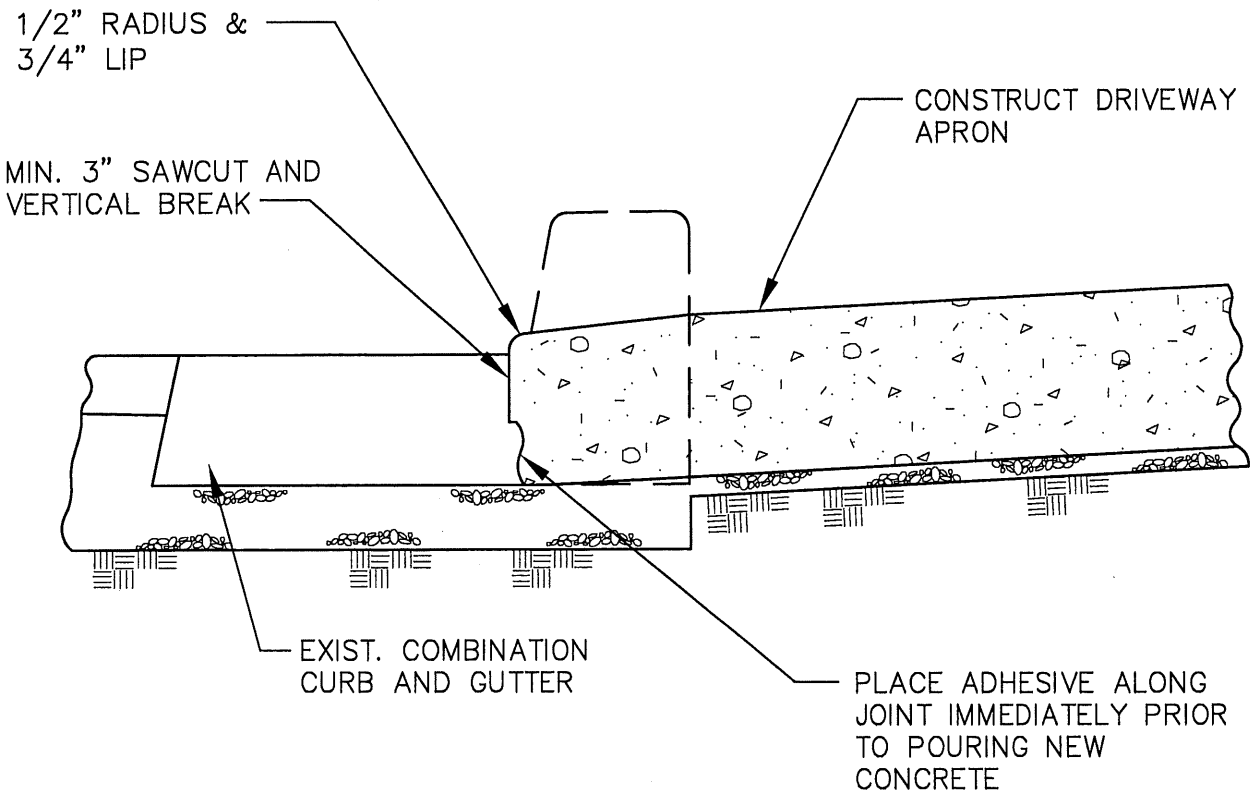

NOTES:

1. ONLY ALLOWED ON EXISTING PAVED STREETS.
2. SAWCUT THROUGH GUTTER PAN SHALL BE MADE AS CLOSE TO CURB FACE AS POSSIBLE.
3. COMPLETE CURB AND GUTTER SHALL NOT BE REMOVED UNLESS APPROVED BY THE CITY ENGINEER PRIOR TO START OF CONSTRUCTION.
4. WHEN TYPE 'C' CURBS ARE REMOVED, A MINIMUM OF 2 FEET OF PAVEMENT (MEASURED FROM THE FACE OF CURB) SHALL BE REMOVED AND REPLACED UNLESS OTHERWISE APPROVED BY THE CITY
5. ANY AC SAWCUTS WILL REQUIRE A BENCH GRIND (PER DETAILS 302A & 302B) IN CONJUNCTION WITH REPAVING.

LAST REVISION DATE: MAY 2014	
CURB KNOCKOUT FOR NEW DRIVEWAYS ON EXISTING CURBED STREETS (NTS)	
PHILOMATH, OR	DETAIL NO. 217

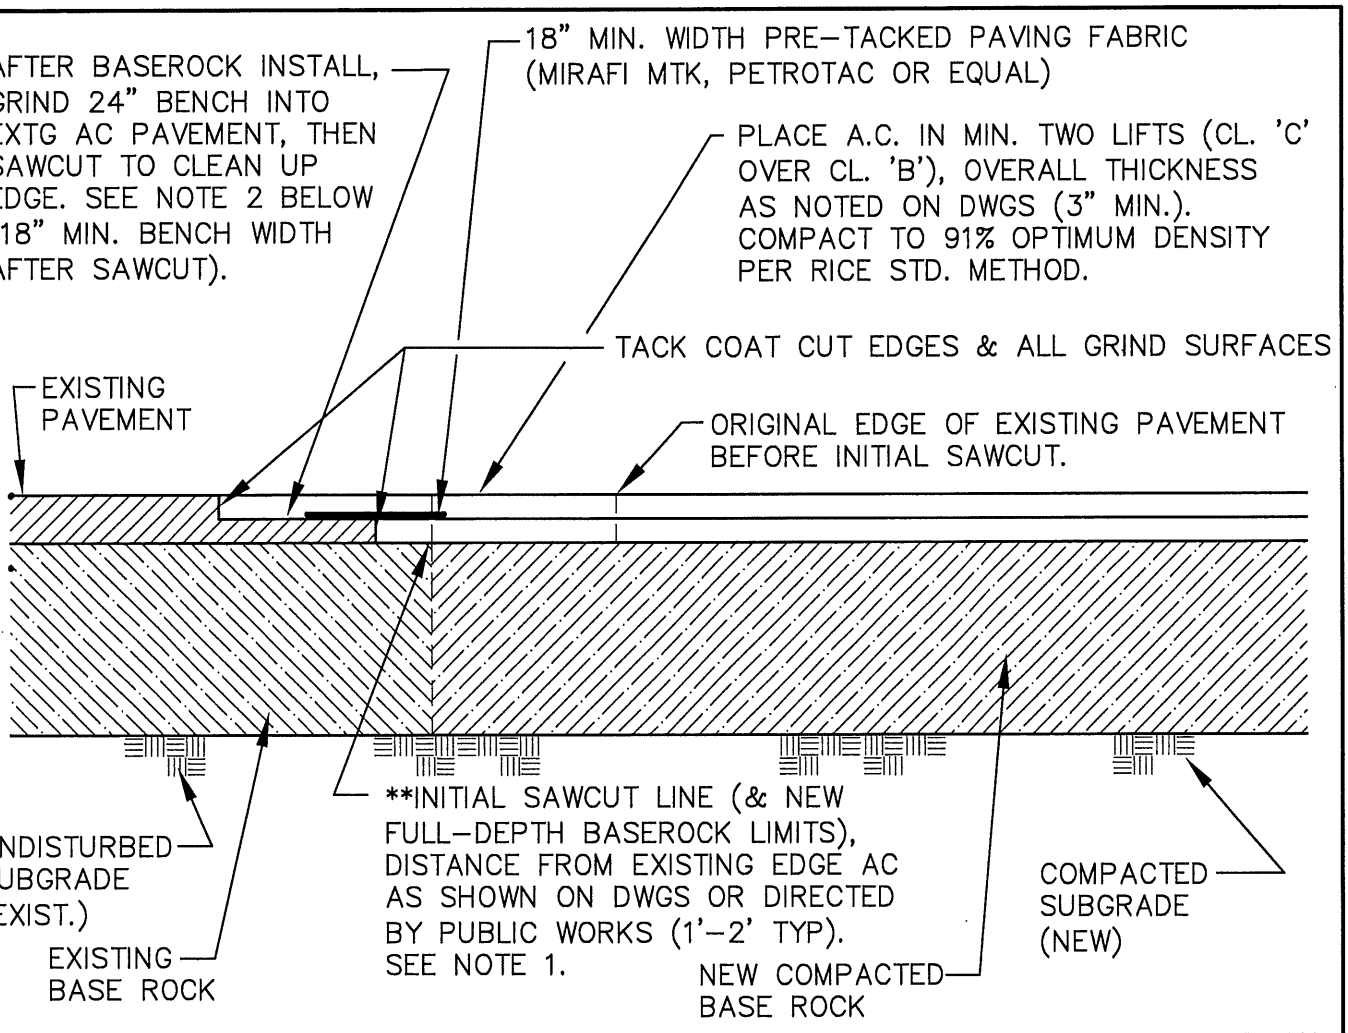

****BENCH GRIND REQUIREMENT SHOWN DOES NOT REPLACE ANY REQUIREMENT NOTED ON DRAWINGS FOR SAWCUT BACK FROM EDGE OF EXISTING AC & INSTALLATION OF NEW BASEROCK. BENCH GRIND REQUIREMENT APPLIES AFTER ALL EXCAVATION & BASEROCK PLACEMENT (PRIOR TO PAVING), TO AVOID FULL DEPTH AC JOINTS.**

NOTES:

1. INITIAL SAWCUT SHOWN ABOVE** TO OCCUR PRIOR TO EXCAVATION FOR NEW BASEROCK. SAWCUT LIMITS (& NEW BASEROCK LIMITS) MAY BE INCREASED BY PUBLIC WORKS BASED ON ACTUAL FIELD CONDITIONS (IE. INADEQUATE BASEROCK AT TRANSITION POINT, ETC.).
2. AFTER INSTALLATION OF NEW BASEROCK (PRIOR TO PAVING), GRIND 24" WIDE BENCH ALONG EDGE OF EXISTING AC (2" DEEP TYP), THEN SAWCUT TO CLEAN UP EDGE AS REQUIRED (FINISHED BENCH GRIND TO EXTEND TO A POINT 18" MINIMUM FROM FINAL SAWCUT LOCATION).
3. TACK COAT CUT EDGES AND INSTALL BASE LIFT OF AC LEVEL WITH BENCH GRIND.
4. INSTALL PAVING FABRIC AT ALL JOINTS, TACK COAT ALL GRIND SURFACES & EDGES, INSTALL TOP LIFT OF AC.
5. SAND SEAL ALL JOINTS (REMOVE EXCESS SAND AFTER CURE).
6. ALONG WIDENED STREETS, THE CONTRACTOR SHALL VERIFY THAT THE PROPOSED CURB/GUTTER ELEVATIONS MATCH THE EXISTING EDGE OF PAVEMENT, BASED ON THE DESIGN STREET CROSS SLOPES SHOWN ON THE DRAWINGS AND THE SPECIFIED CURB EXPOSURE. ANY DISCREPANCIES SHALL BE REPORTED TO THE ENGINEER PRIOR TO PLACEMENT OF CURB FORMS OR STRINGLINE. CURBS WHICH ARE PLACED TOO HIGH OR TOO LOW SHALL BE REMOVED AND REPLACED AS DIRECTED BY THE CITY.

LAST REVISION DATE: SEPT 2016	
AC STREET CUT FOR STREET WIDENING OR EXTENSION (NTS)	
PHILOMATH, OR	DETAIL NO. 219

FIRE CODE NOTE:
ALL FIRE LANES, TURNAROUNDS AND ASSOCIATED IMPROVEMENTS SHALL COMPLY WITH THE MOST CURRENT VERSION OF THE OREGON FIRE CODE (OFC).

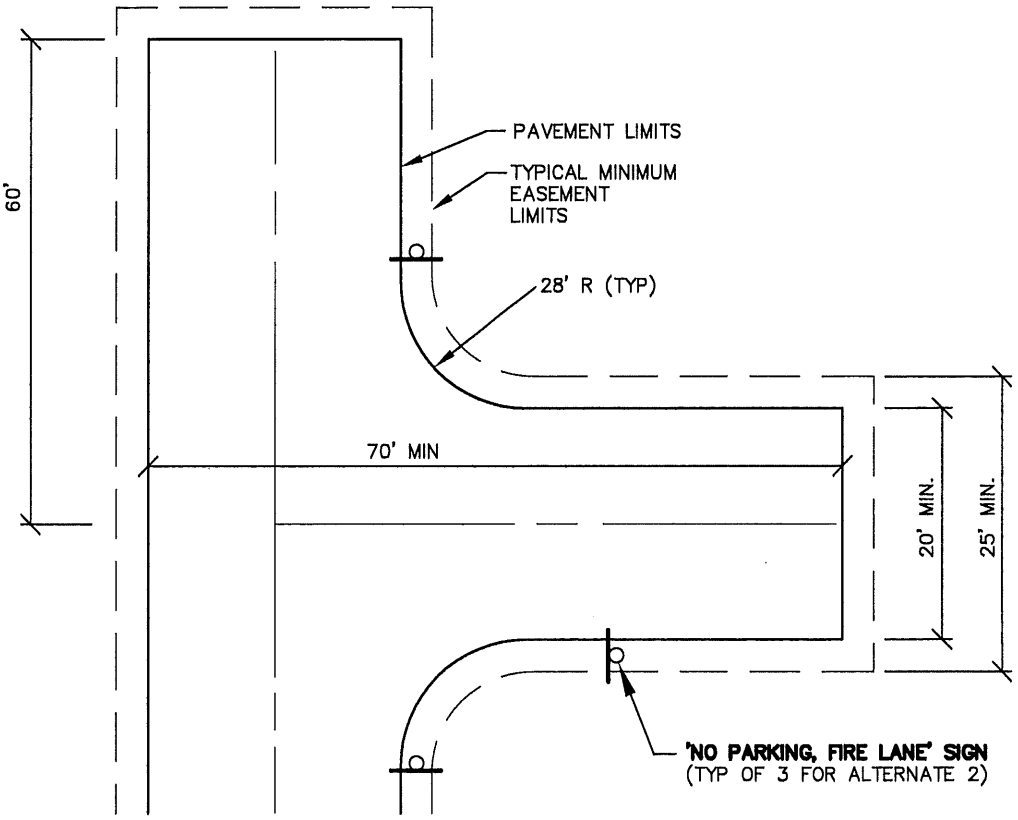

ALT 2

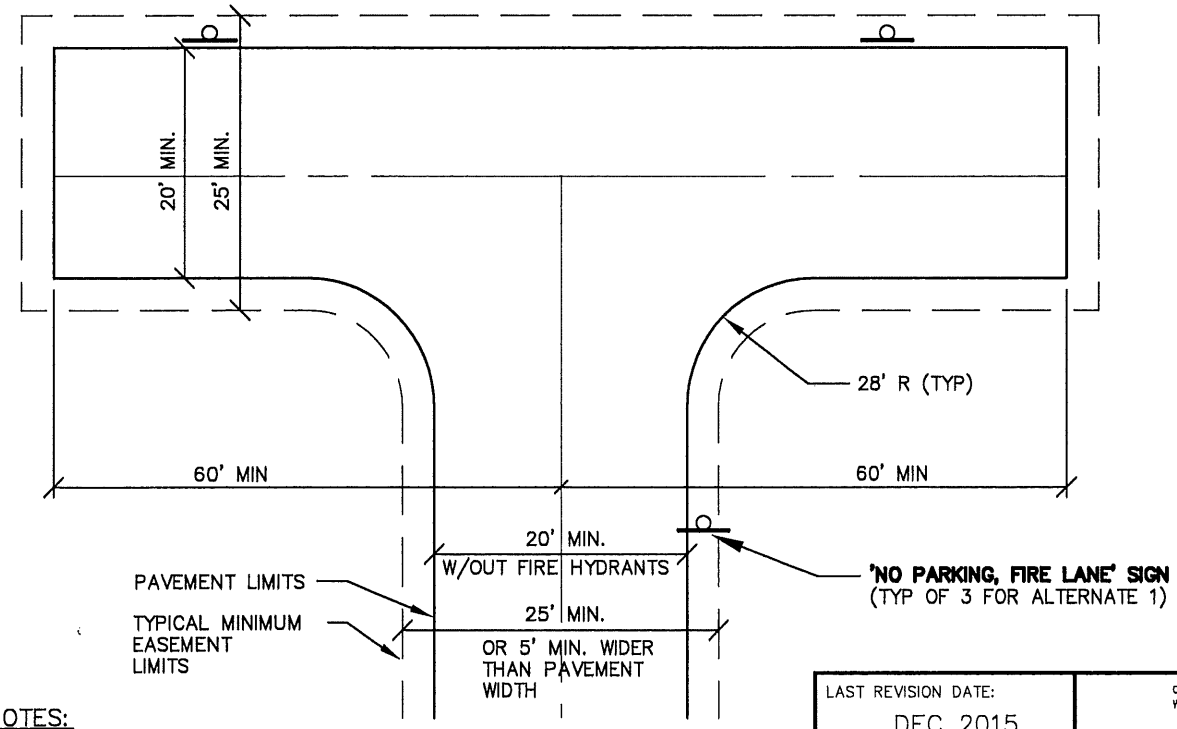

NOTES:

1. 'NO PARKING/FIRE LANE' SIGNS REQUIRED WITHIN LIMITS OF TURN-AROUND AS SHOWN, & AT TYPICAL 50 FOOT MAXIMUM INTERVALS ALONG LENGTH OF FIRE LANE OR PER OFC REQUIREMENTS.
2. THESE ARE TYPICAL MINIMUM DESIGNS AS REQUIRED BY THE 2010 OFC D103.4 & FIGURE D103.1. ALTERNATE DESIGNS SHALL MEET THE APPROVAL OF THE LOCAL FIRE MARSHALL.
3. PAVEMENT DIMENSIONS SHOWN REFERS TO TOTAL DRIVABLE WIDTH BETWEEN CURBS IF PRESENT.
4. MIN. 26' PAVEMENT WIDTH AT FIRE HYDRANTS (OFC D103.1).

LAST REVISION DATE: DEC 2015	

FIRE CODE/FIRE LANE HAMMERHEAD TURNAROUND (PRIVATE DRIVES ONLY)

(NTS)

PHILOMATH, OR	DETAIL NO. 220

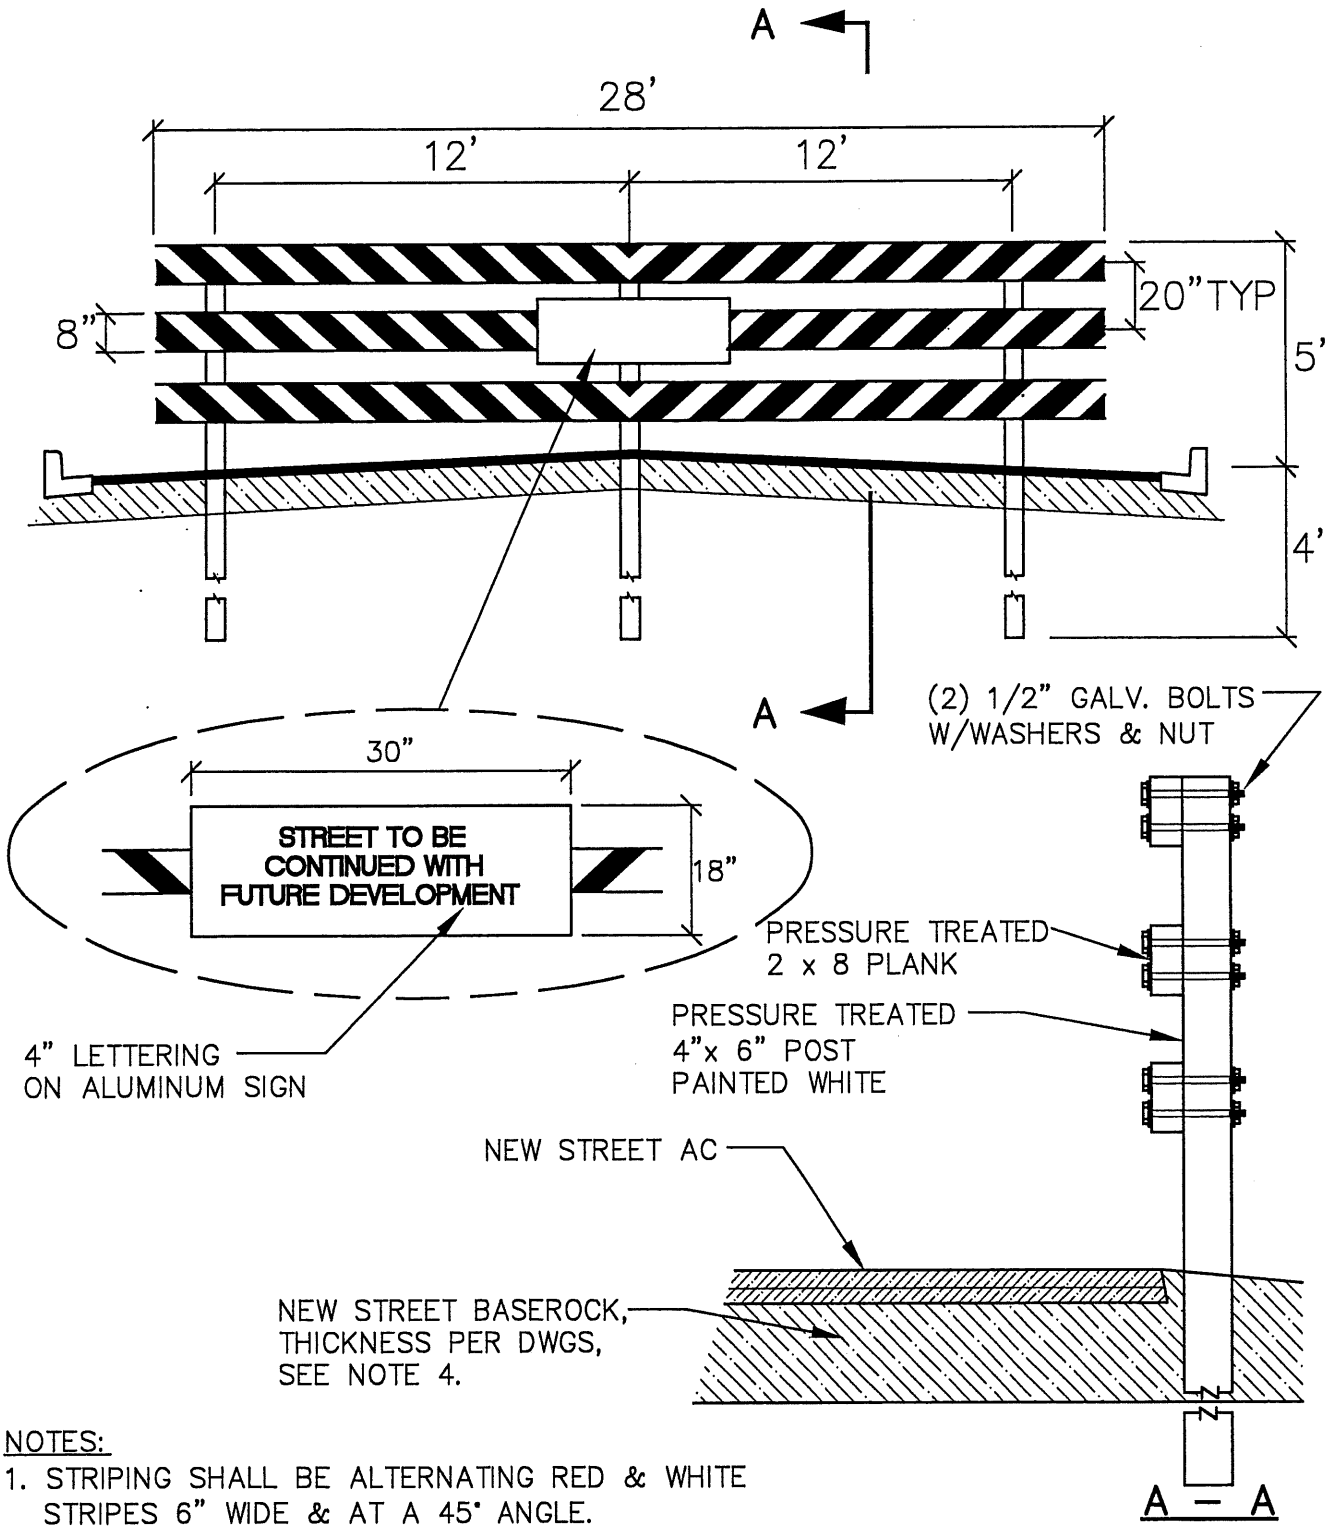

NOTES:

1. STRIPING SHALL BE ALTERNATING RED & WHITE STRIPES 6" WIDE & AT A 45° ANGLE.
2. STRIPING SHALL BE EITHER RETRO-REFLECTIVE TAPE OR PAINTED WITH A SEALED RETRO-REFLECTIVE SURFACE.
3. BARRICADE SHALL BE LOCATED WITHIN THE RESERVE STRIP, IF PRESENT.
4. FULL DEPTH BASEROCK SHALL EXTEND BEYOND BARRICADE POSTS AS SHOWN.

LAST REVISION DATE: SEPT 2016	
STREET BARRICADE (STUB STREETS) (NTS)	
PHILOMATH, OR	DETAIL NO. 225

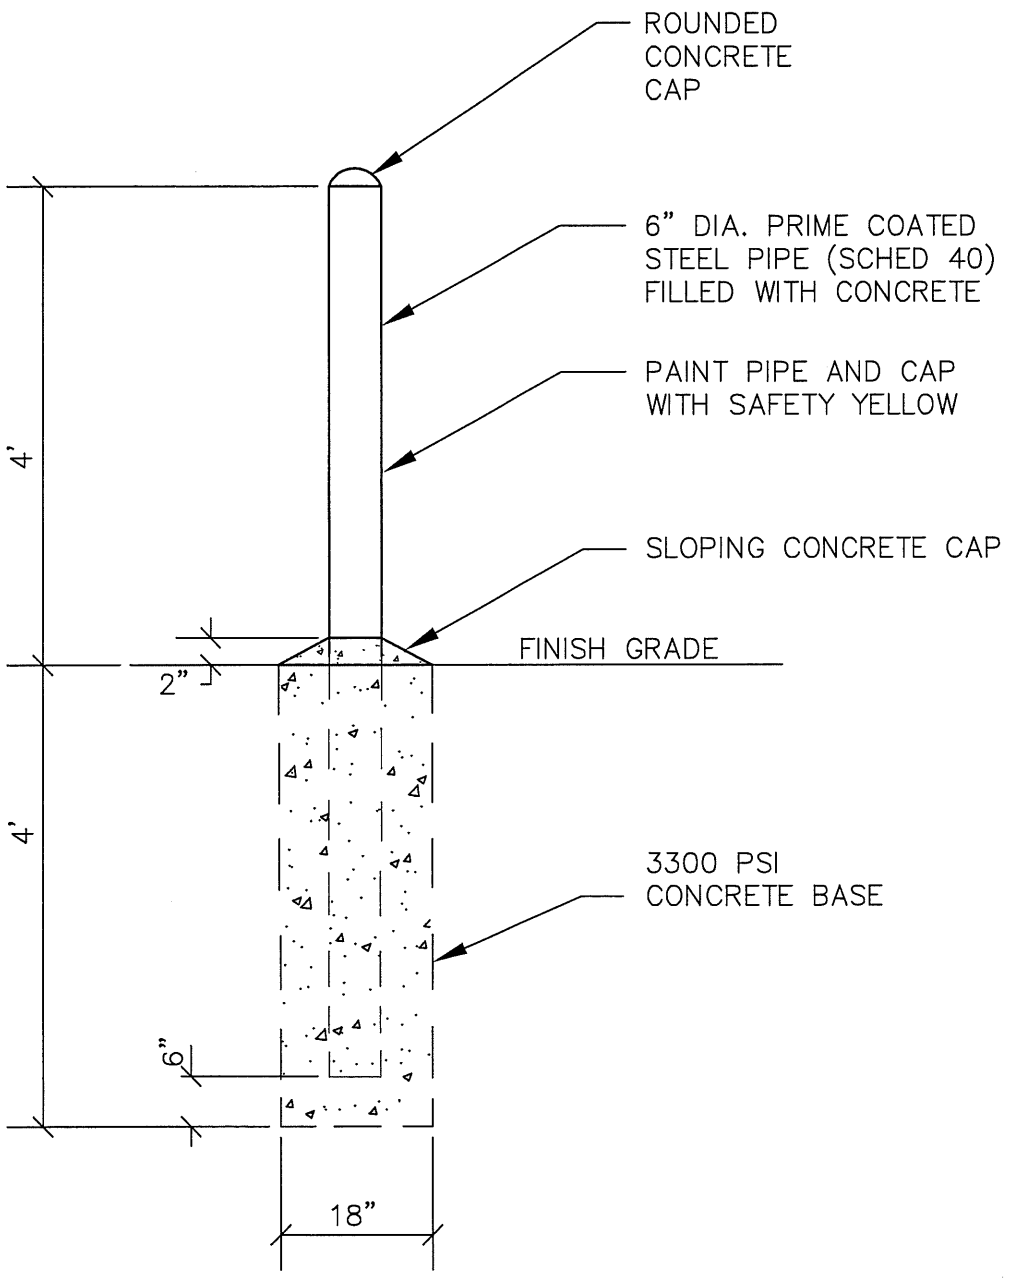

LAST REVISION DATE: JUNE 1998	
6-INCH BOLLARD (GUARD POST) (NTS)	
PHILOMATH, OR	DETAIL NO. 226

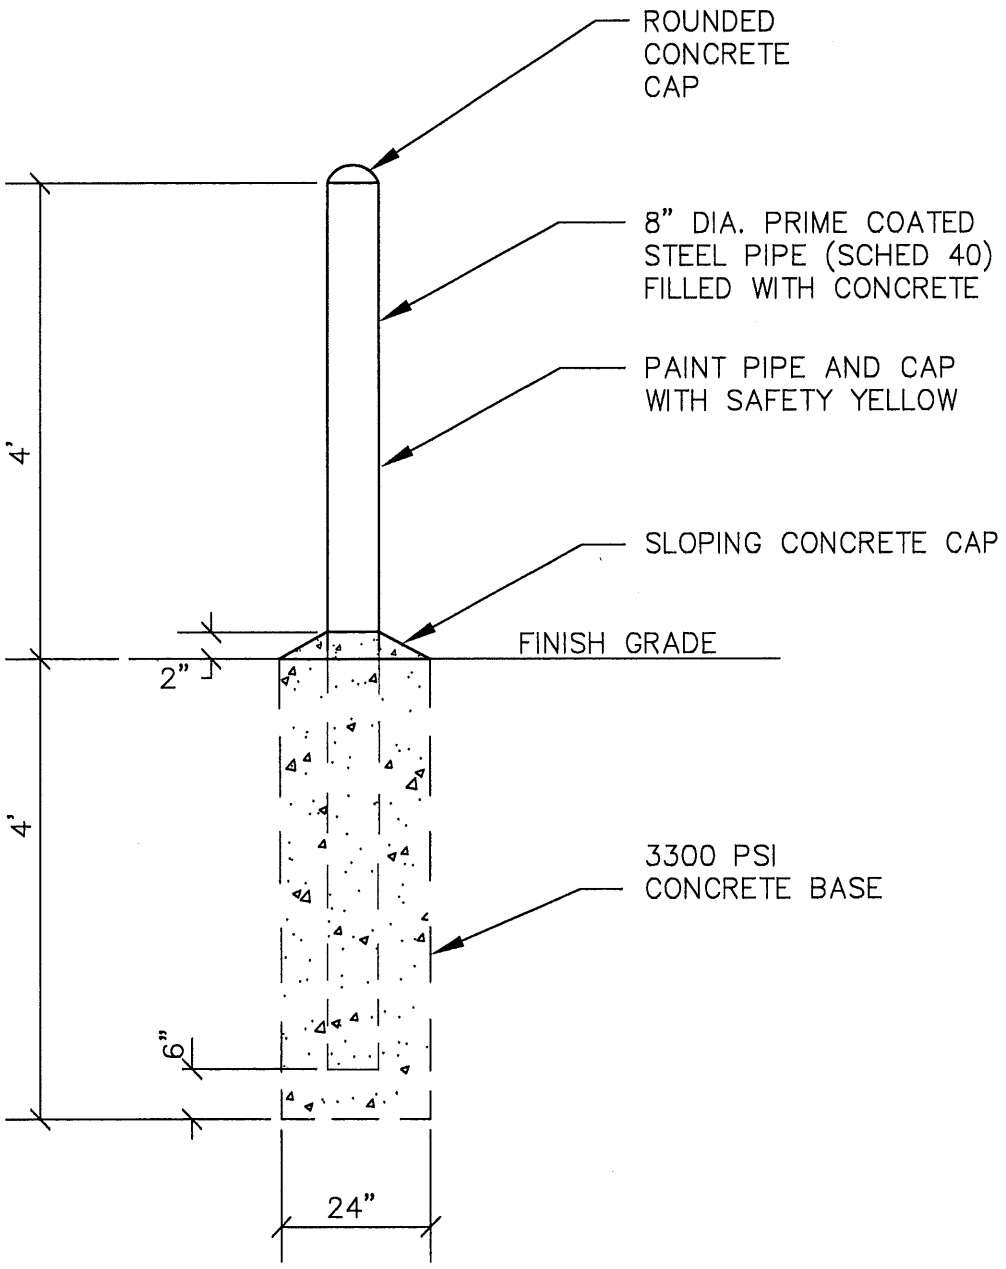

NOTES:

1. 8" BOLLARD TYPICALLY ONLY REQUIRED FOR LARGE COMMERCIAL/INDUSTRIAL TRUCK TRAFFIC.

LAST REVISION DATE: DEC 2015	
8-INCH BOLLARD (GUARD POST) (NTS)	
PHILOMATH, OR	DETAIL NO. 227

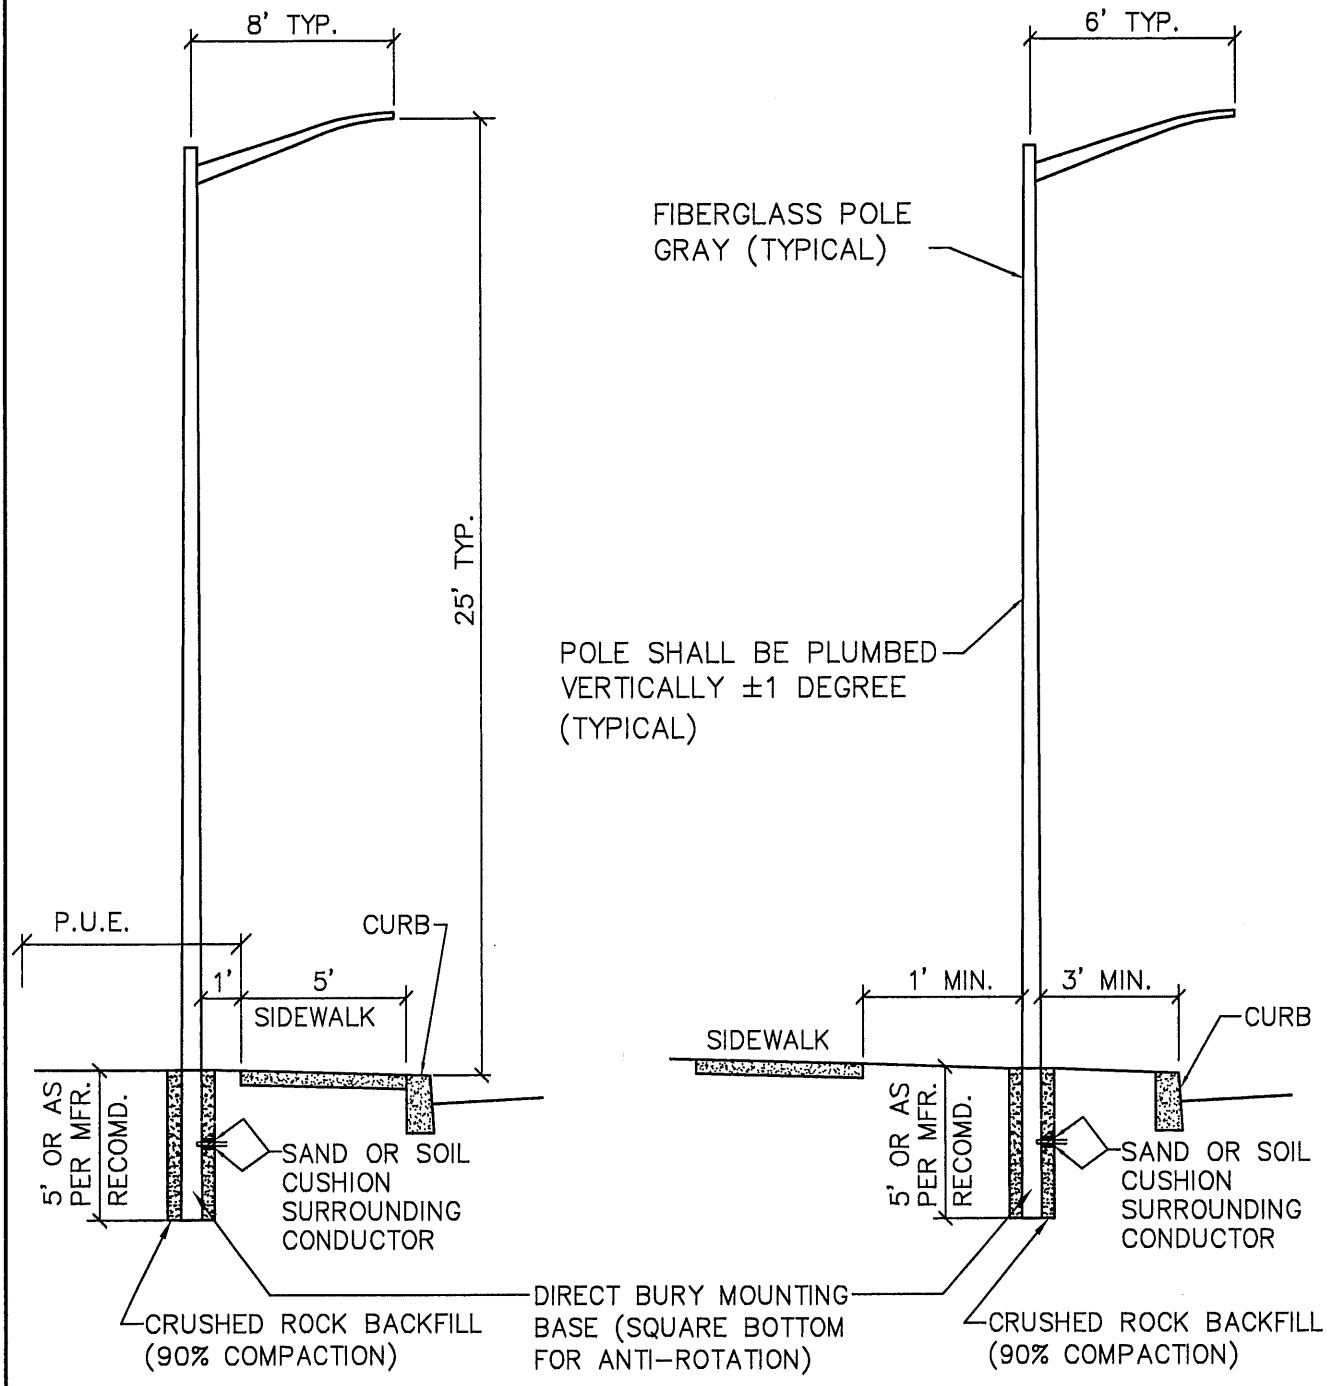

TYPICAL LAMP POST
CROSS SECTION TYPE ONE

TYPICAL LAMP POST
CROSS SECTION TYPE TWO

NOTES:

1. CONTRACTOR TO COORDINATE W/LOCAL POWER COMPANY FOR MATERIALS AND WORKMANSHIP REQUIREMENTS.
2. UNLESS OTHERWISE SHOWN ON DRAWINGS OR REQUIRED BY CITY, PROVIDE CITY APPROVED COBRAHEAD LED FIXTURE EQUIVALENT TO 100 WATT HPS.

NOTE: PER ORS 92.044(7), STREET LIGHT MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

LAST REVISION DATE: MAY 2016	
TYPICAL STREET LAMP POST (NTS)	
PHILOMATH, OR	DETAIL NO. 230

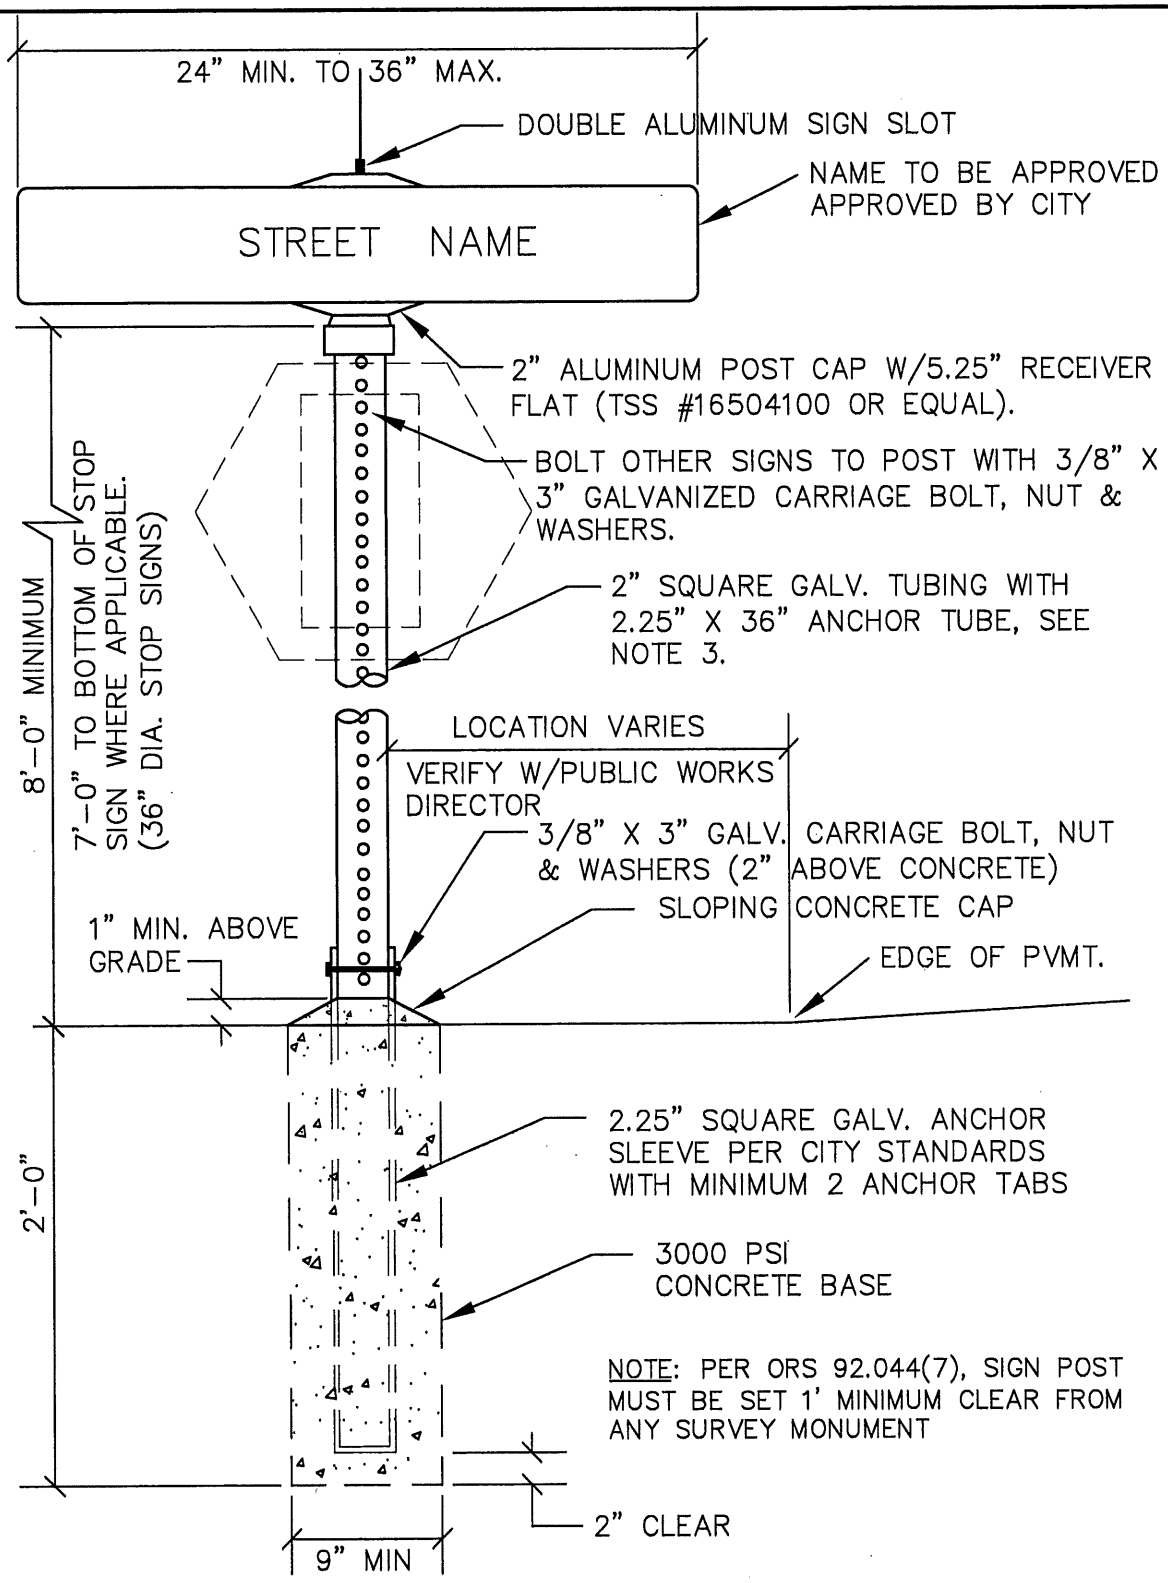

NOTES:

1. ALL NEWLY PLATTED STREETS TO BE SIGNED IN ACCORDANCE WITH CITY STANDARDS.
2. SIGN PANEL MATERIALS TO CONFORM TO SECTION 00940 OF OSHD SPECIFICATIONS, AND ALL SIGNS SHALL CONFORM WITH OREGON MUTCD MANUAL.
3. SIGN POSTS TO BE 2" SQUARE 14 GAUGE GALVANIZED STEEL TUBE WITH 7/16" DIAMETER HOLES ON 1" HOLE CENTERS. ANCHOR TUBE TO BE 2.25" X 36" 12 GAUGE STEEL TUBE WITH 7/16" DIAMETER HOLES ON 1" HOLE CENTERS.

LAST REVISION DATE: AUG 2011	
SIGN POST FOR STREET SIGNS, STOP SIGNS & TRAFFIC CONTROL SIGNS (NTS)	
PHILOMATH, OR	DETAIL NO. 231

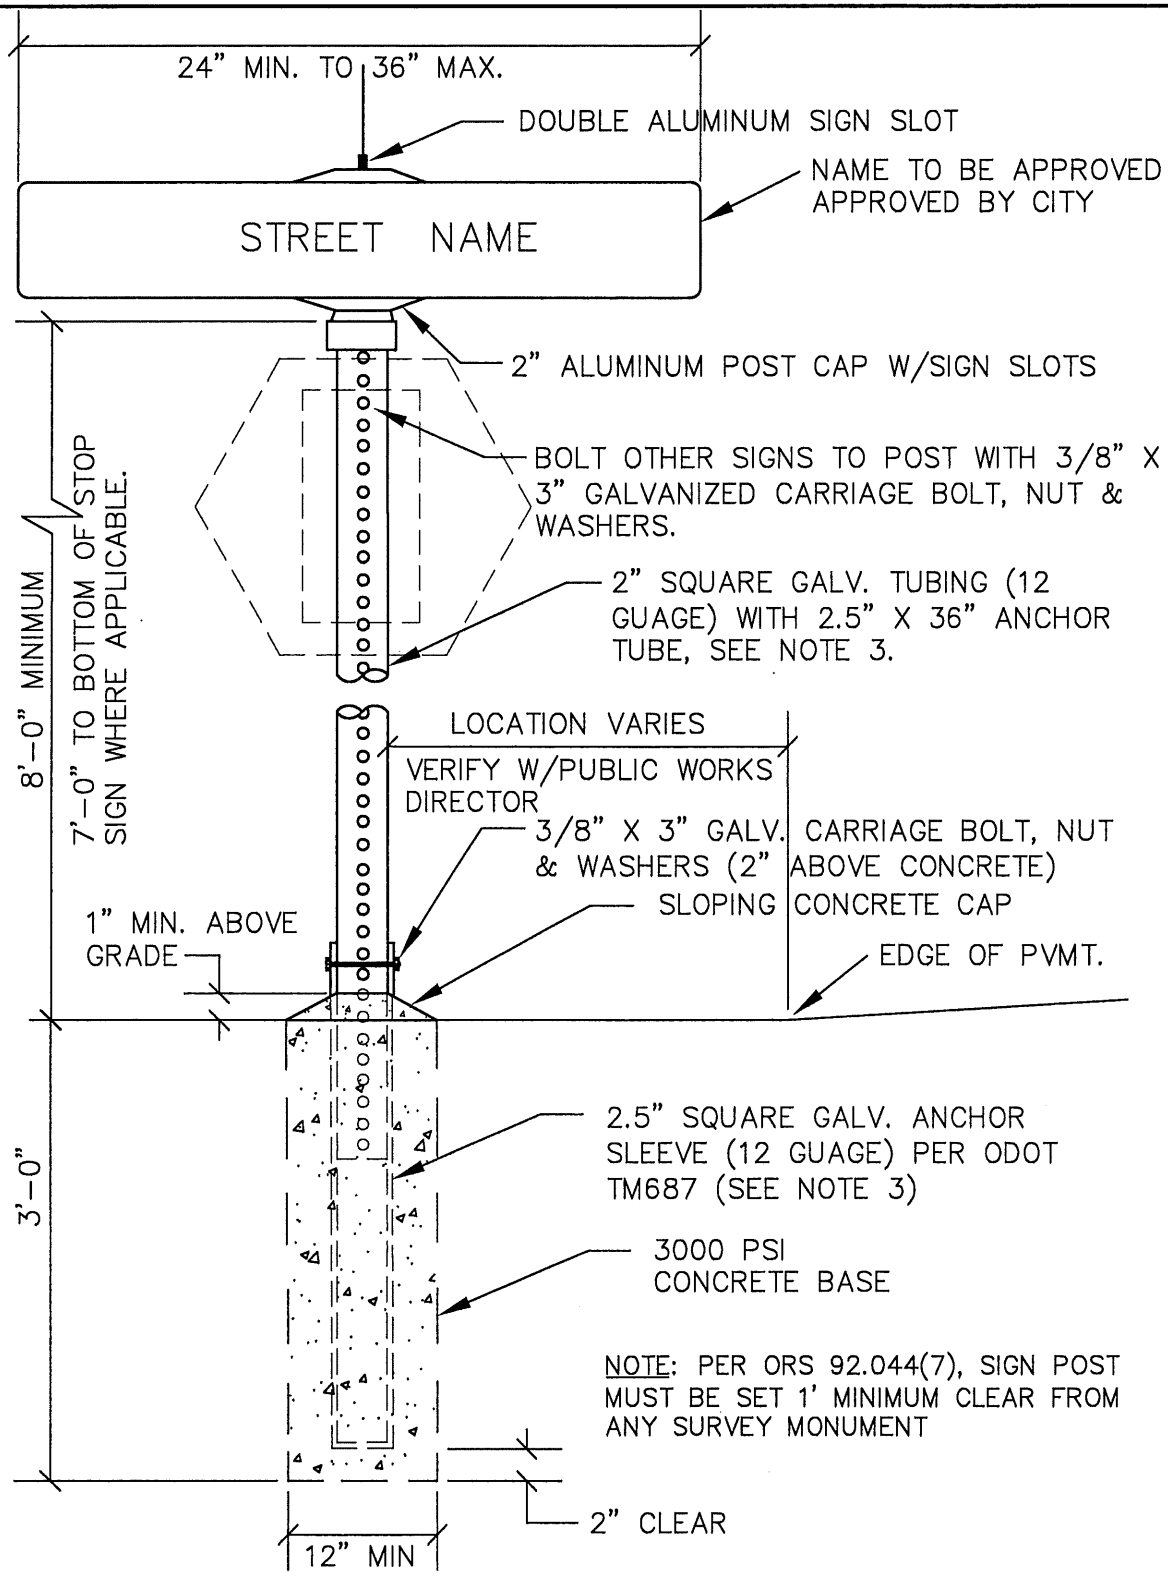

NOTES:

1. STREETS INTERSECTING ODOT RIGHT-OF-WAY TO BE SIGNED PER WITH ODOT STANDARDS.
2. SIGN PANEL MATERIALS TO CONFORM TO SECTION 00940 OF OSHD SPECIFICATIONS, AND ALL SIGNS SHALL CONFORM WITH OREGON MUTCD MANUAL.
3. SIGN POSTS & SLEEVES TO HAVE 7/16" DIAMETER HOLES ON 1" HOLE CENTERS.

LAST REVISION DATE: FEB 2013	
SIGN POST WITH TELESPAR BASE & ANCHOR (REQUIRED IN ODOT R.O.W) (NTS)	
PHILOMATH, OR	DETAIL NO. 232

OFF–STREET PARKING DIMENSIONS

STALLS WITHIN EACH PARKING LOT MAY BE DISTRIBUTED AS FOLLOWS: 60% STANDARD SPACES, 40% MAXIMUM COMPACT SPACES. ALL COMPACT SPACES SHALL BE PERMANENTLY LABELED.

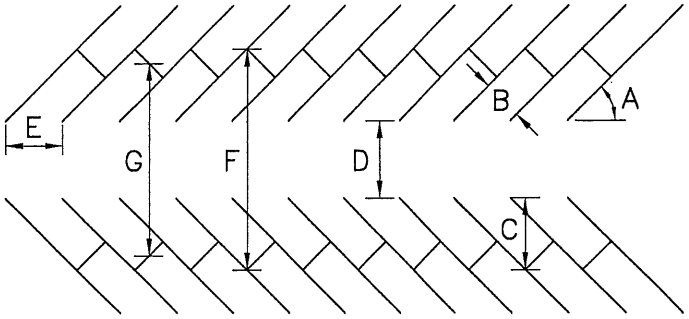

A– PARKING ANGLE

B– STALL WIDTH

C– STALL TO CURB DEPTH

D– AISLE WIDTH BETWEEN STALL LINES

E– STALL WIDTH PARALLEL TO AISLE

F– MODULE WIDTH (FRONT OF STALL TO FRONT OF STALL)

G– MODULE WIDTH (FRONT OF STALL TO FRONT OF STALL AT BUMPER MIDPOINT



PARKING–STALL WIDTH BACKING–POCKET FOR HEAD–IN PARKING WITHOUT DRIVE AISLE EXIT.

OFF–STREET PARKING MATRIX

MINIMUM PARKING SPACE AND AISLE DIMENSIONS (FT)
ONE WAY TRAFFIC FLOW

COMPACT (8.5' x 16')							STANDARD (9' x 19')					
A	B	C	D	E	F	G	B	C	D	E	F	G
0°	8.5	8.5	12.0	19.0	28.0	–	9.0	9.0	12.0	22.0	28.0	–
30°	8.5	15.4	12.0	17.0	41.7	34.4	9.0	17.3	12.0	18.0	45.6	37.8
45°	8.5	17.3	13.0	12.0	47.6	41.6	9.0	19.8	13.0	12.7	52.6	46.2
60°	8.5	18.1	18.0	9.8	54.2	50.0	9.0	21.0	18.0	10.4	60.0	55.7
70°	8.5	17.9	19.0	9.0	54.9	52.0	9.0	21.0	19.0	9.6	61.0	57.8
90°	8.5	16.0	24.0	8.5	56.0	56.0	9.0	19.0	24.0	9.0	62.0	62.0

NOTES:

1. WHERE DRIVE AISLE "D" IS A FIRE LANE, WIDTHS SHALL CONFORM WITH THE OREGON FIRE CODE MINIMUMS OF 20 FEET IN ALL CASES (26 FOOT MINIMUM ADJACENT TO FIRE HYDRANTS), PER OFC 503.2.1 & D103.1.

LAST REVISION DATE: MAR 2016	
OFFSTREET PARKING DIMENSIONS ONE WAY TRAFFIC FLOW (NTS)	
PHILOMATH, OR	DETAIL NO. 235

OFF–STREET PARKING DIMENSIONS

STALLS WITHIN EACH PARKING LOT MAY BE DISTRIBUTED AS FOLLOWS: 60% STANDARD SPACES, 40% MAXIMUM COMPACT SPACES. ALL COMPACT SPACES SHALL BE PERMANENTLY LABELED.

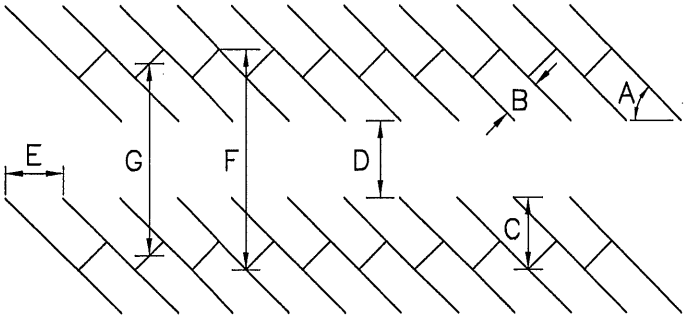

A– PARKING ANGLE

B– STALL WIDTH

C– STALL TO CURB DEPTH

D– AISLE WIDTH BETWEEN STALL LINES

E– STALL WIDTH PARALLEL TO AISLE

F– MODULE WIDTH (FRONT OF STALL TO FRONT OF STALL)

G– MODULE WIDTH (FRONT OF STALL TO FRONT OF STALL AT BUMPER MIDPOINT



PARKING–STALL WIDTH BACKING–POCKET FOR HEAD–IN PARKING WITHOUT DRIVE AISLE EXIT.

OFF–STREET PARKING MATRIX

MINIMUM PARKING SPACE AND AISLE DIMENSIONS (FT)
TWO WAY TRAFFIC FLOW

COMPACT (8.5' x 16')							STANDARD (9' x 19')					
A	B	C	D	E	F	G	B	C	D	E	F	G
0°	8.5	8.5	24.0	19.0	28.0	–	9.0	9.0	24.0	22.0	28.0	–
30°	8.5	15.4	24.0	17.0	41.7	34.4	9.0	17.3	24.0	18.0	45.6	37.8
45°	8.5	17.3	24.0	12.0	47.6	41.6	9.0	19.8	24.0	12.7	52.6	46.2
60°	8.5	18.1	24.0	9.8	54.2	50.0	9.0	21.0	24.0	10.4	60.0	55.7
70°	8.5	17.9	24.0	9.0	54.9	52.0	9.0	21.0	24.0	9.6	61.0	57.8
90°	8.5	16.0	24.0	8.5	56.0	56.0	9.0	19.0	24.0	9.0	62.0	62.0

NOTES:

1. WHERE DRIVE AISLE "D" IS A FIRE LANE, WIDTHS SHALL CONFORM WITH THE OREGON FIRE CODE MINIMUMS OF 20 FEET IN ALL CASES (26 FOOT MINIMUM ADJACENT TO FIRE HYDRANTS), PER OFC 503.2.1 & D103.1.

LAST REVISION DATE: MAY 2015	
OFFSTREET PARKING DIMENSIONS TWO WAY TRAFFIC FLOW (NTS)	
PHILOMATH, OR	DETAIL NO. 236

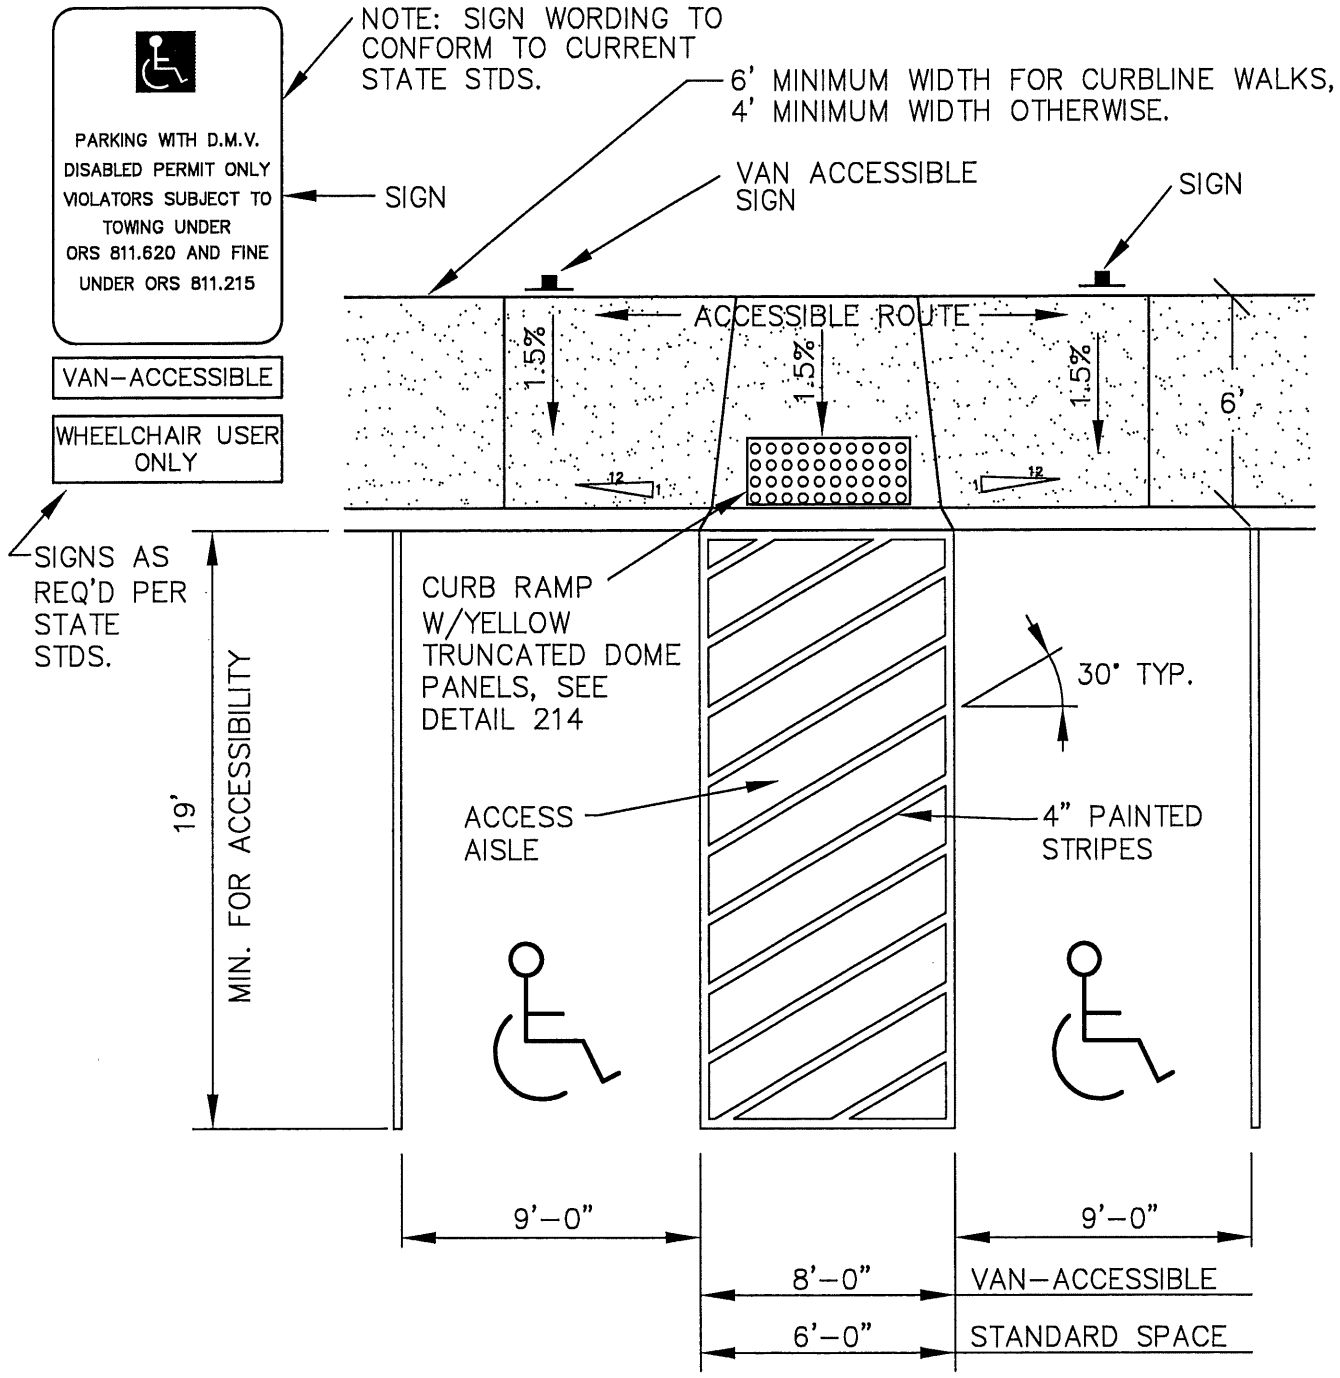

DOUBLE ACCESSIBLE PARKING SPACE

NOTES:

1. ONE ACCESSIBLE PARKING SPACE MUST BE DESIGNATED "VAN-ACCESSIBLE", THE OTHER SPACE CAN BE EITHER "VAN-ACCESSIBLE" OR STANDARD PARKING SPACE.
2. VAN-ACCESSIBLE OR WHEELCHAIR ONLY SPACES SHALL HAVE AN ADDITIONAL SIGN MOUNTED BELOW THE STANDARD PARKING SPACE PARKING SIGN.
3. VAN-ACCESSIBLE SPACE CAN BE USED BY ANY VEHICLE WITH A DMV DISABLED PERMIT.
4. MAXIMUM 2% CROSS SLOPE ALLOWED IN PARKING SPACE OR ACCESS AISLE.
5. POST MOUNTED SIGNS SHALL HAVE 7' (±3") CLEARANCE FROM SIGN BOTTOM TO GROUND.

LAST REVISION DATE: NOV 2013	
DOUBLE ACCESSIBLE PARKING SPACE (NTS)	
PHILOMATH, OR	DETAIL NO. 237

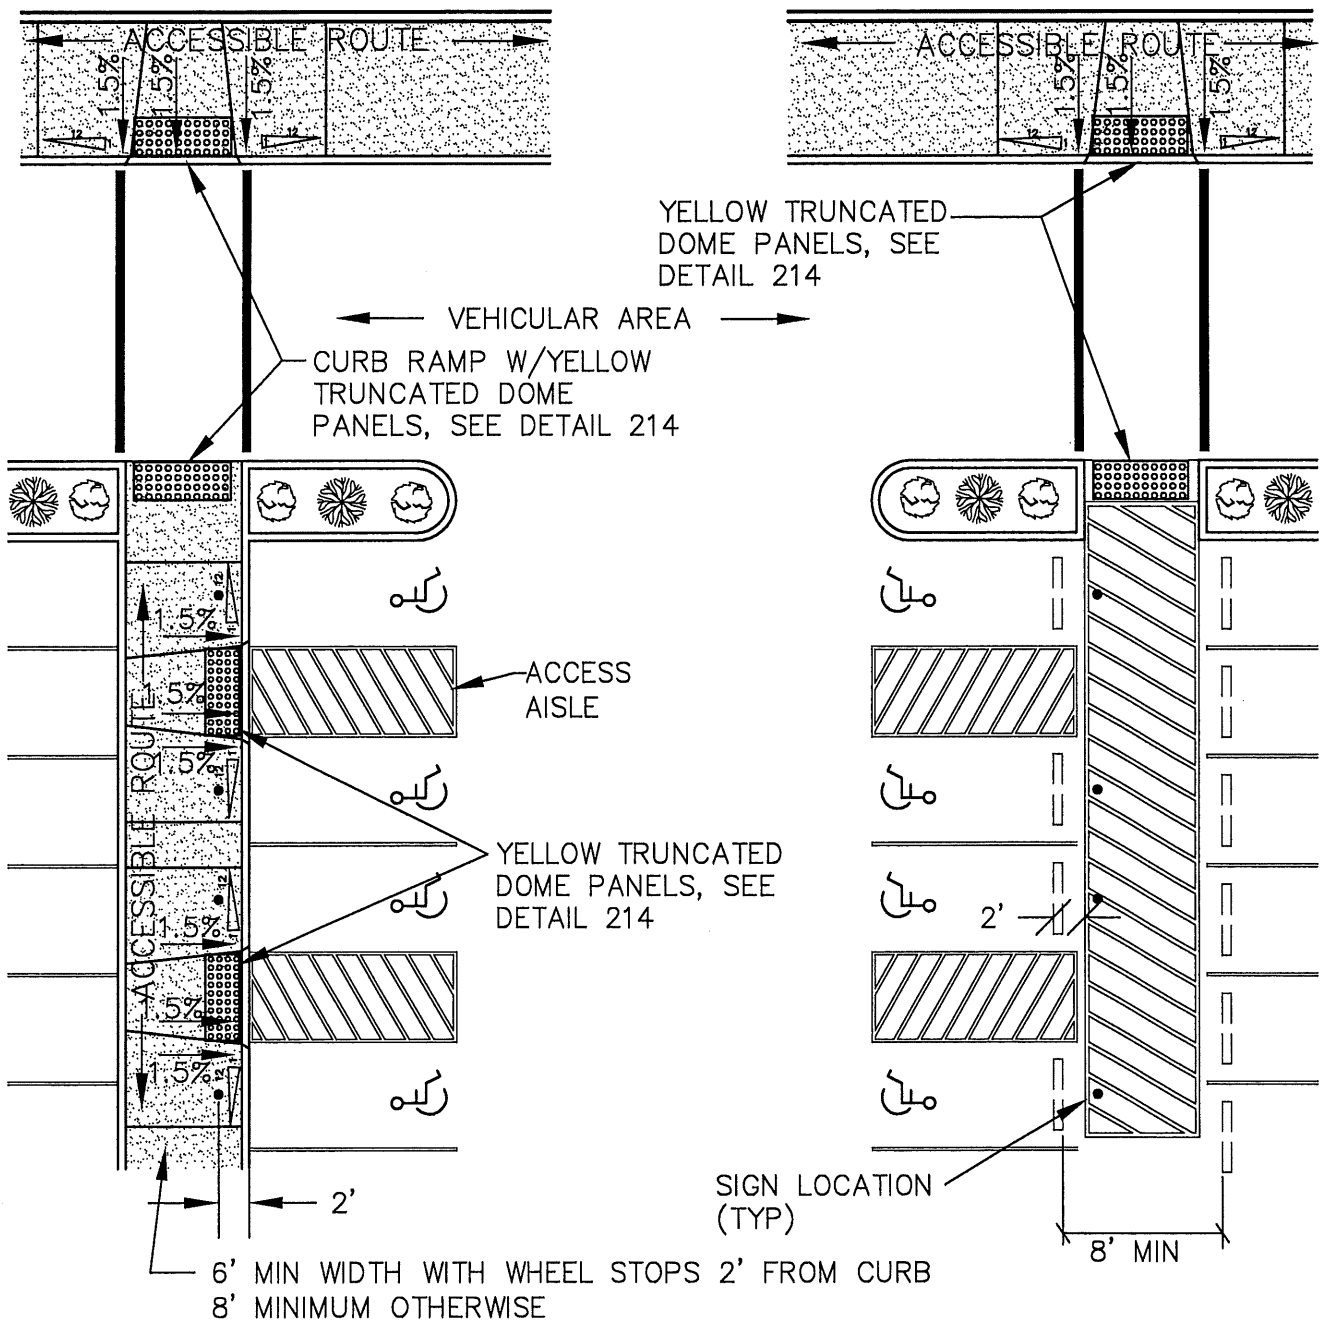

ACCESSIBLE PARKING PLAN ①

ACCESSIBLE PARKING PLAN ②

NOTES:

1. SEE DETAIL 237 FOR ACCESSIBLE PARKING PARKING SPACE LAYOUT.

LAST REVISION DATE: NOV 2013	
ACCESSIBLE ROUTES AND CROSSINGS IN VEHICULAR AREAS (NTS)	
PHILOMATH, OR	DETAIL NO. 238

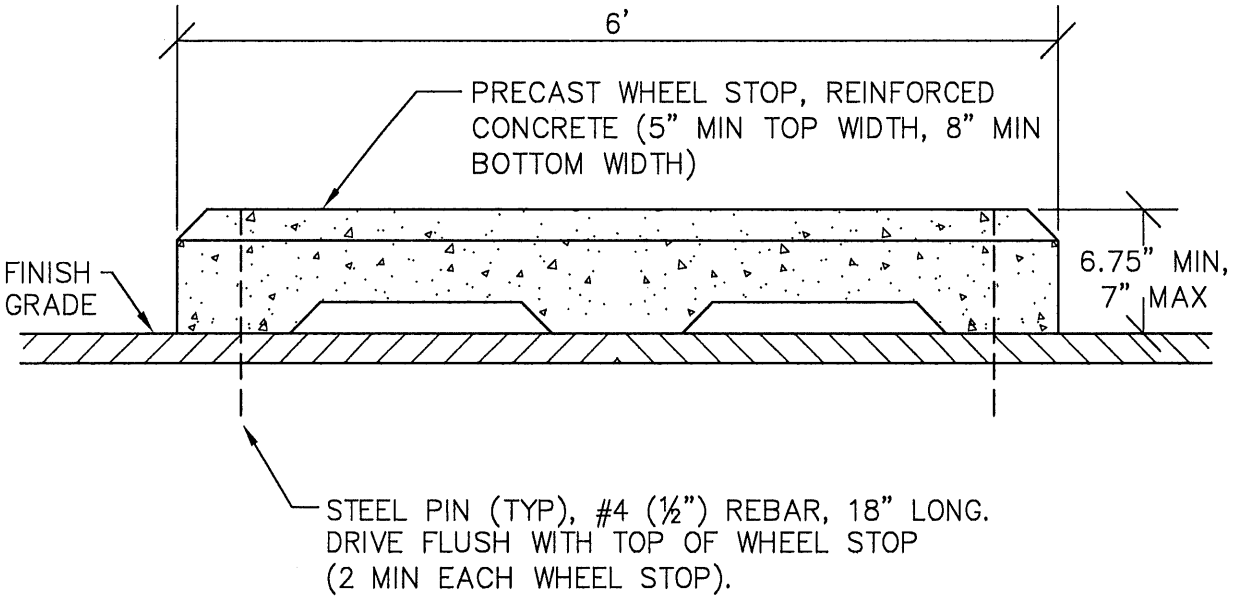

SECTION

NTS

NOTES:

1. SEE DRAWINGS FOR LOCATION & NUMBER OF WHEEL STOPS, INCLUDING DIMENSION FROM CURB, EDGE OF PAVEMENT OR BUILDING AS APPLICABLE.
2. UNLESS OTHERWISE SPECIFIED OR SHOWN ON SITE PLAN, SET WHEEL STOPS 2 FEET FROM FACE OF CURB OR EDGE OF PAVEMENT, MEASURED FROM THE FACE OF THE WHEEL STOP (VEHICLE SIDE) TO FACE OF CURB (OR EDGE OF PAVEMENT). SET BACK FROM PROPERTY LINES PER CITY STANDARDS (3' MIN). MIN SETBACK FROM BUILDINGS AS SHOWN ON DWGS.
3. FOR USE ON HEAD-IN PARKING WITHOUT FULL HEIGHT CURBS, OR WHERE A SIDEWALK ALONG HEAD-IN PARKING IS LESS THAN 6 FEET WIDE.

LAST REVISION DATE: JAN 2013	JO #
PRECAST WHEELSTOP DETAIL (NTS)	
PHILOMATH, OR	DETAIL NO. 239

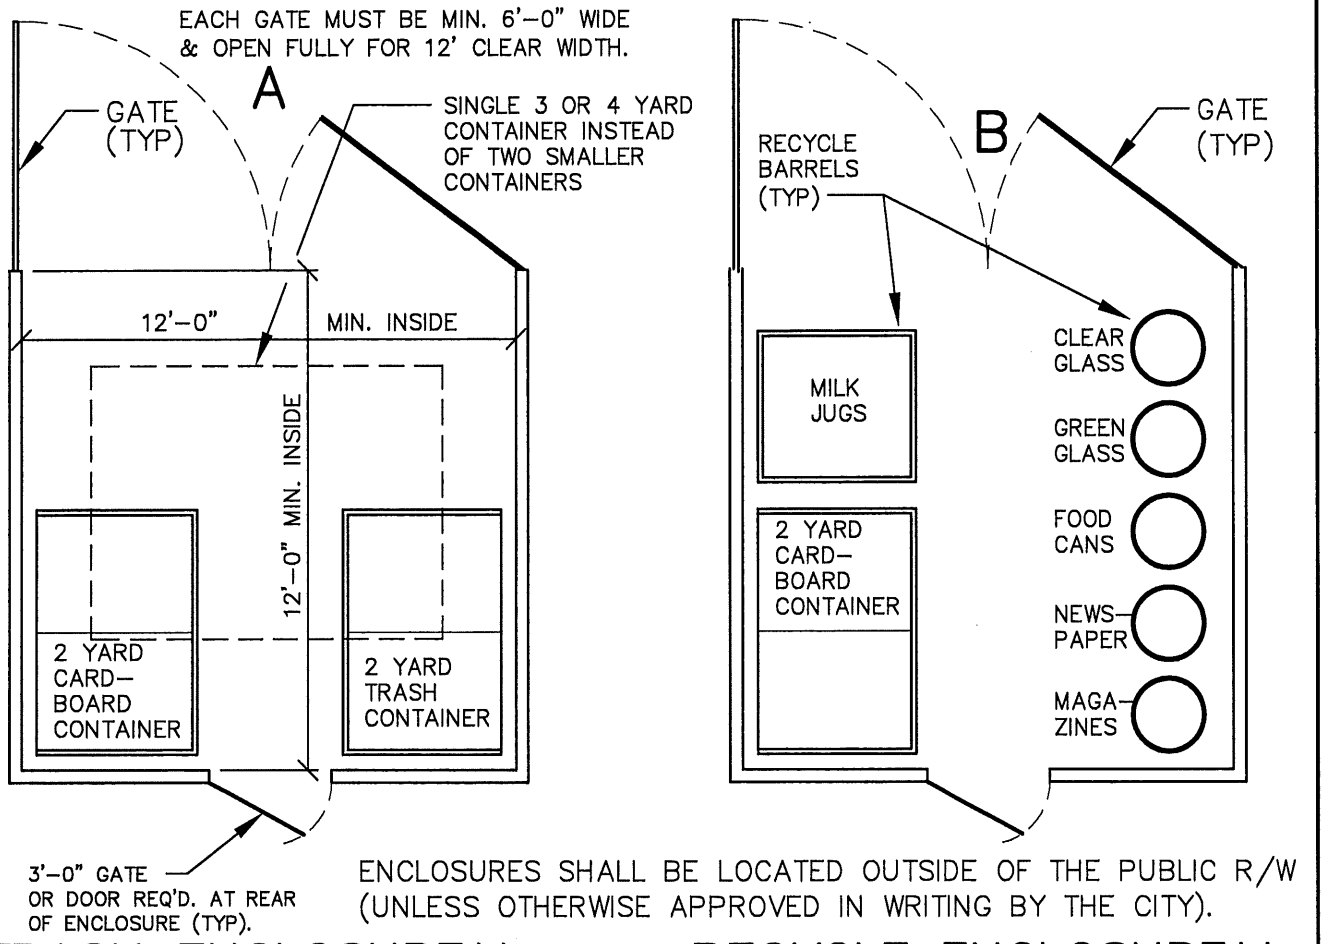

ENCLOSURES SHALL BE LOCATED OUTSIDE OF THE PUBLIC R/W (UNLESS OTHERWISE APPROVED IN WRITING BY THE CITY).

TRASH ENCLOSURE**

RECYCLE ENCLOSURE**

**ENCLOSURES SHOWN ARE TYPICAL EXAMPLES UNLESS ALTERNATE CONFIGURATION IS APPROVED BY TRASH/RECYCLING FRANCHISEE AND CITY PLANNER.

NOTES:

1. GATES:
   (a) ALL GATES MUST ATTACH AT THE END OF OF THE WALLS TO PROVIDE A MINIMUM OF 12' CLEAR WORKING SPACE WHEN OPEN.
   (b) TO SERVICE THE ENCLOSURE, THE GATES MUST BE ABLE TO BE PINNED IN MUST BE ABLE TO BE PINNED IN THE FULL OPEN POSITION.
   (c) GATES MUST OPEN FROM OUTSIDE THE ENCLOSURE.
2. FOR 5 OR 6 YARD CONTAINERS THE ENCLOSURE DEPTH MUST BE 15'.
3. WHERE REQ'D. (I.E. RESTAURANTS), GREASE BARRELS MUST BE SEPARATE FROM TRASH AND RECYCLING ENCLOSURES.
4. ROOFS OR OVERHANGS SHALL HAVE 15' OF OVERHEAD CLEARANCE.
5. IF RECYCLING IS NOT INCLUDED, AREA (A) CAN PROVIDE SERVICE FOR TRASH AND CARDBOARD FOR CONTAINER SIZES OF 1 TO 2 YARDS. IF A 3 YARD OR LARGER TRASH CONTAINER IS NEEDED, AN ADDITIONAL 12' X 12' SPACE WILL BE NECESSARY FOR CARDBOARD CONTAINER SERVICE.
6. CONCRETE PADS REQUIRED FOR ALL ENCLOSURES. WALLS, GATE & DOOR MATERIALS & HEIGHT PER CITY STANDARDS BASED ON SCREENING REQUIREMENTS.
7. A 1 YD. CONTAINER WILL HOLD APPROXIMATELY THE SAME AS 6 TRASH CANS (32 GAL SIZE). USE 6 TIMES THE CONTAINER SIZE IN YARDS TO ESTIMATE A CONTAINER CAPACITY. FOR EXAMPLE, A 3 YD. CONTAINER WILL HOLD APPROX THE SAME AMOUNT AS 18 TRASH CANS (32 GAL SIZE).

LAST REVISION DATE: MAY 2014	
TYPICAL TRASH AND RECYCLING ENCLOSURE (NTS)	
PHILOMATH, OR	DETAIL NO. 240

TRENCH COMPACTION: CLASS 1 GRANULAR BACKFILL – 92% OPTIMUM PER AASHTO T–180 (MODIFIED PROCTOR)
CLASS 3 NATIVE BACKFILL – 85% OPTIMUM PER AASHTO T–180

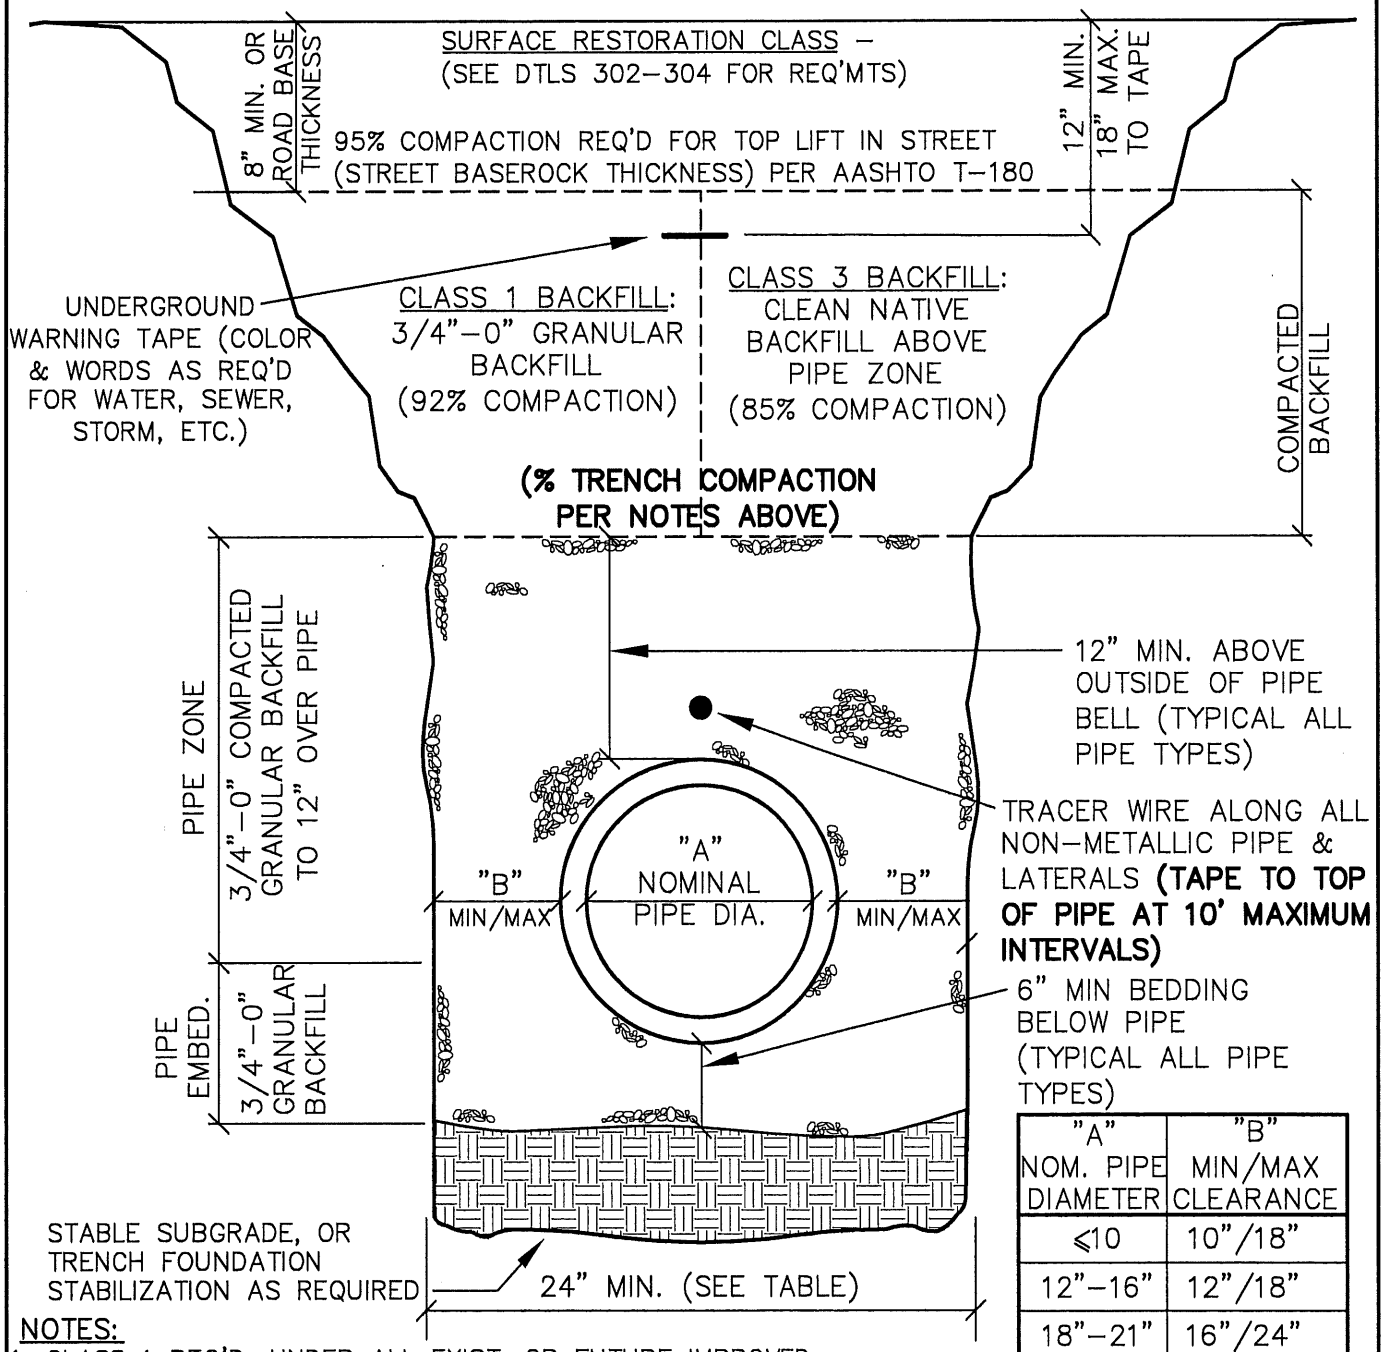

"A" NOM. PIPE DIAMETER	"B" MIN/MAX CLEARANCE
⩽10	10"/18"
12"–16"	12"/18"
18"–21"	16"/24"
24"–30"	18"/30"
>30"	24"/36"

(SEE NOTE 4)

NOTES:
1. CLASS 1 REQ'D. UNDER ALL EXIST. OR FUTURE IMPROVED AREAS INCLUDING SIDEWALKS.
2. WHERE NEW PIPING IS IN SAME ALIGNMENT AS EXISTING PIPING, THE PIPE EMBEDMENT SHALL EXTEND TO A MIN. OF 6" BELOW THE NEW PIPING OR 6" BELOW EXISTING PIPING, WHICHEVER IS DEEPER.
3. FOR FLEXIBLE PIPE, BOTTOM OF TRENCH SHORING SHALL BE ABOVE PIPE SPRINGLINE PRIOR TO COMPACTING BACKFILL BELOW THE PIPE SPRINGLINE AND UNDER THE PIPE HAUNCHES.
4. MINIMUM CLEARANCES SHOWN ("B") ASSUMES STANDARD 6" WALL TRENCH BOXES SET ON TRENCH BOTTOM, AND REPRESENTS WIDTH REQUIRED TO CONSOLIDATE GRANULAR MATERIAL UNDER PIPE HAUNCHES (TO AVOID LOSS OF SIDE SUPPORT WHEN TRENCH BOX IS MOVED OR PULLED FORWARD). TRENCH WIDTH REDUCTION REQUIRES PRIOR APPROVAL BASED ON ACTUAL TRENCH SHORING PROPOSED.

LAST REVISION DATE: JAN 2016	
TRENCH BACKFILL, BEDDING, AND PIPE ZONE (NTS)	
PHILOMATH, OR	DETAIL NO. 301

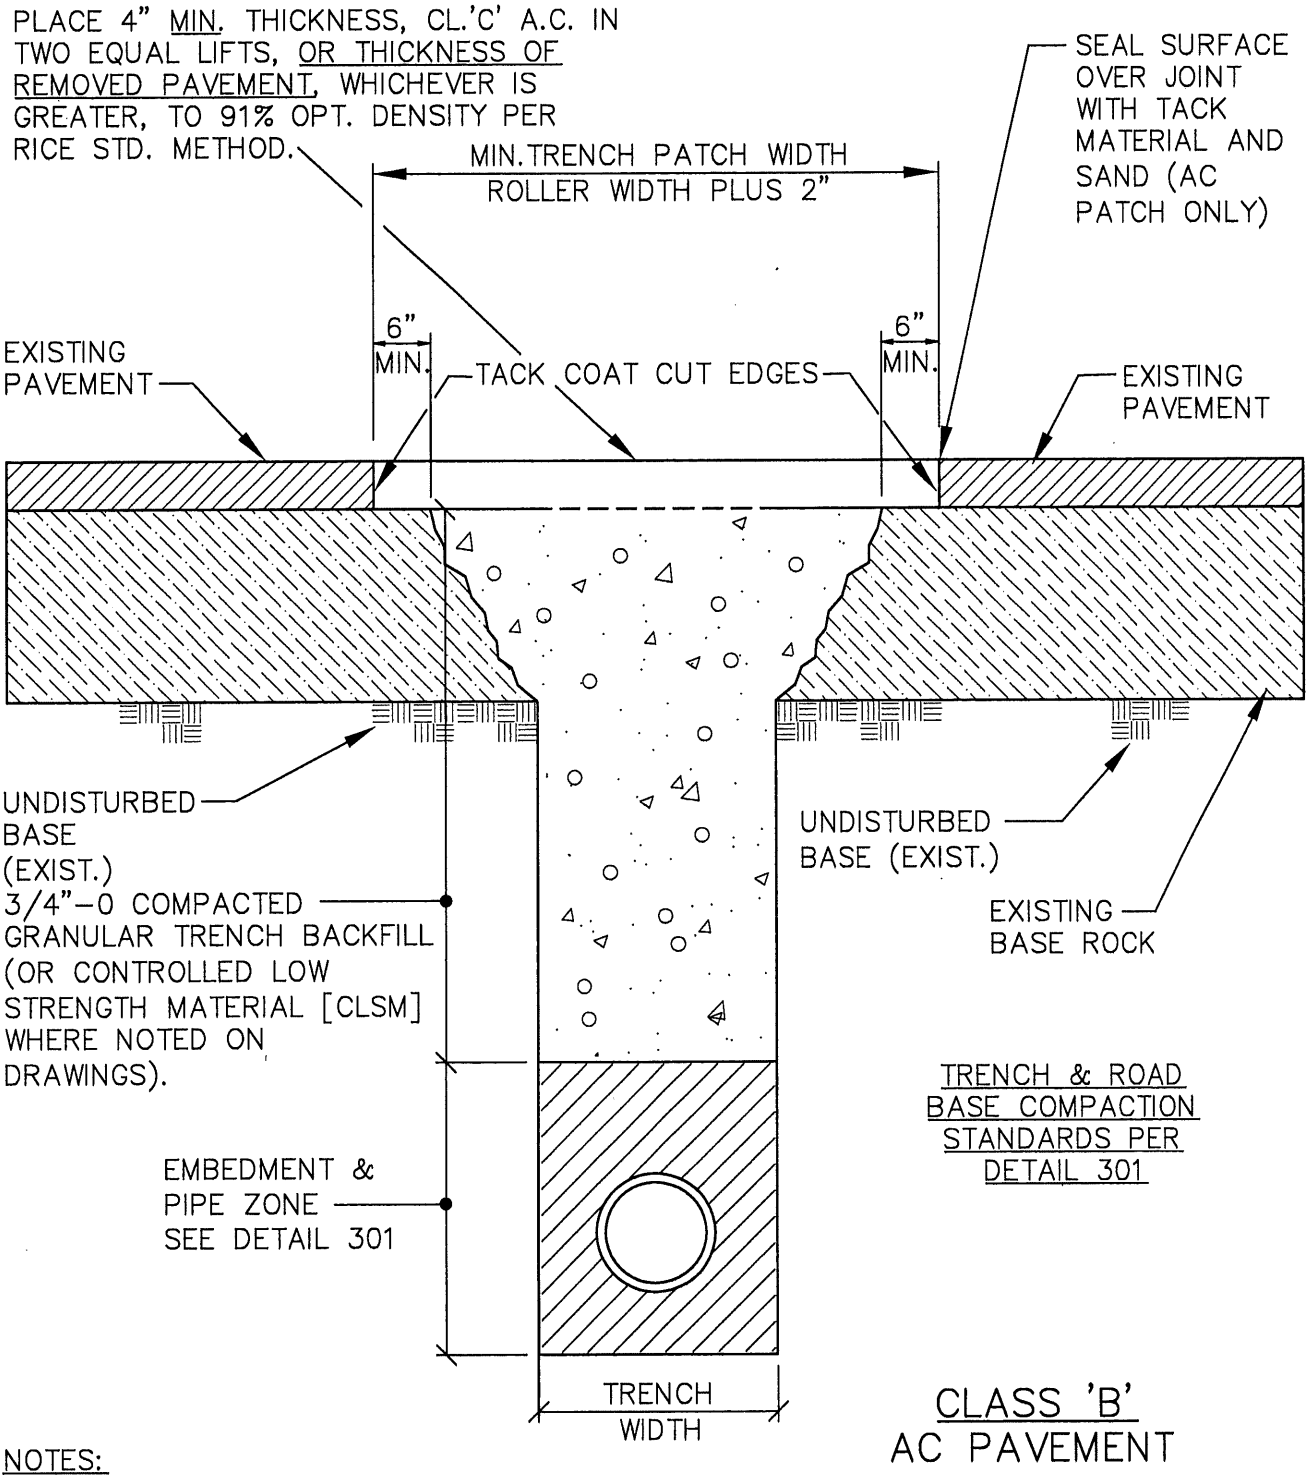

TRENCH & ROAD BASE COMPACTION STANDARDS PER DETAIL 301

CLASS 'B' AC PAVEMENT RESTORATION

NOTES:

1. ALL EXISTING AC OR PCC PAVEMENT SHALL BE SAWCUT PRIOR TO REPAVING.
2. PCC CONCRETE PAVEMENT SHALL BE REPLACED WITH 3300 PSI PCC TO A MINIMUM THICKNESS OF 6" OR TO THE THICKNESS OF REMOVED CONCRETE, WHICHEVER IS GREATER.
3. FOR PAVED DRIVEWAYS (EXCEPT COMMERCIAL OR INDUSTRIAL) WITH LESS THAN 4" EXISTING AC, PAVEMENT THICKNESS MAY BE REDUCED TO 3" AC IN 2 LIFTS, AND OVERCUT MAY BE REDUCED TO 3" EACH SIDE.

LAST REVISION DATE: DEC 2015	
MINOR OR PRIVATE STREET AND AC DRIVEWAY CUT SURFACE RESTORATION (NTS)	
PHILOMATH, OR	DETAIL NO. 302

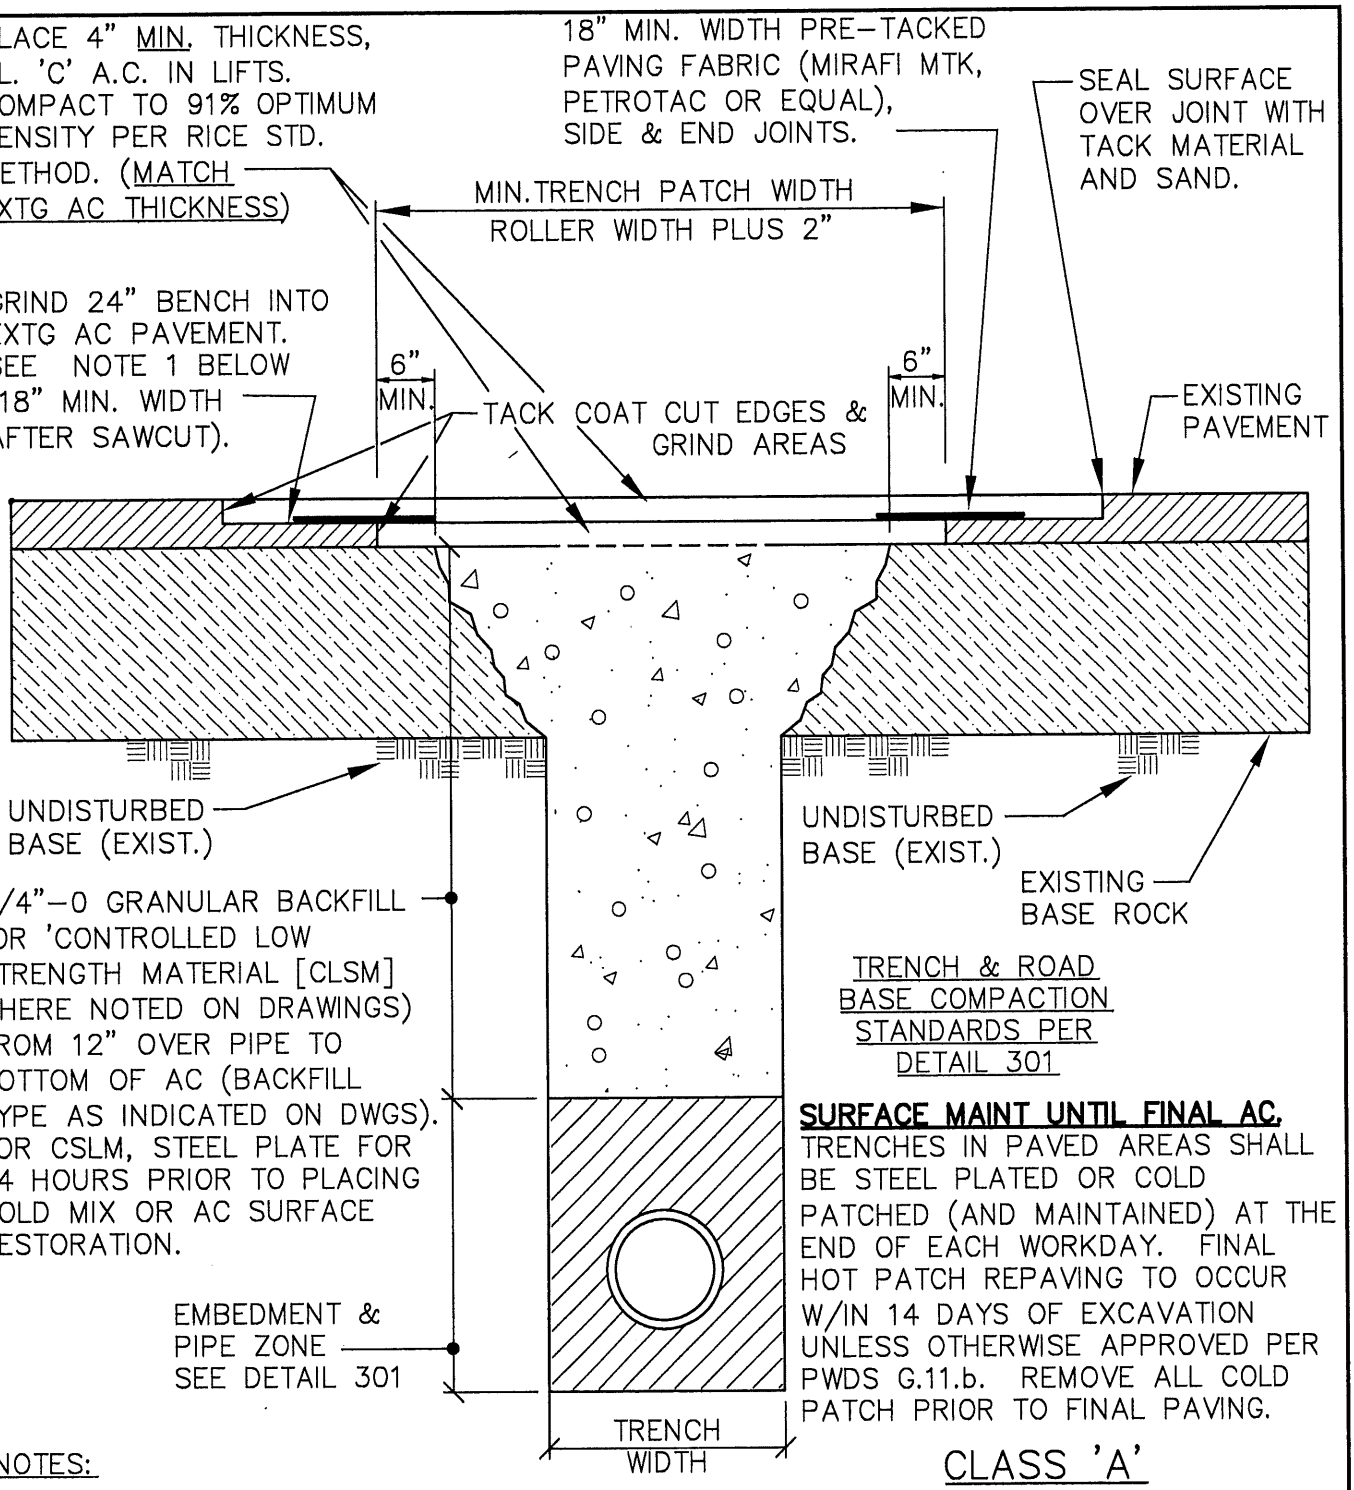

TRENCH & ROAD BASE COMPACTION STANDARDS PER DETAIL 301

SURFACE MAINT UNTIL FINAL AC.
TRENCHES IN PAVED AREAS SHALL BE STEEL PLATED OR COLD PATCHED (AND MAINTAINED) AT THE END OF EACH WORKDAY. FINAL HOT PATCH REPAVING TO OCCUR W/IN 14 DAYS OF EXCAVATION UNLESS OTHERWISE APPROVED PER PWDS G.11.b. REMOVE ALL COLD PATCH PRIOR TO FINAL PAVING.

NOTES:

1. FOLLOWING BACKFILL COMPACTION OR CLSM INSTALLATION, GRIND 24" WIDE BENCH IN EXISTING AC ON BOTH SIDES & TRENCH ENDS, 2" DEEP OR HALF THE DEPTH OF EXISTING AC (3" MAX).
2. AFTER GRINDING, SAWCUT ALONG TRENCH SIDES, 6" BACK FROM TRENCH EDGE.
3. BASE LIFT(S). TACK COAT EDGES, INSTALL/COMPACT BASE LIFTS (3" MAX LIFT) TO LEVEL OF BENCH GRIND.
4. FINISH LIFT. INSTALL JOINT SEAL FABRIC, TACK COAT GRIND SURFACES & EDGES, & INSTALL TOP LIFT OF AC. SAND SEAL ALL JOINTS (REMOVE EXCESS SAND AFTER CURE).

CLASS 'A' AC PAVEMENT RESTORATION

LAST REVISION DATE: DEC 2015	
AC STREET CUT SURFACE RESTORATION W/BENCH GRIND (NTS)	
PHILOMATH, OR	DETAIL NO. 302A

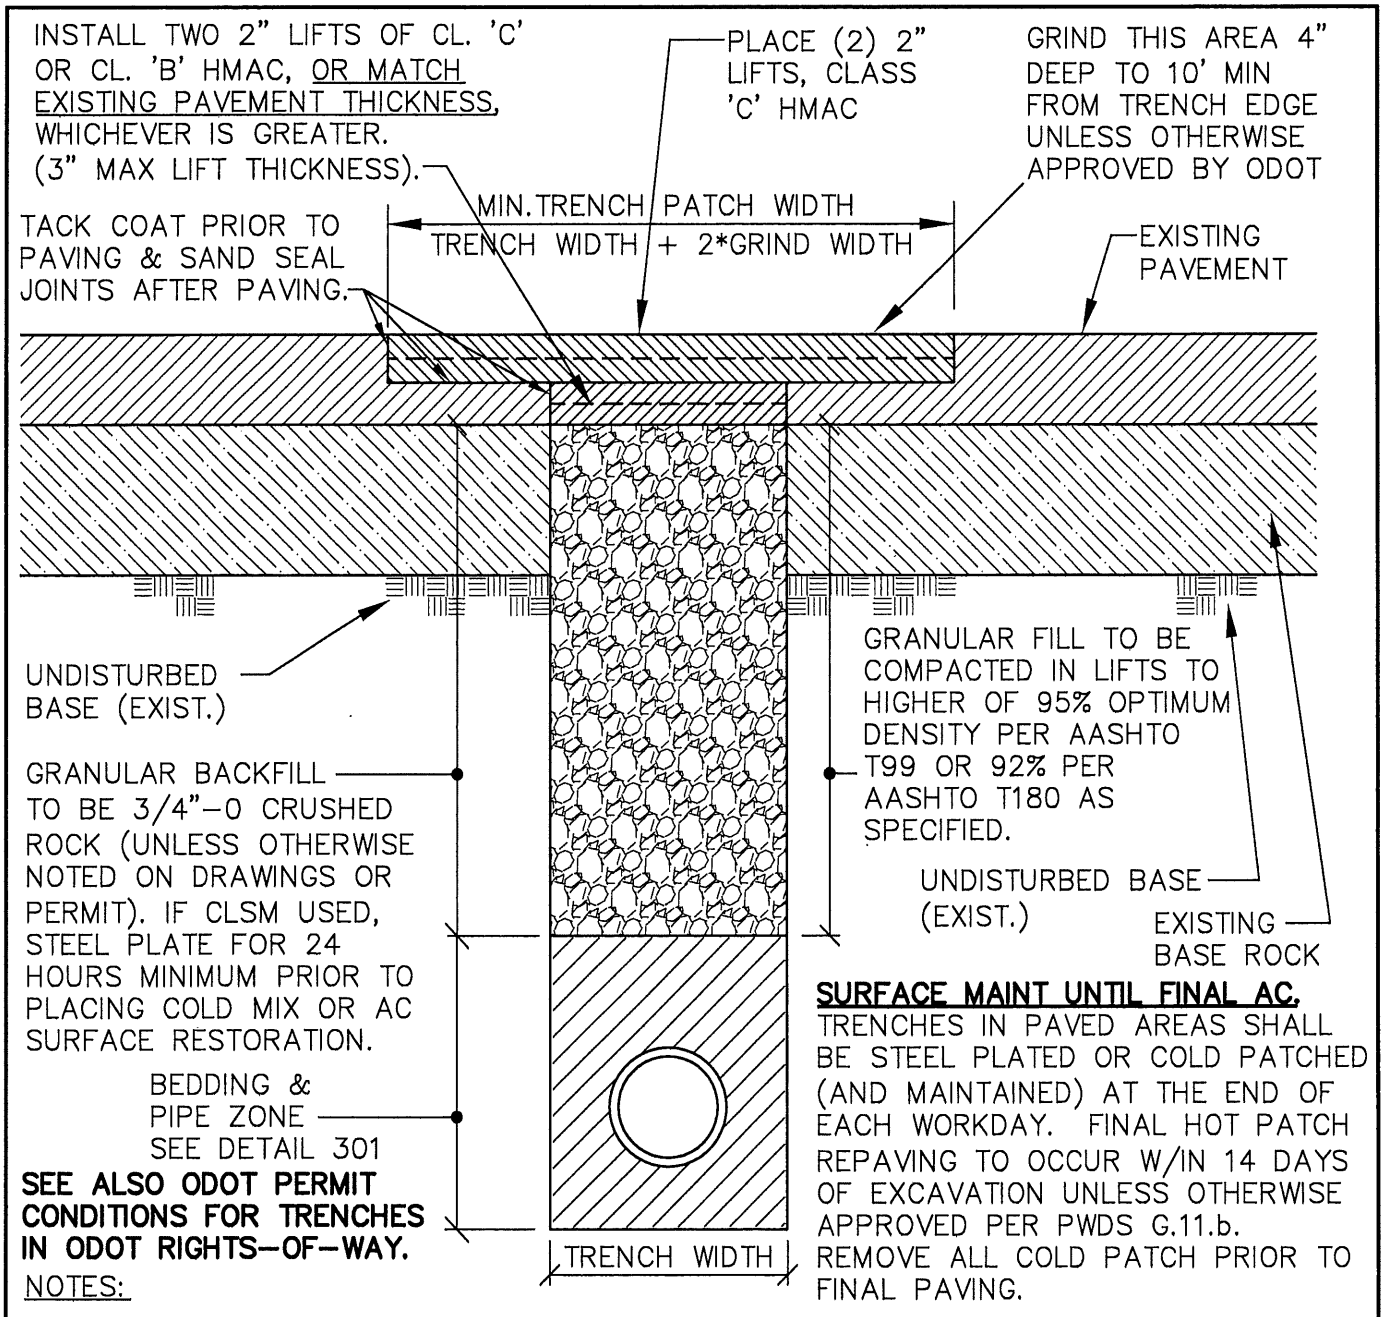

SEE ALSO ODOT PERMIT CONDITIONS FOR TRENCHES IN ODOT RIGHTS-OF-WAY.

SURFACE MAINT UNTIL FINAL AC.
TRENCHES IN PAVED AREAS SHALL BE STEEL PLATED OR COLD PATCHED (AND MAINTAINED) AT THE END OF EACH WORKDAY. FINAL HOT PATCH REPAVING TO OCCUR W/IN 14 DAYS OF EXCAVATION UNLESS OTHERWISE APPROVED PER PWDS G.11.b. REMOVE ALL COLD PATCH PRIOR TO FINAL PAVING.

NOTES:

1. COMPACT ALL A.C. LIFTS TO 91% OPTIMUM DENSITY PER RICE STANDARD METHOD.
2. ASPHALT EMULSION TACK COAT SHALL BE USED TO SEAL THE HMAC TO THE EDGES OF THE EXISTING AC PAVEMENT. ALL AC PAVEMENT CUTS SHALL BE VERTICAL, CLEAN & ASPHALT SAND SEALED ALONG ALL EDGES AFTER INSTALLATION.
3. ALL PAVEMENT CUT AREAS SHALL BE COLD PATCHED OR PLATED AT THE END OF EACH WORK SHIFT, & THE PLATES OR PATCH MAINTAINED UNTIL FULL PAVEMENT RESTORATION IS MADE W/HMAC. COLD PATCH (IF USED) SHALL BE REPLACED WITH HOT MIX HMAC WITHIN FIVE CALENDAR DAYS OR AS DIRECTED BY THE DISTRICT MANAGER OR REPRESENTATIVE IN WRITING.
4. HMAC SHALL BE A COMMERCIALLY PRODUCED PLANT MIXTURE CONFORMING TO ODOT STANDARDS ("B" OR "C" DESIGNATION REFERS TO AGGREGATE SIZE ONLY).
5. 48" MINIMUM COVER IS REQUIRED FOR ALL GAS, ELECTRIC, TELEPHONE, FIBER OPTIC AND OTHER POTENTIALLY DANGEROUS/HIGH IMPACT UTILITY FACILITIES, ALL OTHER FACILITIES REQUIRE 36" MINIMUM COVER DEPTH.

LAST REVISION DATE: JUNE 2015	
ODOT TRENCH CROSSING, TRENCH BACKFILL & SURFACE RESTORATION (NTS)	
PHILOMATH, OR	DETAIL NO. 302D

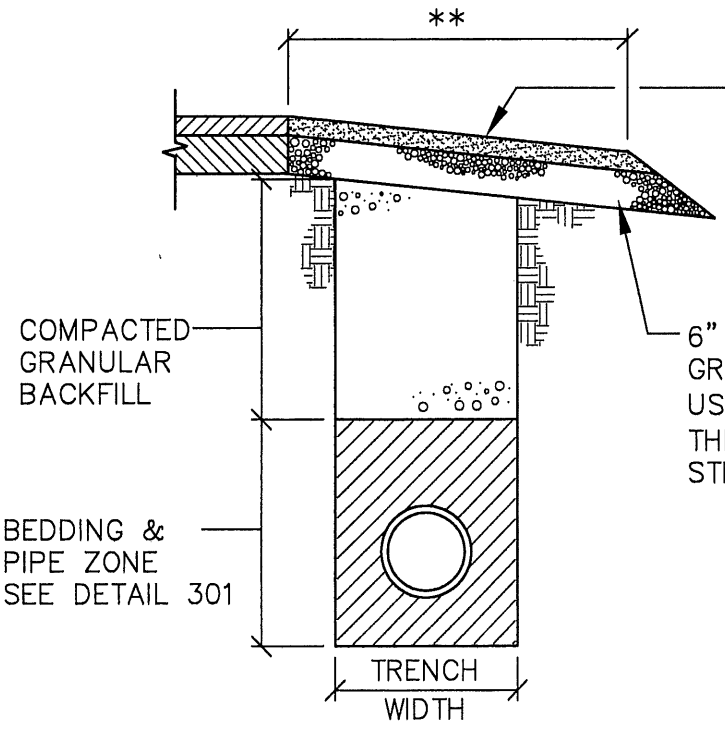

**WHERE ANY PORTION OF TRENCH EXCAVATION FALLS WITHIN SHOULDER LIMITS, RESTORE SHOULDER FOR MIN. WIDTH OF 36" OR AS DIRECTED BY CITY.

CLASS 'C' GRAVEL SHOULDER RESTORATION

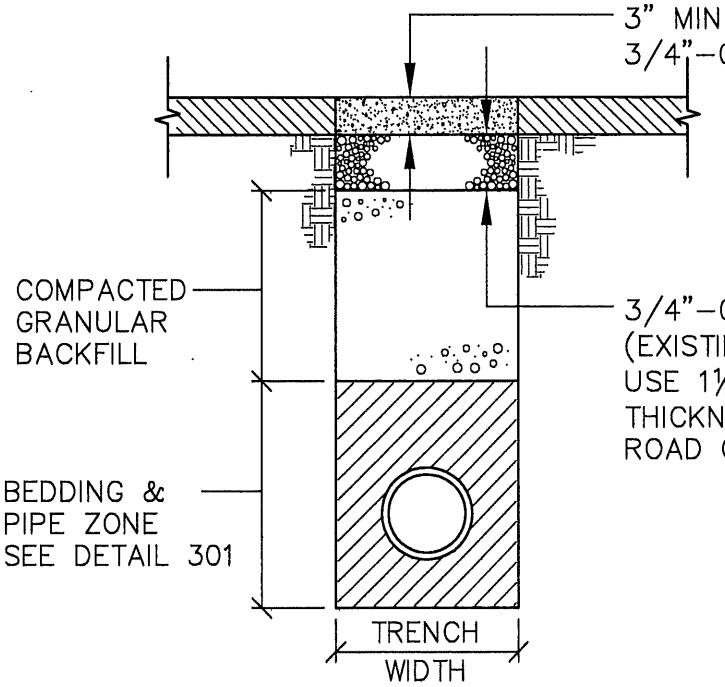

TRENCH & ROAD BASE COMPACTION STANDARDS PER DETAIL 301

CLASS 'D' GRAVEL STREET RESTORATION

NOTES:

1. SHOULDER ROCK TO BE COMPACTED TO ROAD BASEROCK STANDARDS.

LAST REVISION DATE: DEC 2015	
GRAVEL SURFACE RESTORATION (NTS)	
PHILOMATH, OR	DETAIL NO. 303

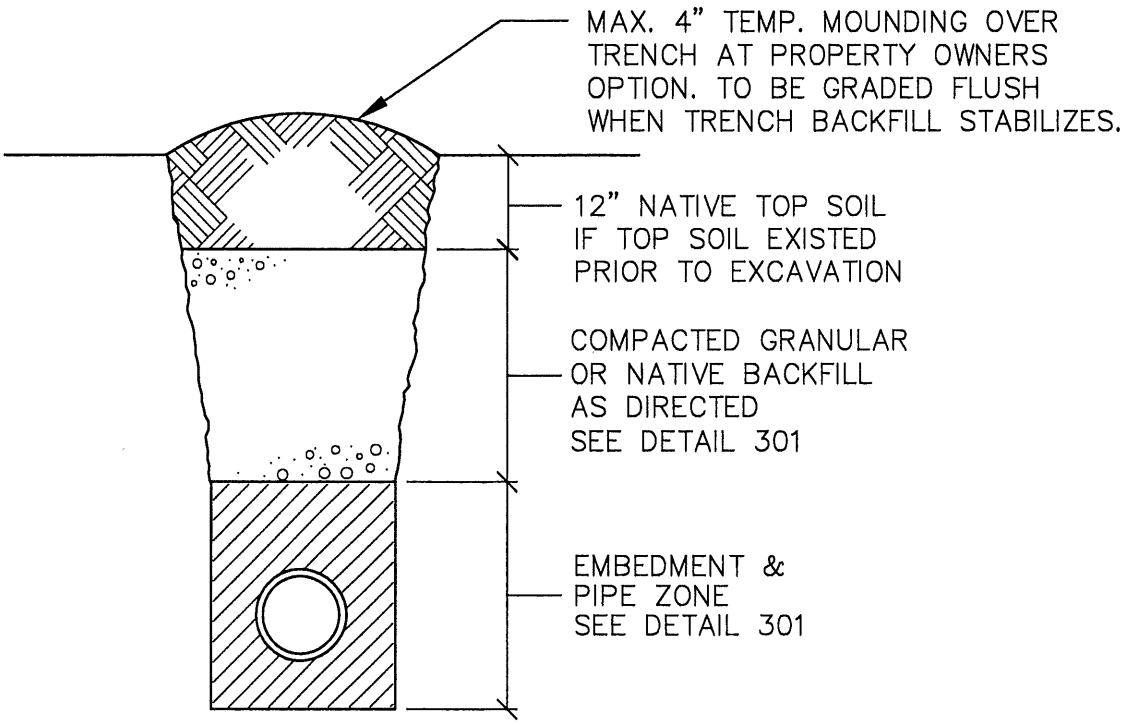

CLASS 'E'

UNIMPROVED & OPEN AREAS

TRENCH & ROAD BASE COMPACTION STANDARDS PER DETAIL 301

NOTES:

1. ANY TRENCH SETTLEMENT DURING WARRANTY PERIOD SHALL BE CORRECTED AT CONTRACTOR'S EXPENSE, INCLUDING SURFACE RESTORATION.

LAST REVISION DATE: DEC 2015	
NATIVE SURFACE RESTORATION (NTS)	
PHILOMATH, OR	DETAIL NO. 304

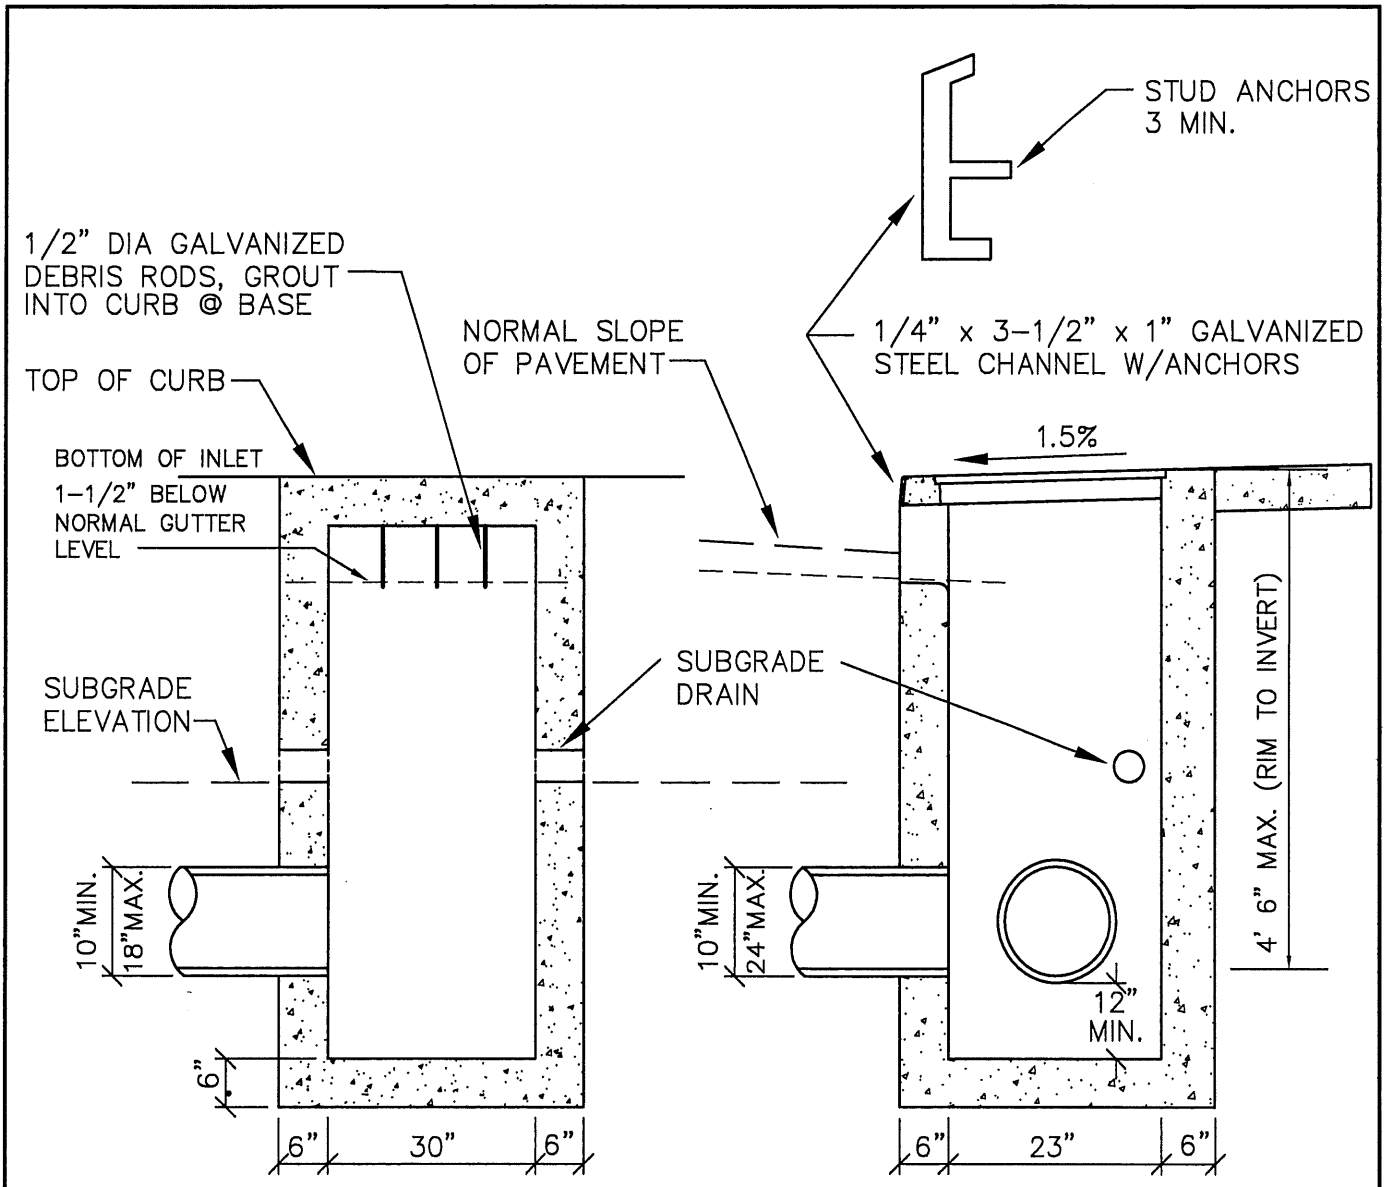

SECTION A–A

SECTION B–B

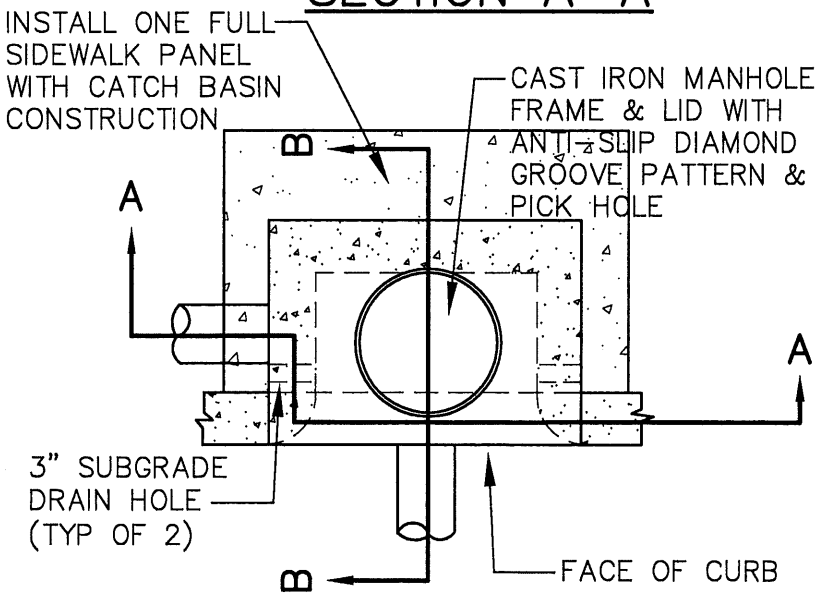

PLAN

NOTES:

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. ALL CONCRETE TO BE 3500 PSI @ 28 DAYS.
3. MATCH EXISTING CURB UNLESS OTHERWISE NOTED.

LAST REVISION DATE: MAY 2016	
STANDARD CURB-INLET CATCH BASIN (NTS)	
PHILOMATH, OR	DETAIL NO. 310

NOTE: CONTRACTOR TO VERIFY CB DATA & FINISH GRADE ELEV'S PRIOR TO INSTALLATION TO ENSURE THAT TOP OF CB DOES NOT EXTEND ABOVE SURROUNDING GRADE UNLESS OTHERWISE SPECIFICALLY NOTED ON THE DRAWINGS OR APPROVED BY THE CITY.

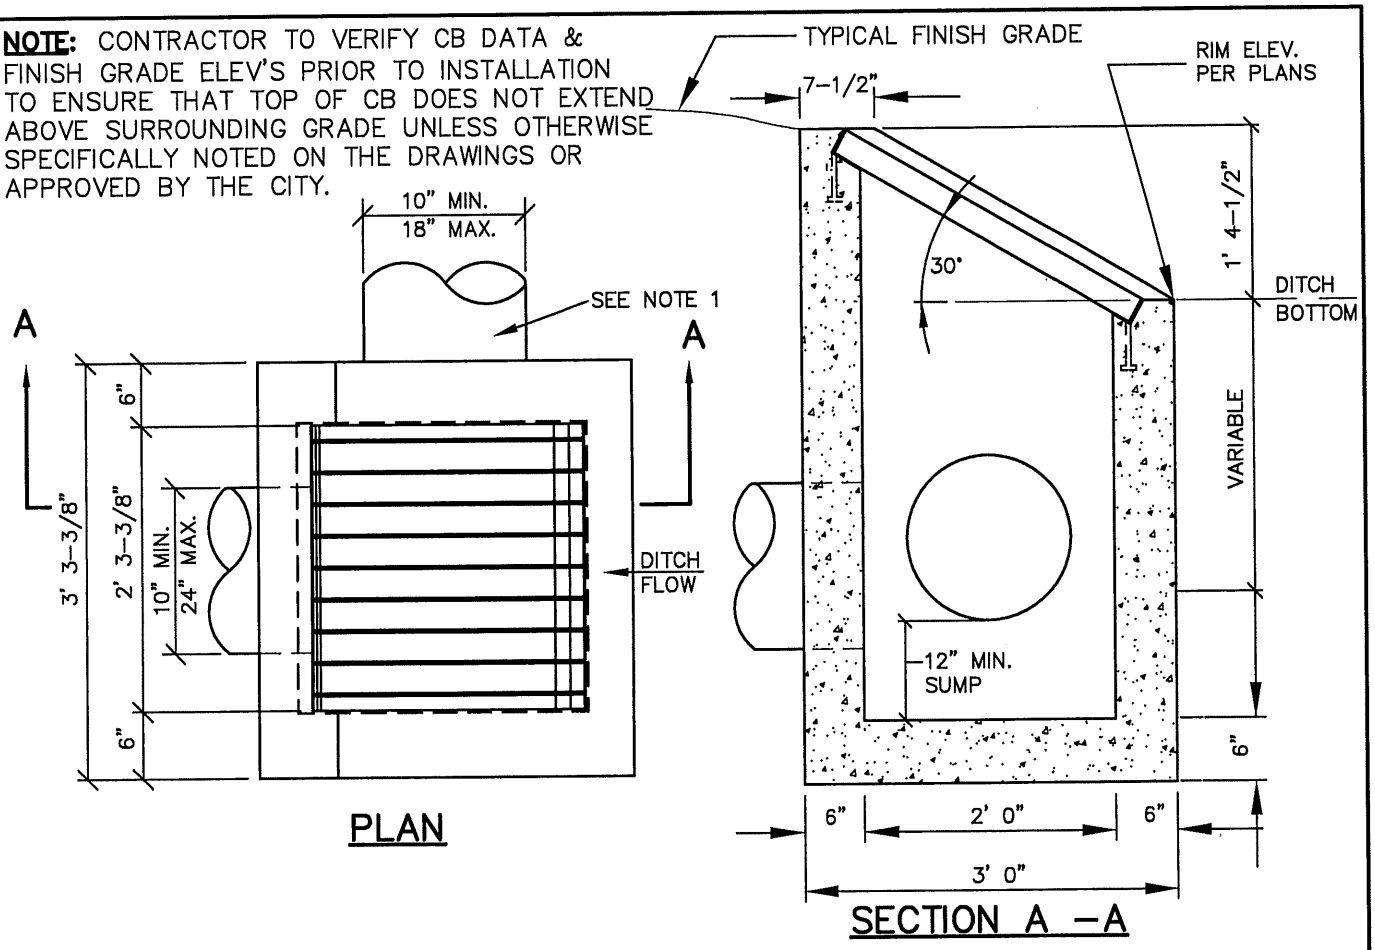

PLAN

SECTION A -A

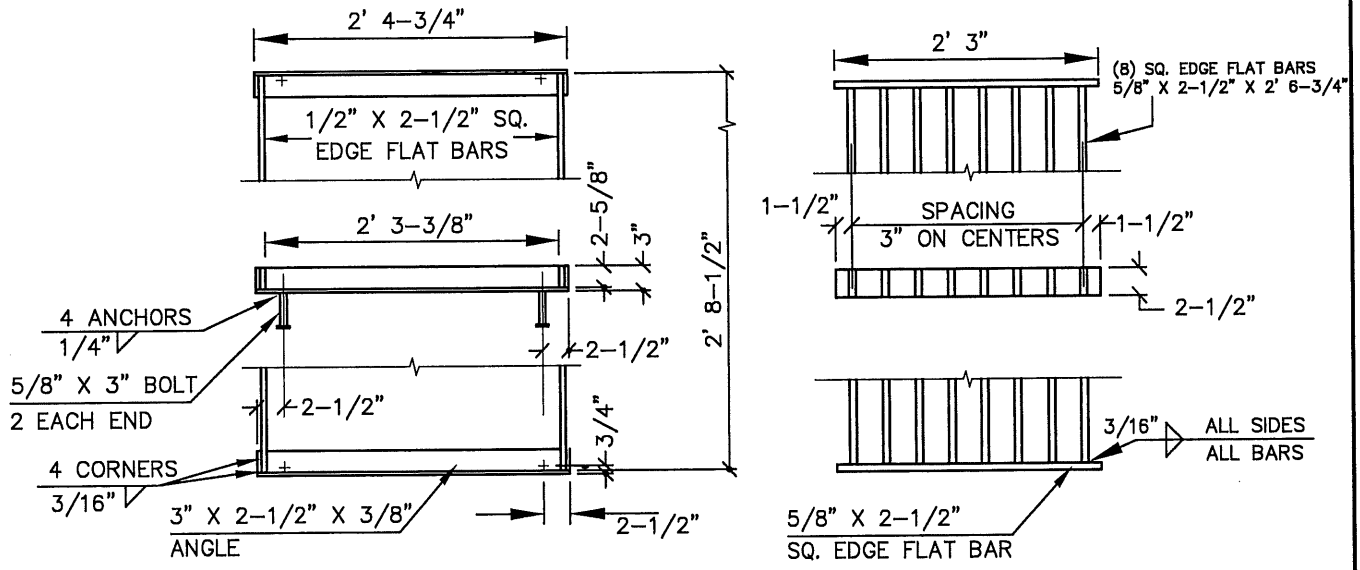

FRAME & GRATE

NOTES:

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. FRAME & GRATE SHALL BE ASTM A-36 STEEL, HOT-DIPPED GALV. AFTER CONSTRUCTION.
3. ALL CONCRETE TO BE 3000 PSI MIN AT 28 DAYS.
4. PRIOR TO CB INSTALLATION, CONTRACTOR SHALL VERIFY RIM ELEVATIONS LISTED AGAINST DITCH & FINISH GRADE ELEVATIONS, & NOTIFY CITY OF ANY DISCREPANCIES.

LAST REVISION DATE: JUNE 2014	
TYPE 3 DITCH INLET CATCH BASIN (NTS)	
PHILOMATH, OR	DETAIL NO. 313

NOTE: CONTRACTOR TO VERIFY FINISH GRADE ELEV'S PRIOR TO INSTALLATION TO ENSURE THAT TOP OF OUTLET STRUCTURE DOES NOT EXTEND ABOVE SURROUNDING GRADE UNLESS OTHERWISE NOTED ON DWGS OR APPROVED BY CITY. PROVIDE OUTLET PIPE & OUTLET CHANNEL (LENGTH & CONFIGURATION PER NOTE 4) AS NOTED UNLESS OTHERWISE SHOWN ON APPROVED DWGS OR REQUIRED BY CITY.

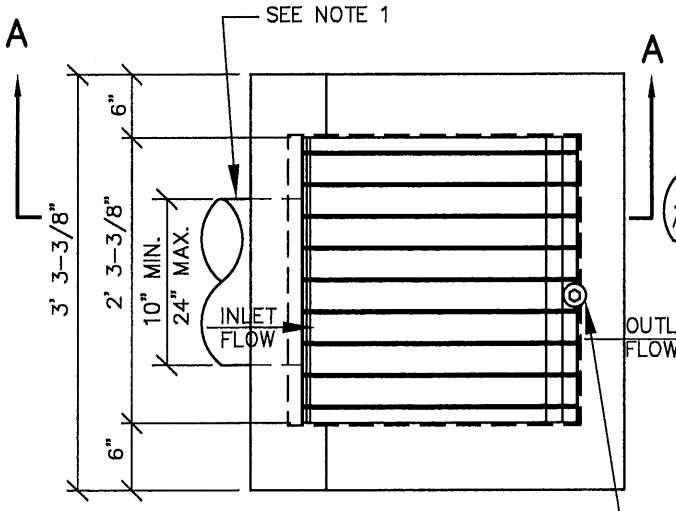

PLAN

INSTALL SINGLE 1/2" ST. STEEL EXPANSION ANCHOR BOLT & 2" PLATE WASHER UNLESS OTHERWISE APPROVED OR REQUIRED BY CITY

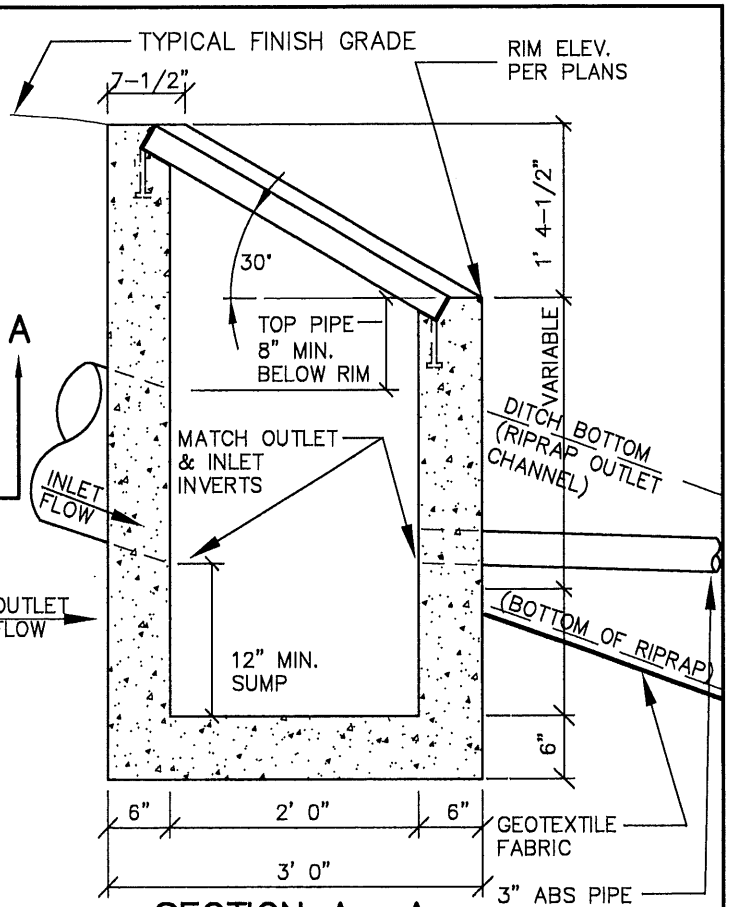

SECTION A –A

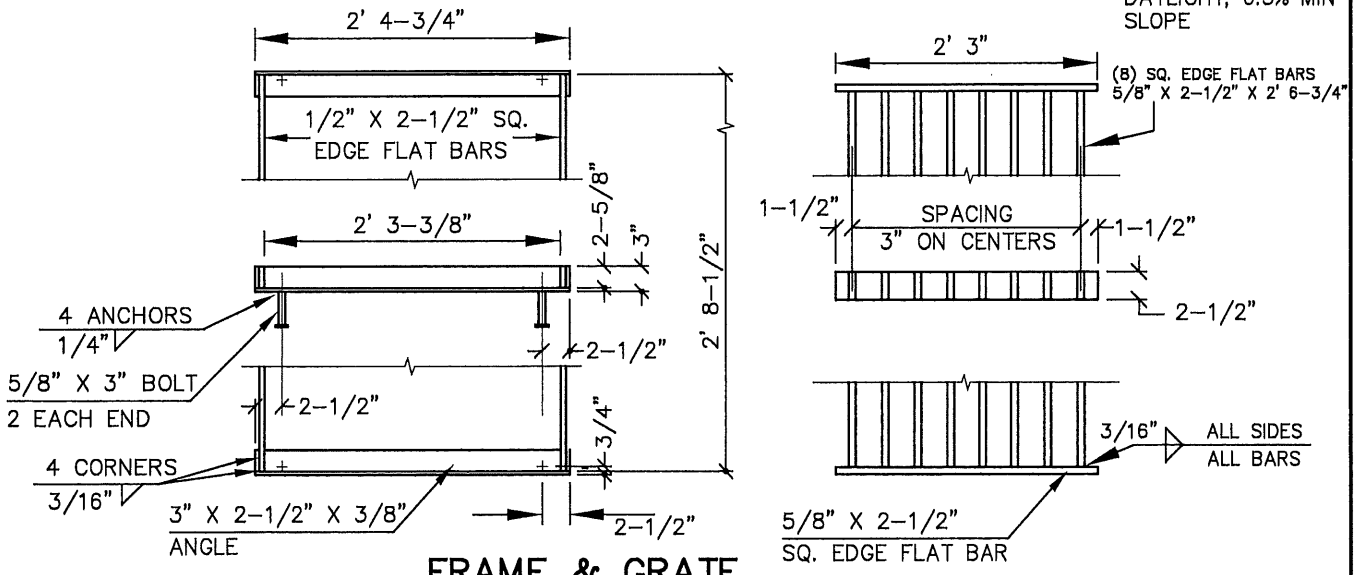

FRAME & GRATE

NOTES:

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. FRAME & GRATE SHALL BE ASTM A–36 STEEL, HOT–DIP GALV AFTER CONSTRUCTION.
3. ALL CONCRETE TO BE 3300 PSI MIN AT 28 DAYS.
4. PROVIDE RIPRAP OUTLET CHANNEL (TYP 18" MIN THICK) W/2H:1V SIDE SLOPES, 12" MIN CHANNEL DEPTH & LENGTH AS NOTED ON DRAWINGS (10' MIN). PROVIDE GEOTEXTILE UNDER RIPRAP TO TOP OF BANK (NO LAPS). USE 5"–12" GRADED ANGULAR RIPRAP (TYP), FILL VOIDS BETWEEN STONE WITH 3/4"–0 BASEROCK.

LAST REVISION DATE: JUNE 2014	
STORM OUTLET ENERGY DISSIPATOR BASIN (NTS)	
PHILOMATH, OR	DETAIL NO. 313A

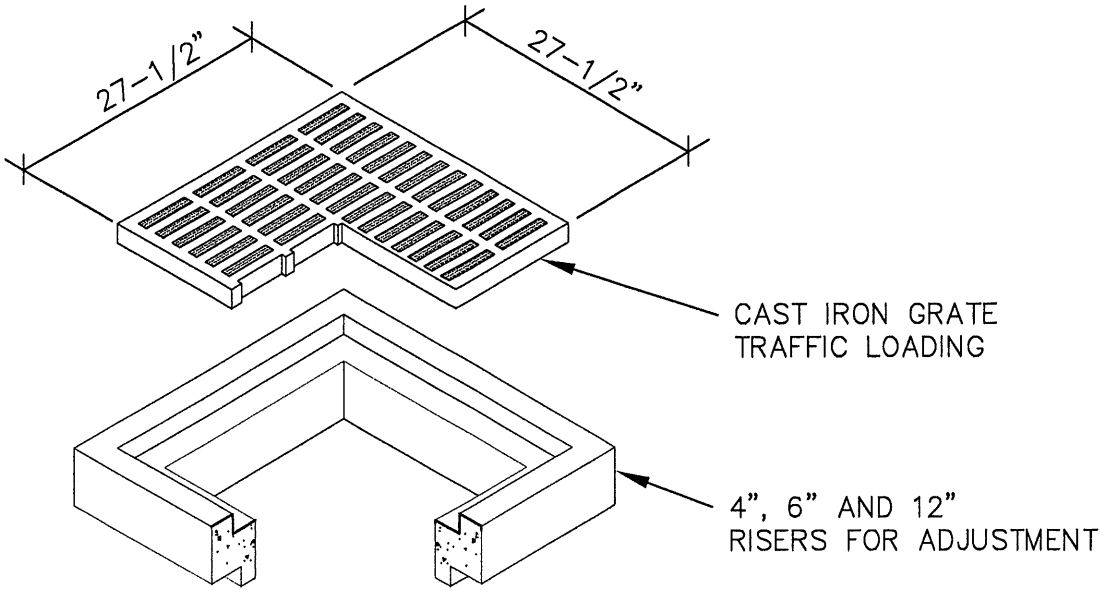

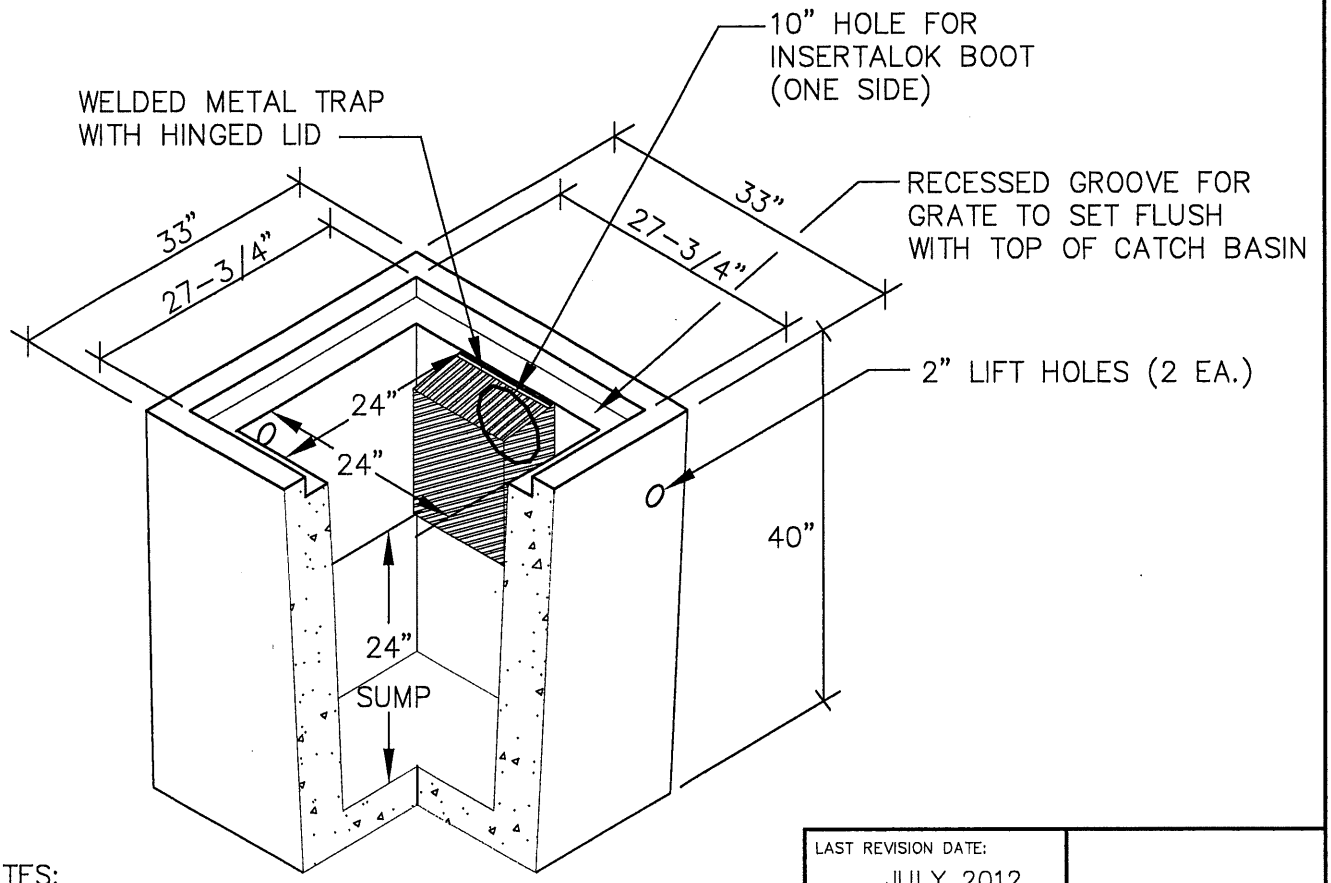

NOTES:

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. CONCRETE SHALL BE 4000 PSI @ 28 DAYS.
3. REBAR SHALL CONFORM TO ASTM A615 GRADE 60.
4. REBAR SHALL BE MIN. #4 BARS @ 6" C.C.
5. SET CB SQUARE WITH BUILDINGS OR WITH EDGE OF PARKING LOT OR DRIVEWAY WHEREIN IT LIES.
6. ADJUST PAVING SO WATER FLOWS TO CB WITH NO PONDING.

LAST REVISION DATE: JULY 2012	
PARKING LOT CATCH BASIN (PRECAST CONCRETE) (NTS)	
PHILOMATH, OR	DETAIL NO. 315

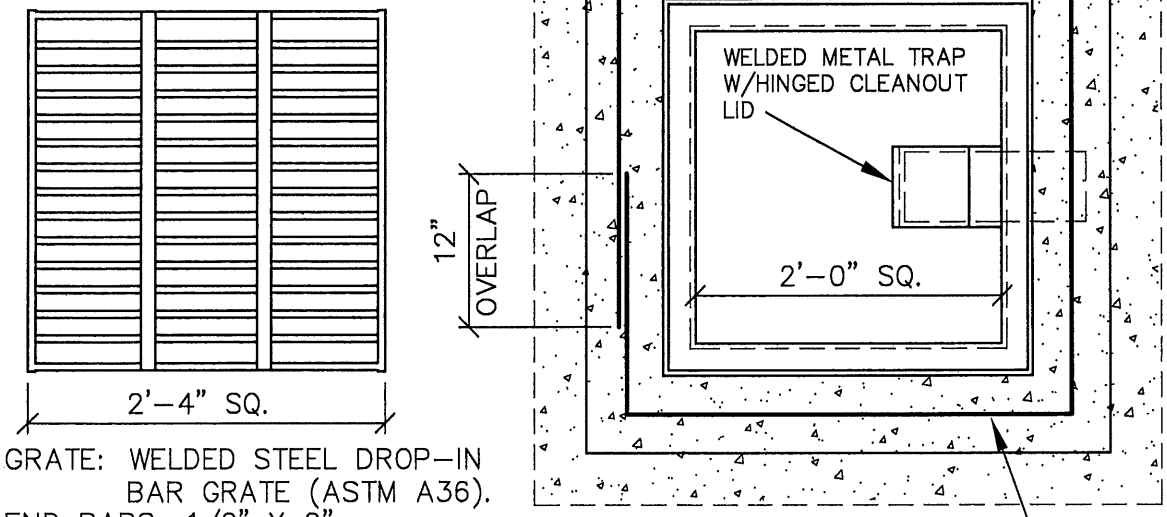

GRATE: WELDED STEEL DROP-IN BAR GRATE (ASTM A36).
END BARS: 1/2" X 2"
CROSS BARS: 1/2" X 2" @ 2" O.C.
BIKE STRAPS: 1/8" X 1" (2 REQ'D)
16,000 LB. UNIFORM LOAD CAPACITY

GRATE DETAIL

PLAN VIEW

#4 REBAR CONTINUOUS

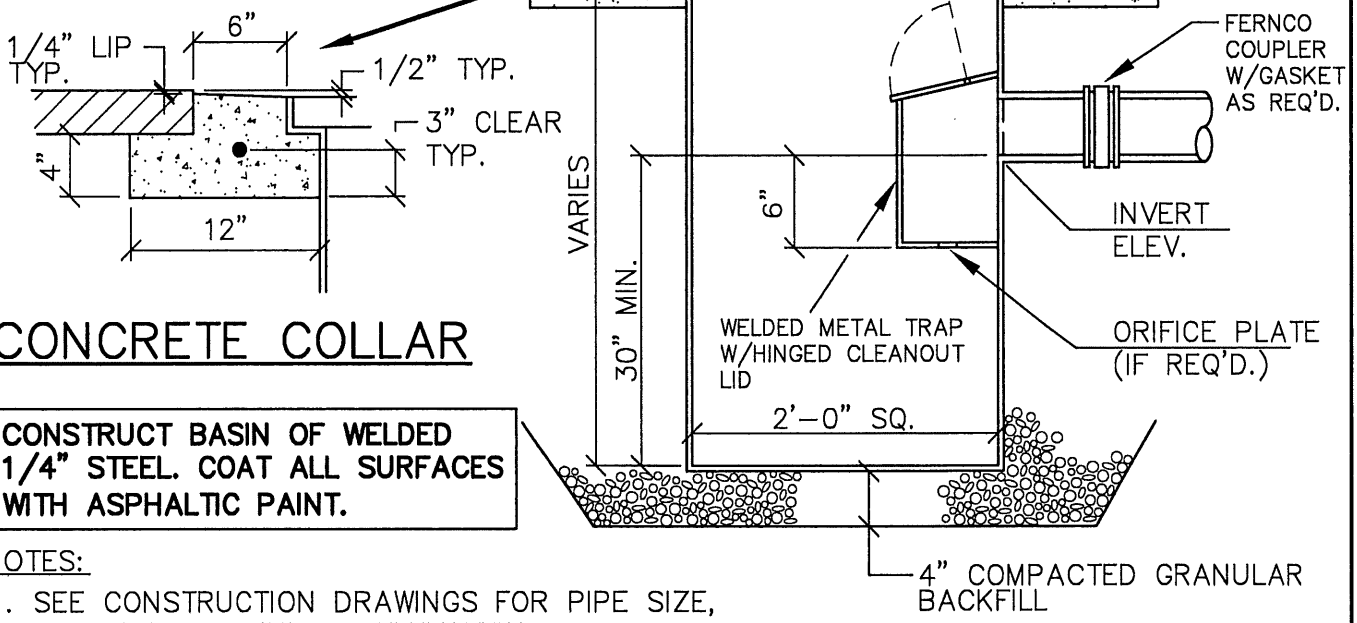

CONCRETE COLLAR

CONSTRUCT BASIN OF WELDED 1/4" STEEL. COAT ALL SURFACES WITH ASPHALTIC PAINT.

NOTES:

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. OUTLET: SIZE AS REQ'D. FOR INDICATED PIPE SIZE.
3. FOR JUNCTION BOX, REPLACE GRATE WITH 3/4" STEEL PLATE. DRILL ONE, 1" LIFTING HOLE, CENTERED IN ONE END OF THE PLATE. WELD SHIMS TO RIM AS REQUIRED TO RAISE PLATE TO RIM ELEVATION.
4. SET CB SQUARE WITH BUILDINGS OR WITH EDGE OF PARKING LOT OR DRIVEWAY WHEREIN IT LIES.
5. ADJUST PAVING SO WATER FLOWS TO CB WITH NO PONDING.

LAST REVISION DATE: JULY 2012	
PARKING LOT CATCH BASIN (LYNCH STYLE) (NTS)	
PHILOMATH, OR	DETAIL NO. 316

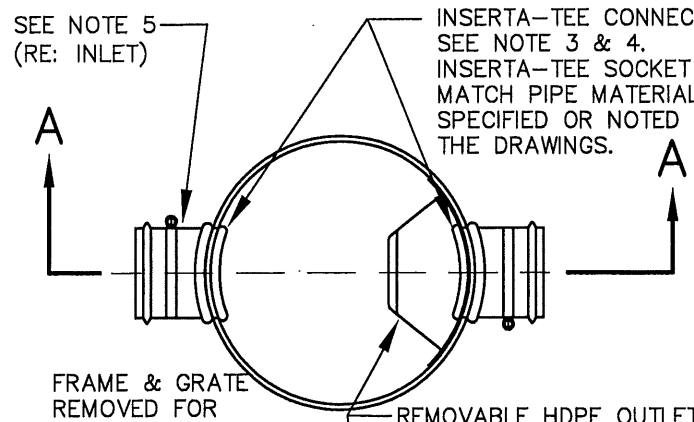

PLAN

REMOVABLE HDPE OUTLET TRAP REQUIRED ON ALL PRIVATE CATCH BASINS (OMIT FOR FLOW-THRU JUNCTION STRUCTURES). ALL CLIPS & HARDWARE TO BE STAINLESS STEEL.

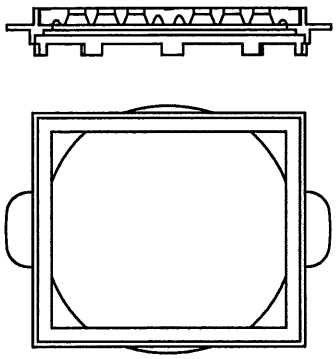

FRAME TO INCLUDE TABS THAT MATCH BASIN OD TO PREVENT DISPLACEMENT. FRAME BODY TO BEAR ON COMPACTED BASEROCK (SEE SECTION A-A)

FRAME

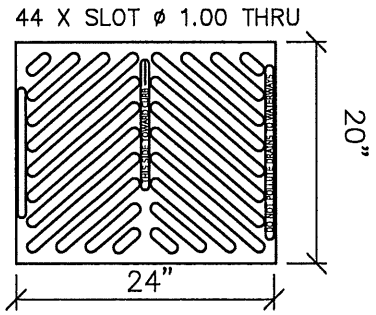

APPROX. DRAIN AREA = 202.48 SQ IN

GRATE

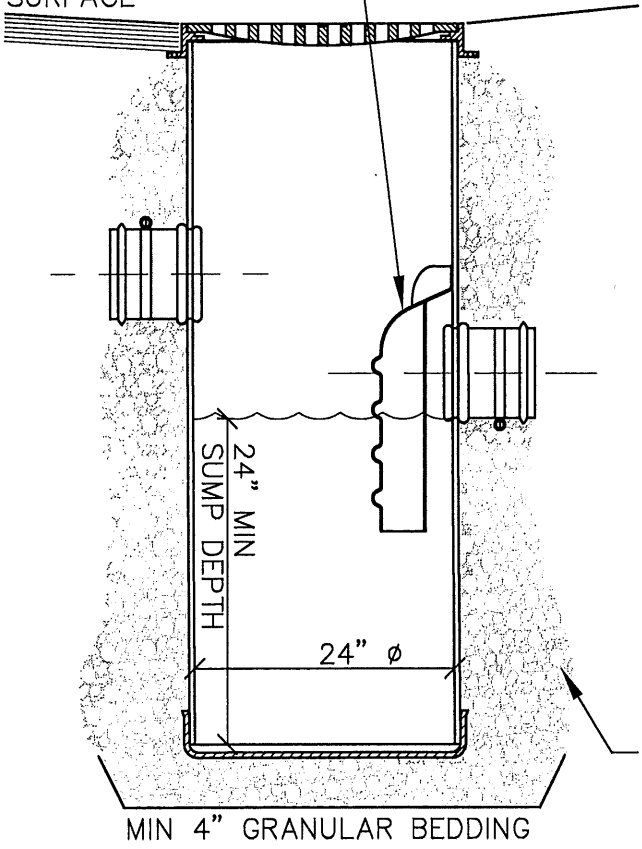

COMPACTED GRANULAR BACKFILL AROUND CATCH BASINS & AREA DRAINS (GRADE AS REQUIRED TO SUPPORT GRATE FRAME).

SECTION A-A

NOTES:

1. NYLOPLAST TRAFFIC RATED DRAIN BASIN OR APPROVED EQUAL W/NYLOPLAST FRAME & GRATE.
2. HERRING-BONE STYLE GRATE TO BE DUCTILE IRON PER ASTM A536 GRADE 70-50-05.
3. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION, ORIENTATION AND INVERT ELEVATIONS.
4. CONNECTIONS TO PVC CATCH BASIN TO BE INSERTA-TEE STYLE FITTINGS (FACTORY OR FIELD INSTALLED).
5. FLOW-THRU CONFIGURATION SHOWN IS ALLOWED ONLY FOR AREA DRAINS OR JUNCTION BOXES.
6. SET CB GRATE SQUARE WITH BUILDINGS OR WITH EDGE OF PARKING LOT OR DRIVEWAY WHEREIN IT LIES.
7. ADJUST PAVING OR GRADING SO WATER FLOWS TO STRUCTURE INLET WITH NO PONDING.

NOTE: PER ORS 92.044(7), AREA DRAIN MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

LAST REVISION DATE:	JO #
JAN 2013	

PARKING LOT CATCH BASIN (TRAFFIC RATED PVC w/TRAP, DUCTILE IRON FRAME/GRATE)

(NTS)

PHILOMATH, OR	DETAIL NO. 317

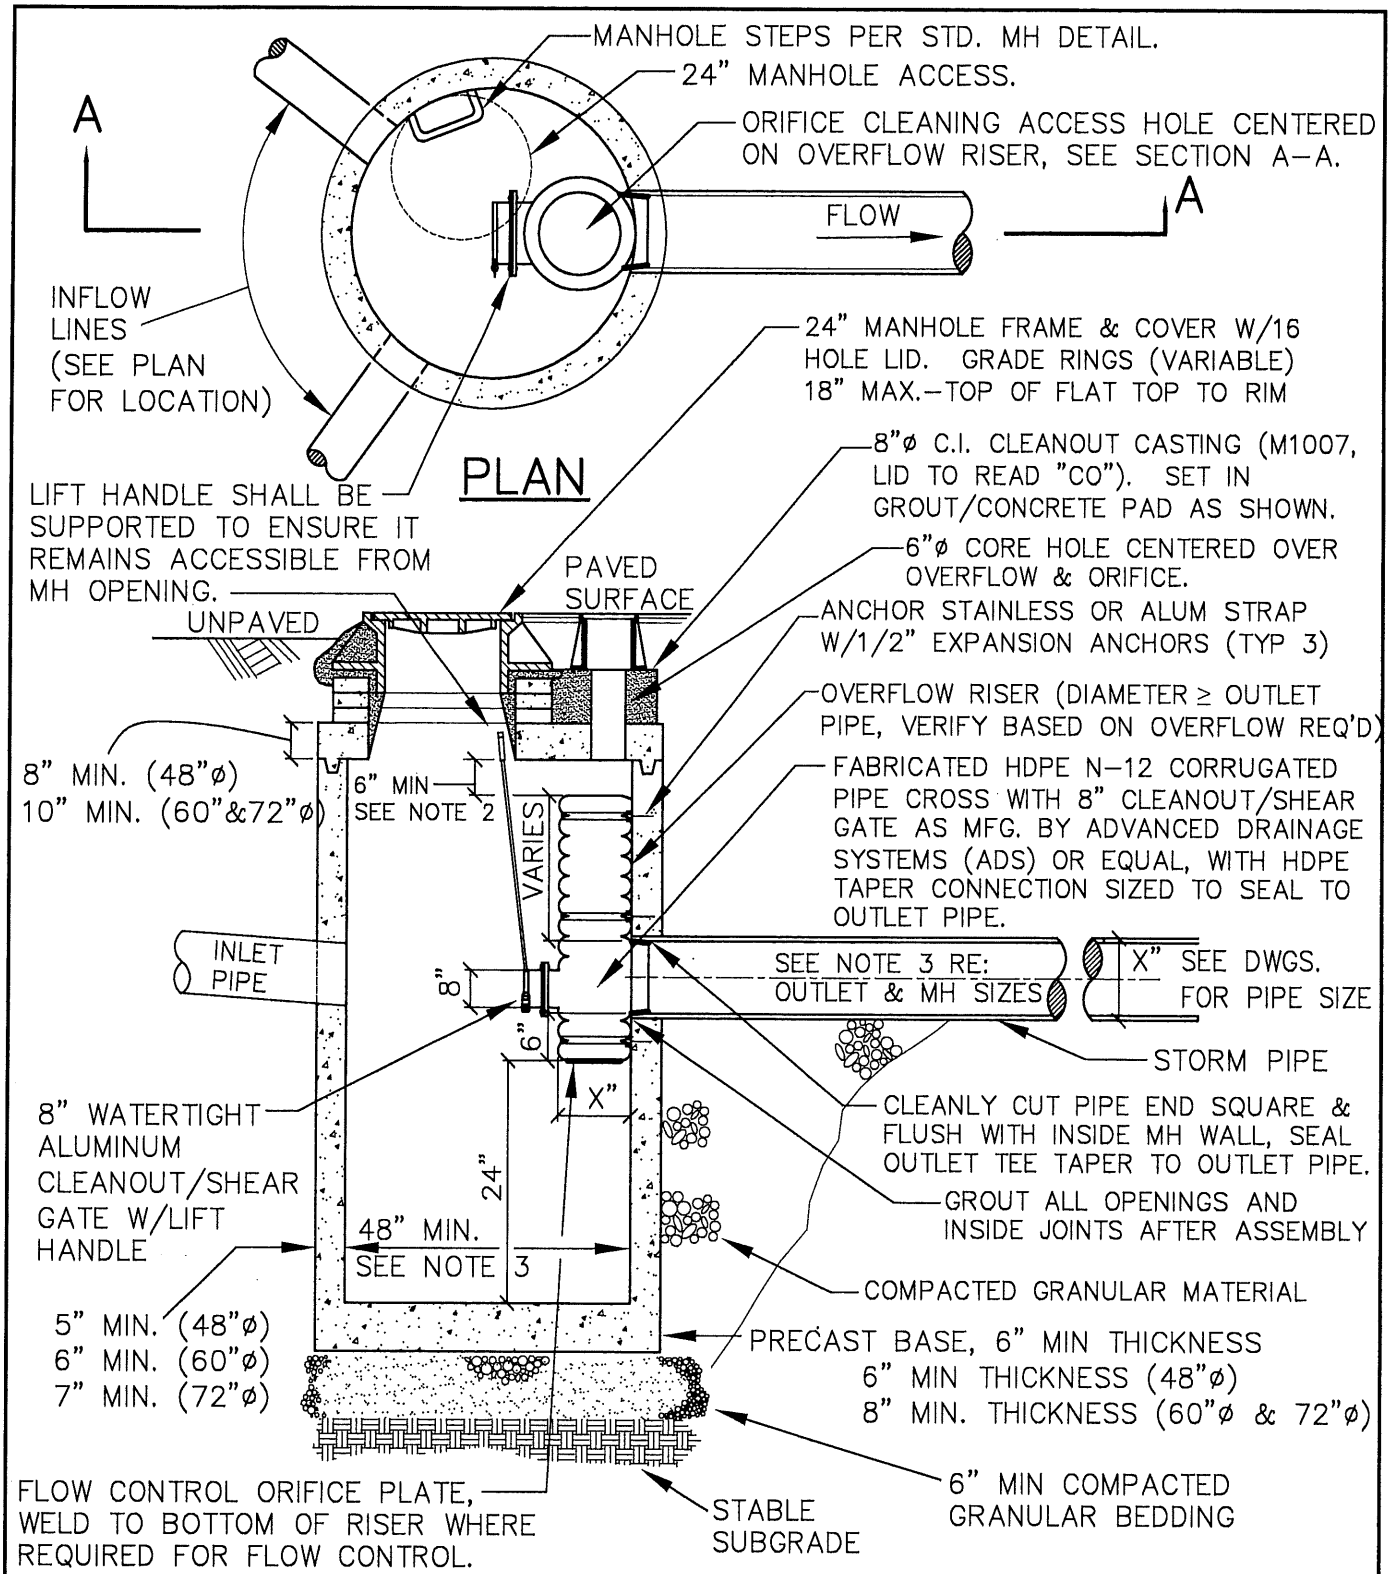

SECTION A-A

NOTES:

1. PRECAST SECTIONS SHALL CONFORM TO ASTM C-478.
2. DISTANCE FROM TOP OF OVERFLOW TO MH RIM SHALL BE BASED ON OVERFLOW CAPACITY CALC'S BY DESIGN ENGINEER (ASSUME ORIFICE CONTROL).
3. 60" MINIMUM DIA. MANHOLE REQUIRED FOR OUTLET PIPE LARGER THAN 15" OR INLET > 21".
4. ORIFICE CLEANING ACCESS TO BE 6" CORE HOLE THROUGH FLAT-TOP (CENTERED ON OVERFLOW) WITH CI CLEANOUT BOX GROUTED TO SLAB.

LAST REVISION DATE: AUG 2014	
POLLUTION/FLOW CONTROL MANHOLE W/OVERFLOW (NTS)	
PHILOMATH, OR	DETAIL NO. 320

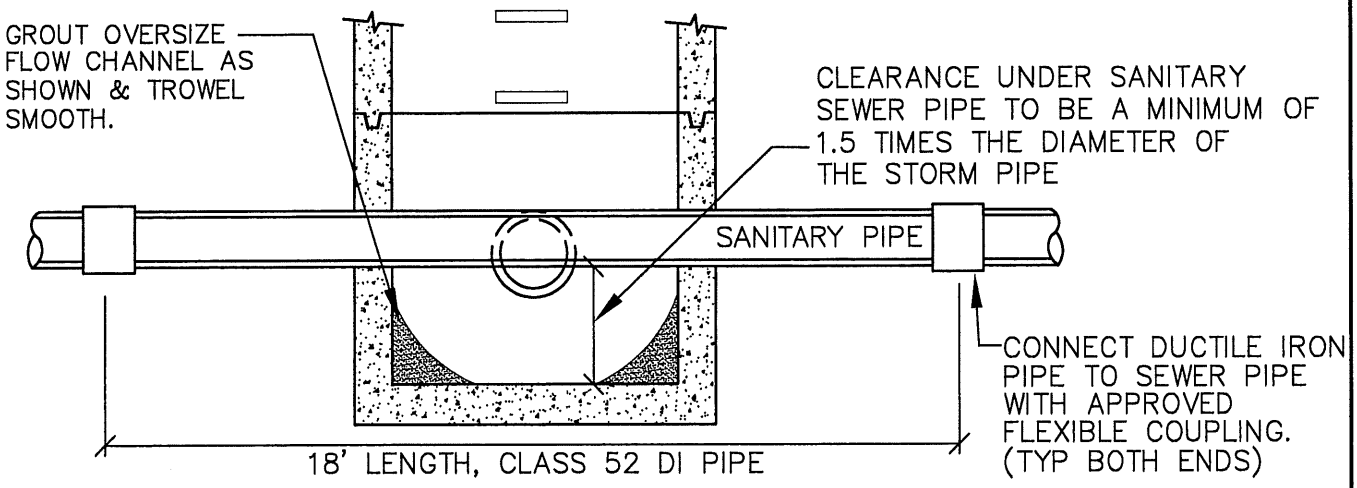

SECTION THRU SANITARY SEWER

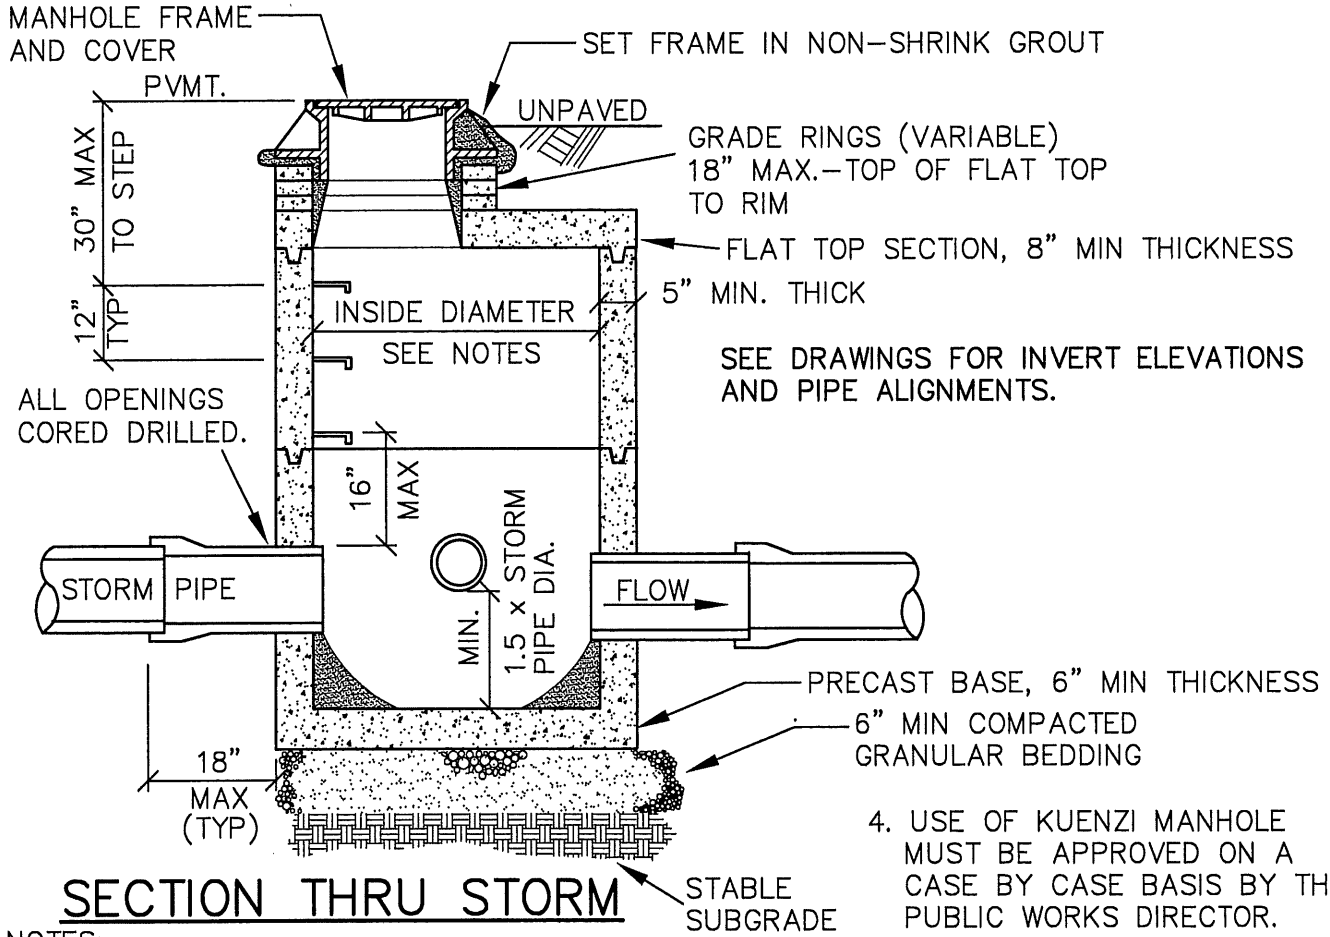

SECTION THRU STORM

NOTES:

1. UNLESS OTHERWISE SHOWN ON DRAWINGS, USE 48" MANHOLE FOR SANITARY SEWER UP TO 12" DIA. & STORM DRAIN UP TO 18" DIAMETER.
2. PRECAST SECTIONS SHALL MEET OR EXCEED ASTM C-478. WATERTIGHT O-RING OR MASTIC KEYLOCK JOINTS REQUIRED.
3. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD.
4. USE OF KUENZI MANHOLE MUST BE APPROVED ON A CASE BY CASE BASIS BY THE PUBLIC WORKS DIRECTOR.

LAST REVISION DATE: JUNE 2015	
KUENZI MANHOLE (NTS)	
PHILOMATH, OR	DETAIL NO. 330

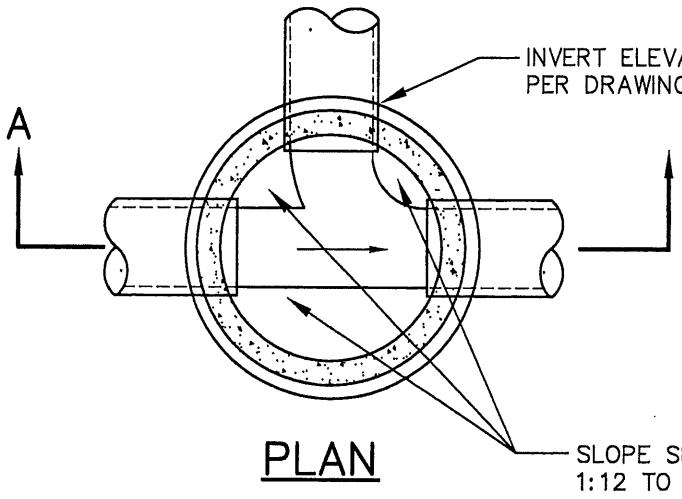

NOTE: PER ORS 92.044(7), MANHOLE MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

PLAN

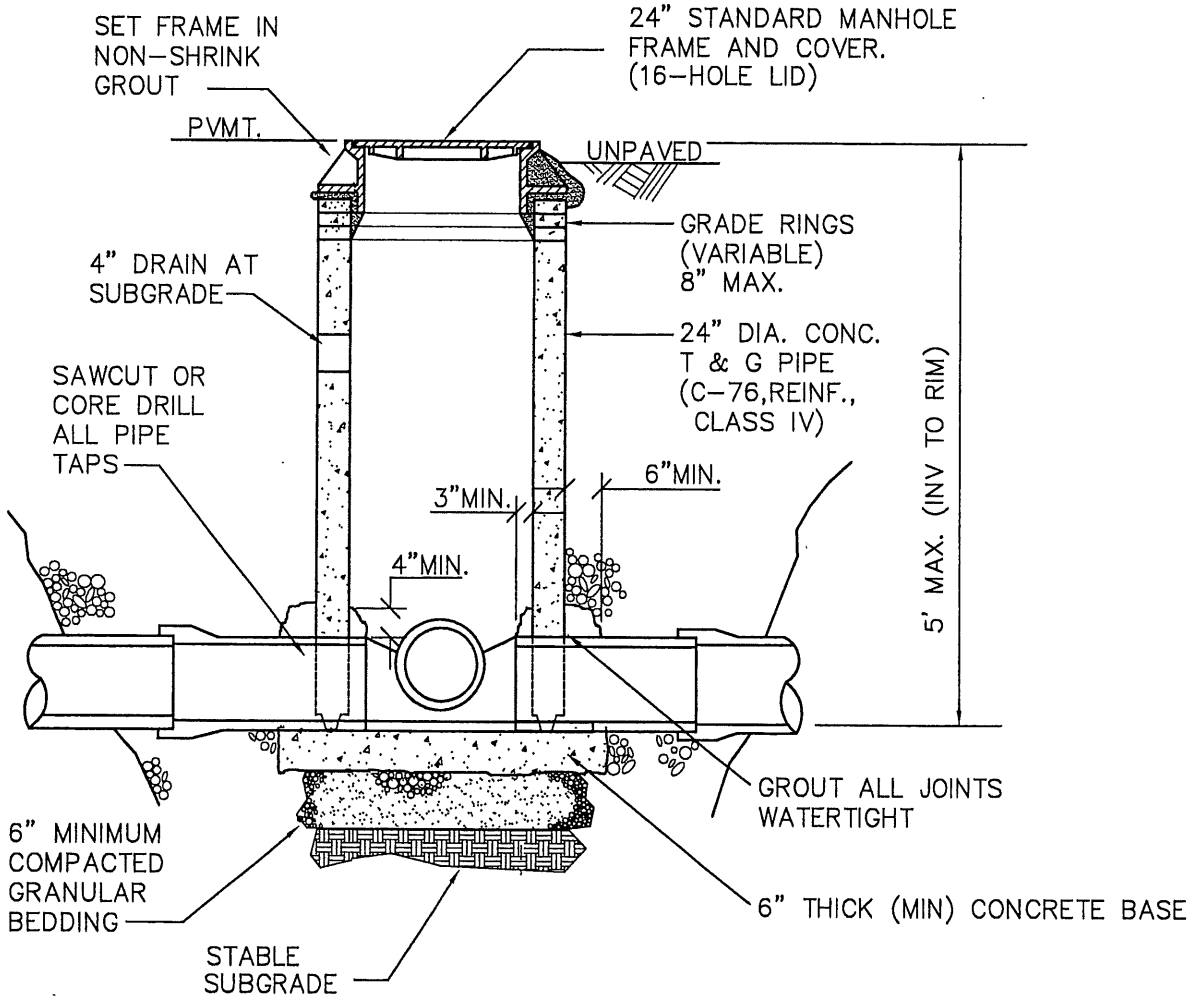

SECTION A-A

NOTE:

1. MAXIMUM PIPE NUMBER & DIAMETERS AS FOLLOWS:
   12" DIAMETER OR LESS - 4 MAXIMUM.
   15" DIAMETER - 2 MAXIMUM.
   ALL OTHER CONFIGURATIONS REQUIRE STANDARD MANHOLE.

LAST REVISION DATE: MAR 2008	
24" DIA. STORM MANHOLE (NTS)	
PHILOMATH, OR	DETAIL NO. 350

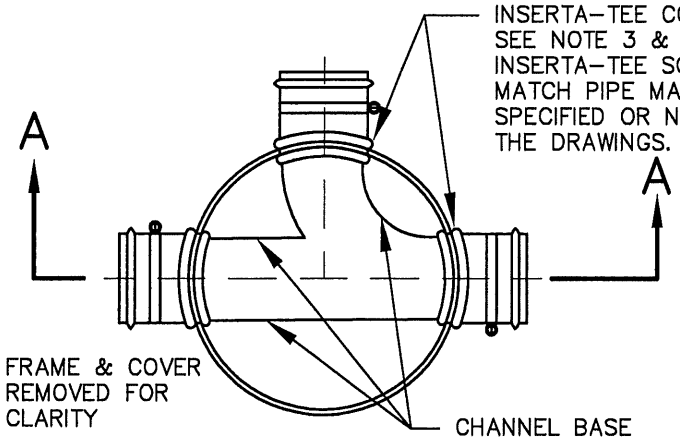

PLAN

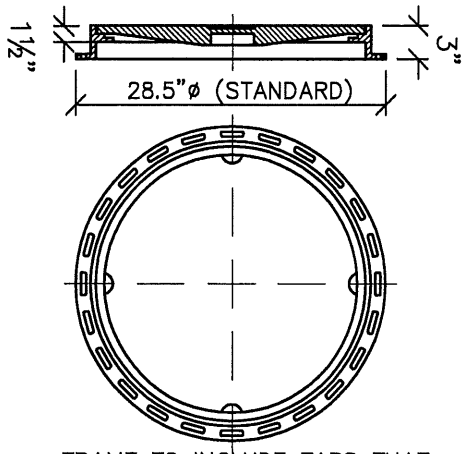

FRAME TO INCLUDE TABS THAT MATCH BASIN OD TO PREVENT DISPLACEMENT. FRAME BODY TO BEAR ON COMPACTED BASEROCK (SEE SECTION A-A)

FRAME

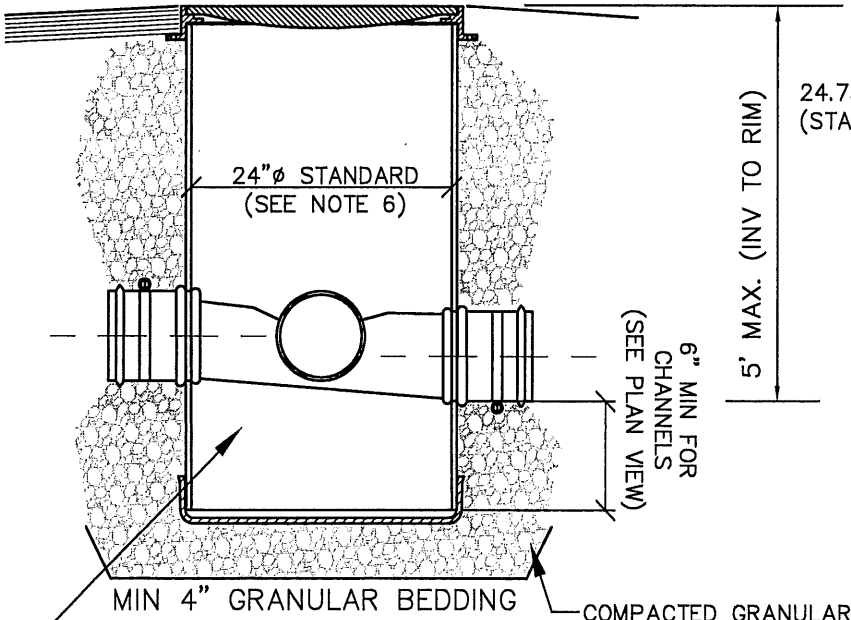

SECTION A-A

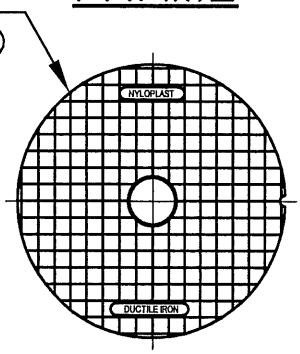

PROVIDE A MINIMUM OF (2) 1" DIAMETER PICK HOLES IN SOLID LID, OR PROVIDE STANDARD 16-HOLE STORM MANHOLE LID.

SOLID LID

NOTE: PER ORS 92.044(7), MANHOLE MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

NOTES:

1. NYLOPLAST TRAFFIC RATED DRAIN BASIN OR APPROVED EQUAL WITH NYLOPLAST FRAME & MH LID.
2. MH FRAME & COVER TO BE DUCTILE IRON PER ASTM A536 GRADE 70-50-05.
3. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION, ORIENTATION AND INVERT ELEVATIONS.
4. CONNECTIONS TO PVC MANHOLE TO BE INSERTA-TEE STYLE FITTINGS (FACTORY OR FIELD INSTALLED).
5. FIVE (5) FOOT MAXIMUM ALLOWABLE DEPTH FROM RIM TO OUTLET INVERT (DEEPER APPLICATIONS REQUIRE 48" MANHOLE).
6. MAXIMUM NUMBER & CONFIGURATION OF PIPE CONNECTIONS TO BE BASED ON INSERTA-TEE RECOMMENDATIONS. PROVIDE 30" DIAMETER BASIN & 30" SOLID COVER IF REQUIRED DUE TO NO. OF PIPES, SPACING &/OR ANGLES (30" MH TO MEET ALL DETAIL REQUIREMENTS SHOWN EXCEPT DIAMETER).
7. USE OF THIS DETAIL MUST BE APPROVED ON A CASE BY CASE BASIS BY THE PUBLIC WORKS DIRECTOR.

LAST REVISION DATE:	JO #
JUNE 2015	

24" DIA. STORM MANHOLE (TRAFFIC RATED PVC W/SOLID DUCTILE IRON FRAME/COVER)

(NTS)

PHILOMATH, OR	DETAIL NO. 351

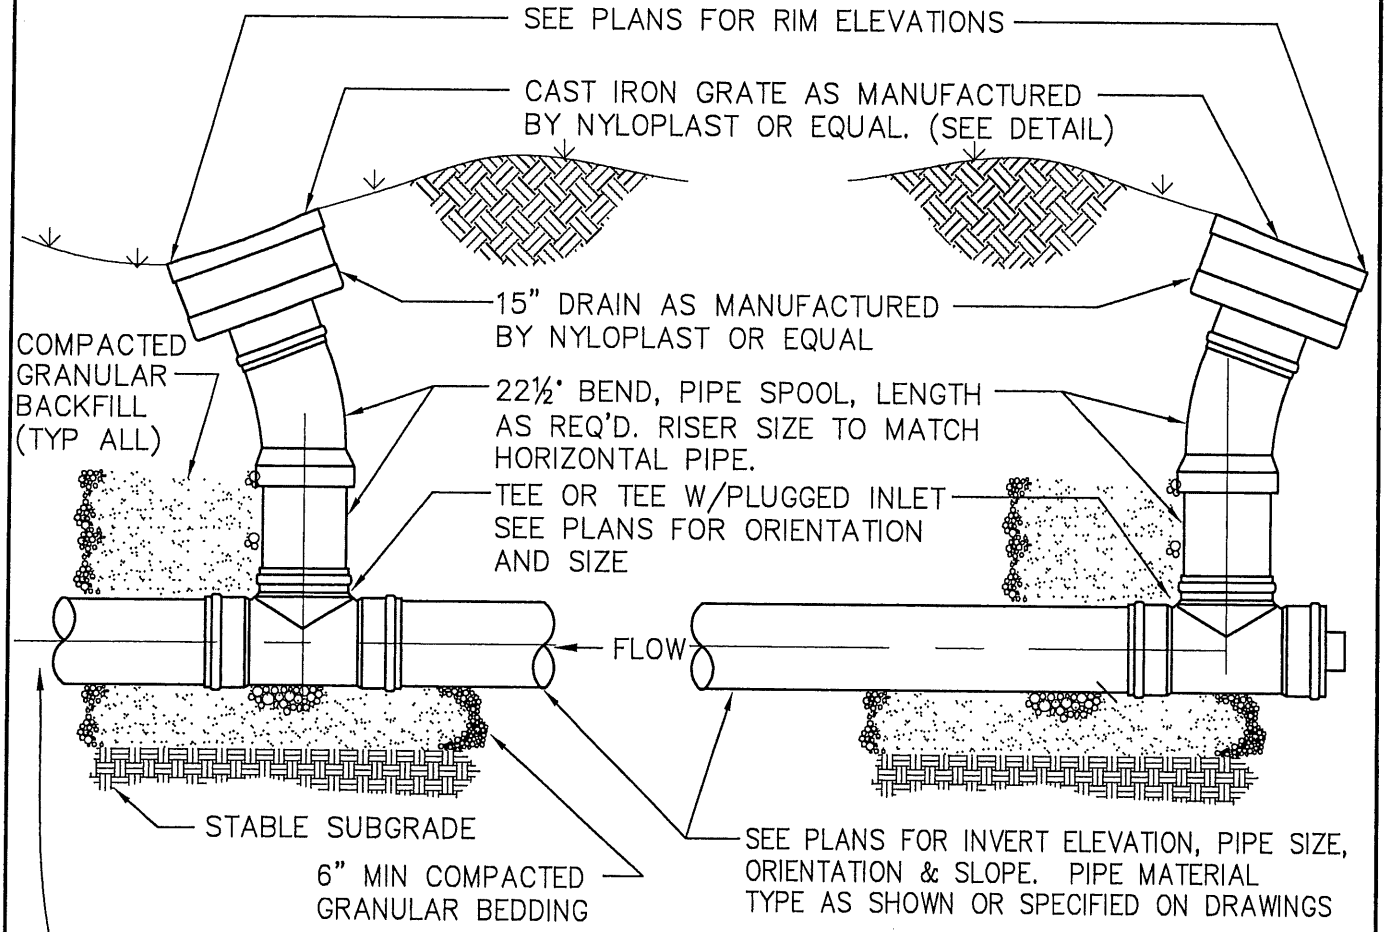

AREA DRAIN
NTS

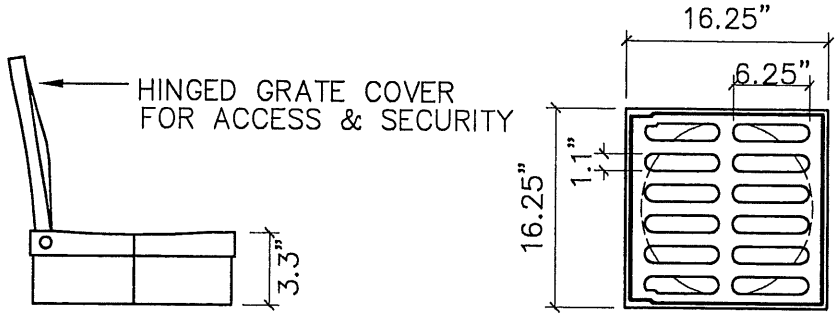

STANDARD

15" CAST IRON GRATE DETAIL
NTS

NOTES:

1. AREA DRAIN NOT FOR USE IN AREAS SUBJECT TO VEHICLE TRAFFIC.
2. USE WATERTIGHT GASKETED FITTINGS AND ADAPTORS FOR ALL PIPE CONNECTIONS.
3. ALL GRATES IN PEDESTRIAN AREAS SHALL CONFORM WITH ADA REQUIREMENTS, INCLUDING GRATE OPENING SIZE.

LAST REVISION DATE: NOV 2008	JO # STANDARD
PRIVATE AREA DRAIN, NON-TRAFFIC AREAS (NTS)	
PHILOMATH, OR	DETAIL NO. 355

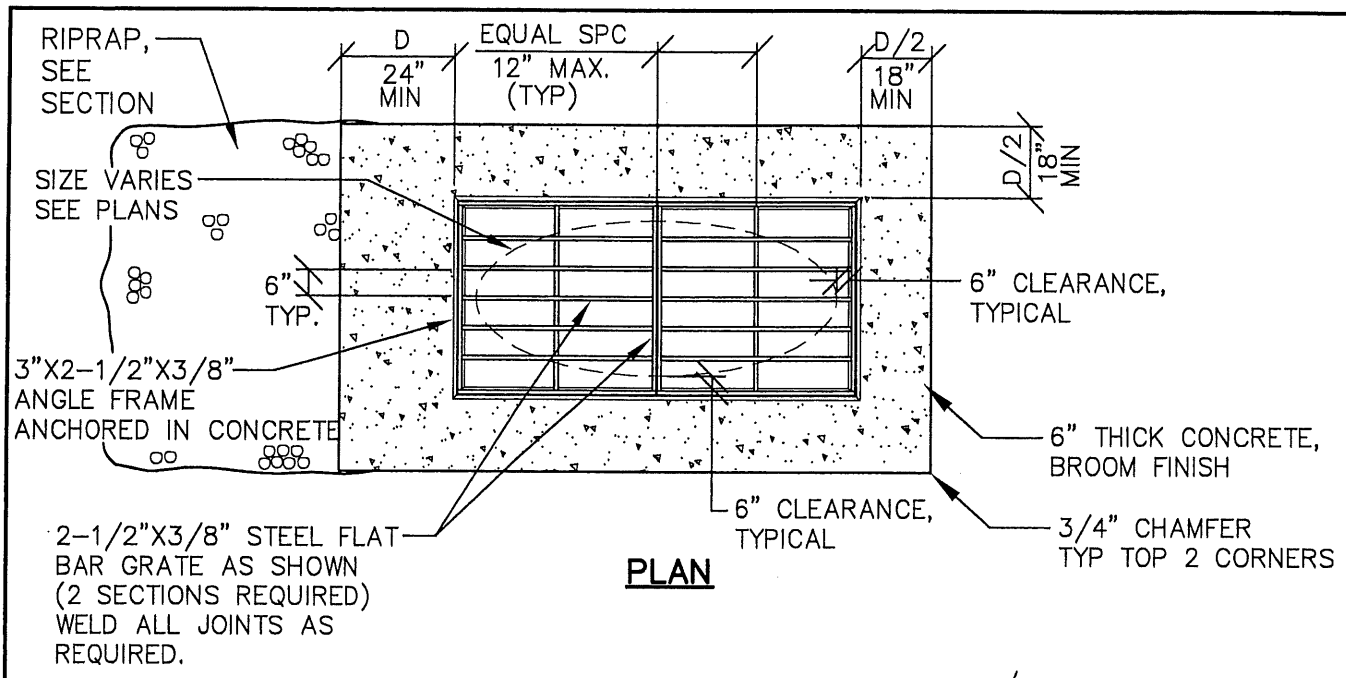

PLAN

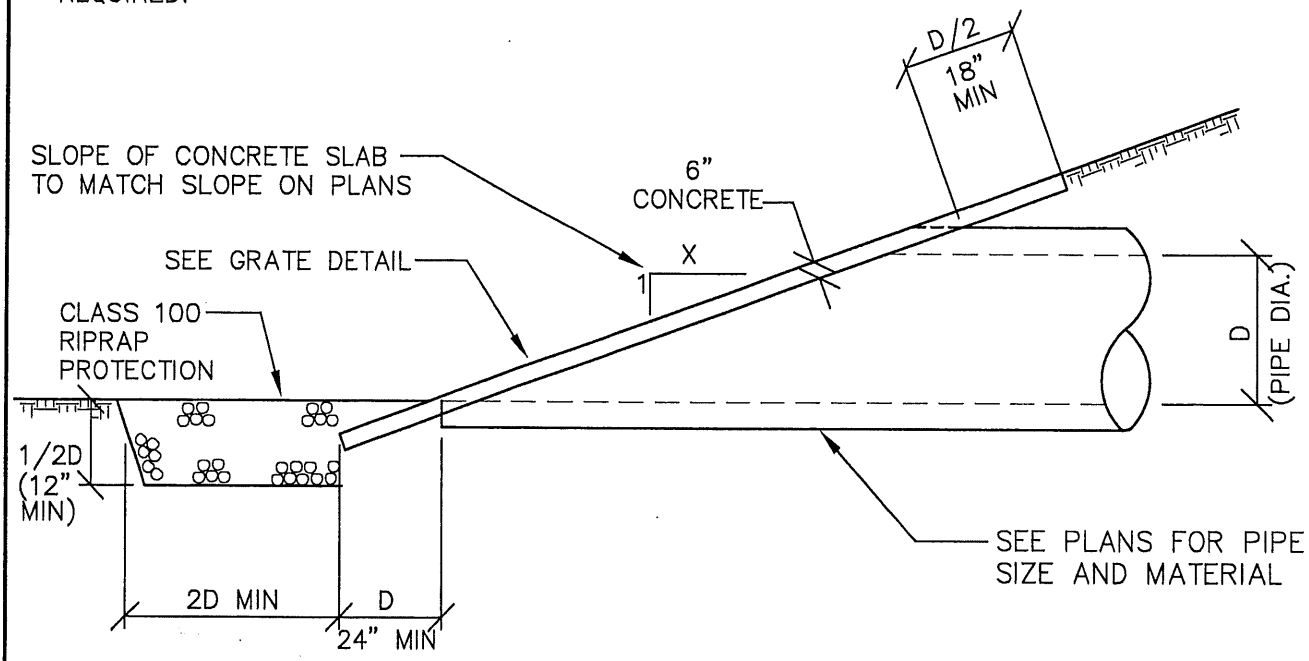

(NORMAL TO CL OF EMBANKMENT)

SECTION

NOTES:

1. SEE CONSTRUCTION DRAWINGS FOR PIPE SIZE, LOCATION AND INVERT ELEVATION.
2. FRAME AND GRATE SHALL BE ASTM A-36 STEEL, HOT DIP GALVANIZED AFTER CONSTRUCTION.
3. ALL CONCRETE TO BE 3300 PSI AT 28 DAYS.

LAST REVISION DATE: NOV 2006	
CONCRETE PIPE END CAP WITH GRATE (NTS)	
PHILOMATH, OR	DETAIL NO. 362

STORM SEWER MANDREL TEST REPORT

Project Location: (City)	Project Name:
Inspector: (Print)	Date: (Separate Report Required for Each Test Session)
Mandrel Diameters Verified? Yes / No	

Station (& Manhole #)		Size & Material	Length (ft)	Results	Backfill Compaction Completed?	Date Sewer Flushed & Cleaned	Comments
From	To						
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		

1. Mandrel testing shall be conducted on a manhole to manhole (or cleanout) basis and shall be done after the line has been completely flushed out with water.

2. Mandrel testing shall be conducted after trench backfill and compaction has been completed.

3. The mandrel diameter shall be 95% of the pipe initial inside diameter. The inspector shall verify the diameter of each mandrel used during each test session.

STORM PIPELINE TV INSPECTION REPORT

Page ___ of ____

Date:	Client: City:					Basin No.	
Technician:	Inspector:		Weather:	Cleaned By:		Report No.	Tape No.
From M.H. #: Street:	Pipe Dia. (in)	Joint Length (ft)	Section Length (ft)	Joint Type:	Pipe Material	To M.H. #: Street:	

PIPELINE DATA;

Cleanliness: _____

Alignment: _____

Grade: _____

Age: _____

%Est. Leaking Joints: _____

Other:_____

_____

Footage	Problem Code	Comments	I/I (gpm)

PROBLEM CODE LEGEND:

BP = Broken Pipe
CC = Circumferential Crack
LC = Longitudinal Crack
G = Break in Grade
L = Leak
PJ = Pulled Joint
PT = Protruding Tap
ST = Service Tap
SL = Service Left
SR = Service Right
RT = Roots
U = Unpassable

PIPE MATERIAL **LEGEND:**

AC = Asbestos Cement
CIP = Cast Iron Pipe
C(M) = Conc., Mortar Joint
C(R) = Conc., Rubr. Gasket Jnt
DI = Ductile Iron Pipe
PVC = Polyvinylchloride Pipe
TC = Terra Cotta
VC = Vitrified Clay

TURNAROUND:

Requested (Date/time):_____

Authorized (Date/time):_____

NOTE: PER ORS 92.044(7), MANHOLE MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

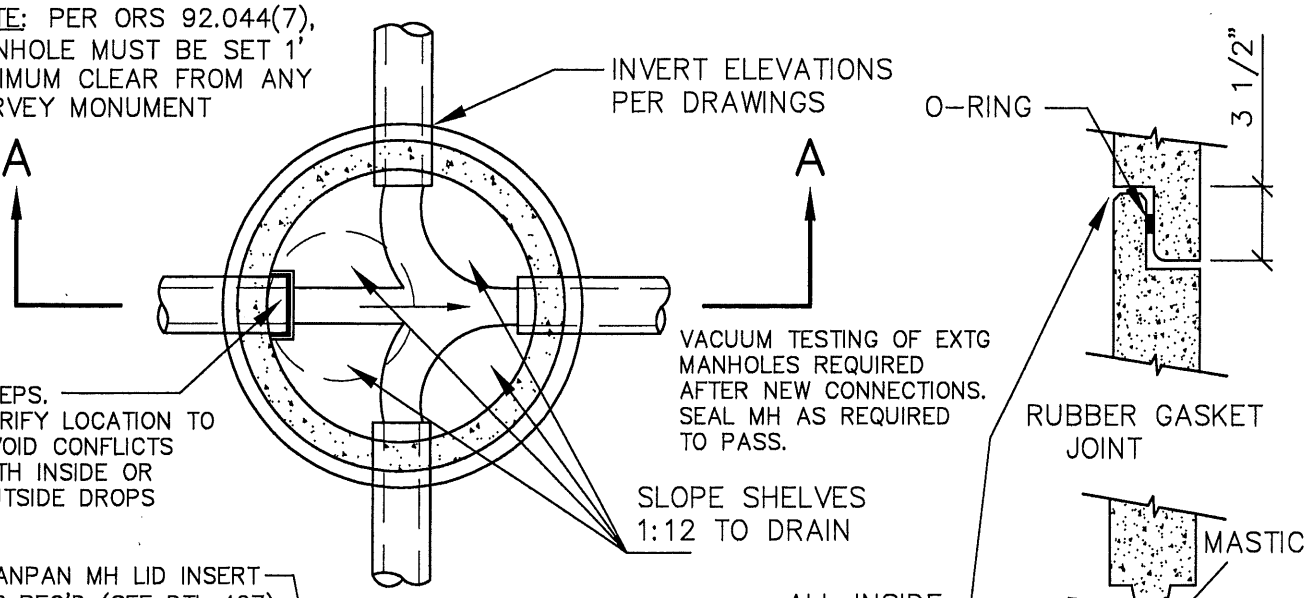

PLAN

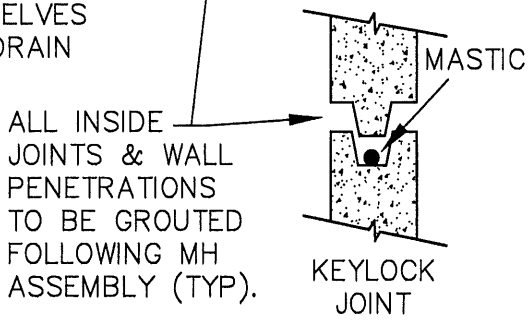

FLAT TOP MH'S SHALL BE USED FOR ALL MH'S LESS THAN 6' RIM TO INVERT, OR WITH PIPE CONNECTIONS WITHIN 5 FEET OF RIM ELEV.

SECTION A-A

NOTES:

1. PRECAST SECTIONS SHALL MEET OR EXCEED ASTM C-478.
2. WATERTIGHT O-RING OR MASTIC KEYLOCK JOINTS REQUIRED.
3. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD. ADD STEPS TO EXTG CONNECTION MH IF EXTG STEPS ARE ABSENT.

LAST REVISION DATE: DEC 2015	

STANDARD MANHOLE FOR 21" PIPE AND SMALLER

(NTS)

PHILOMATH, OR	DETAIL NO. 401

NOTE: PER ORS 92.044(7), MANHOLE MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

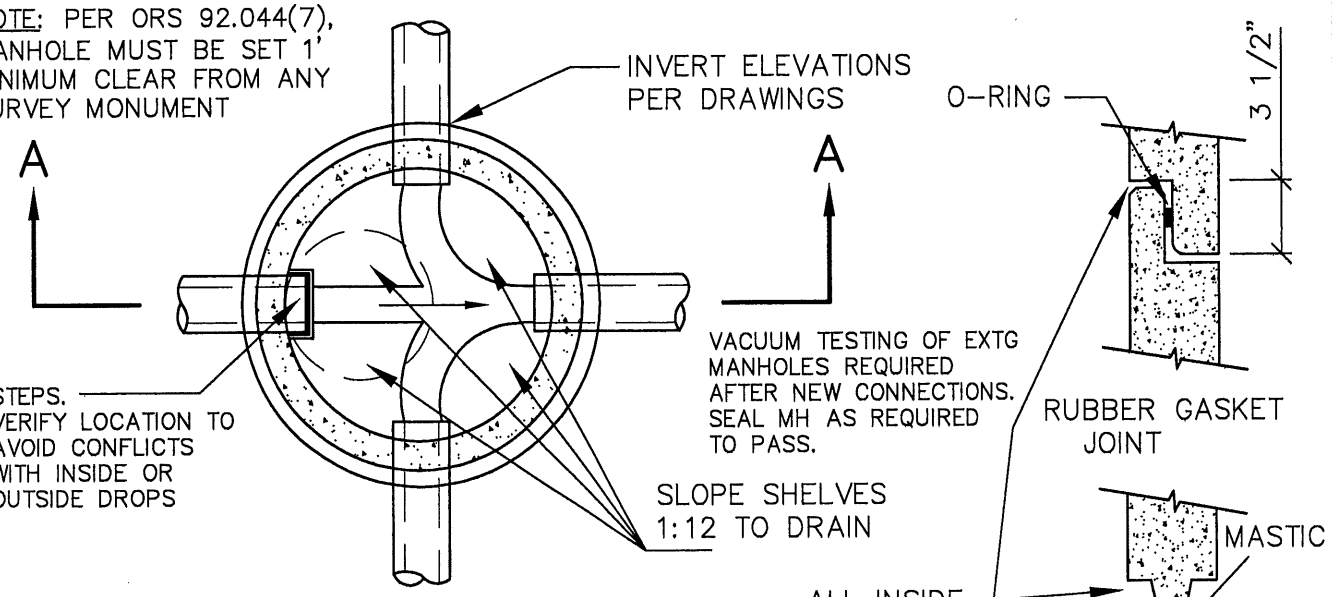

PLAN

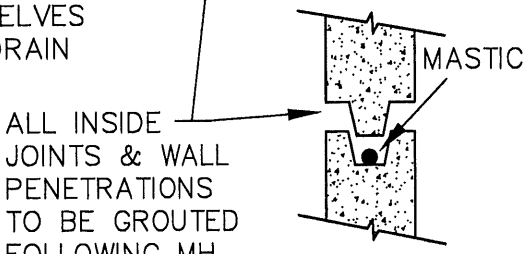

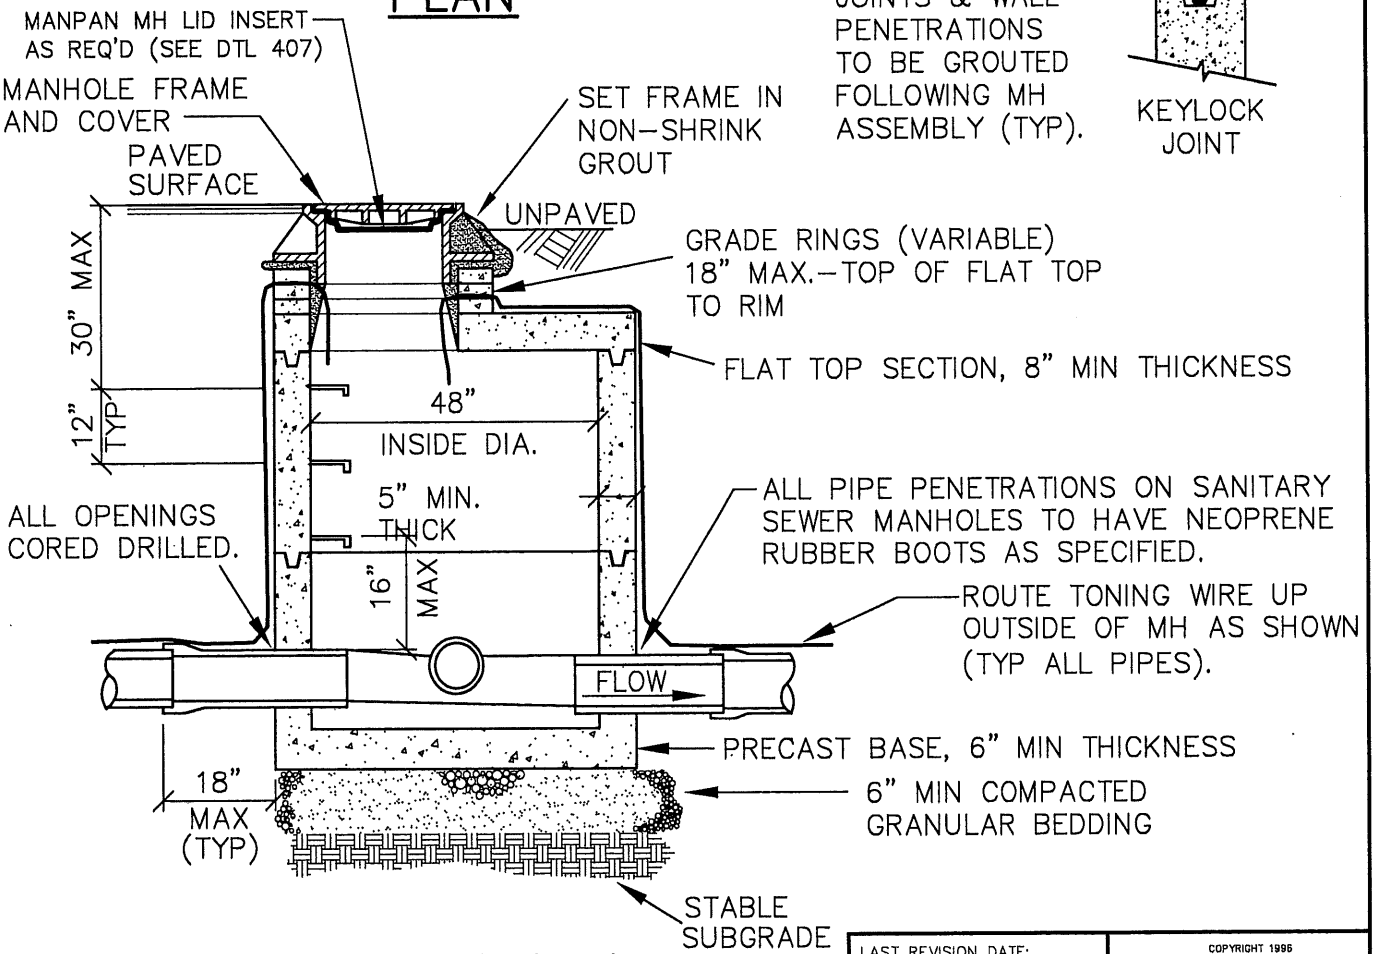

SECTION A-A

NOTES:

1. PRECAST SECTIONS SHALL MEET OR EXCEED ASTM C-478.
2. WATERTIGHT O-RING OR MASTIC KEYLOCK JOINTS REQUIRED.
3. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD. ADD STEPS TO EXTG CONNECTION MH IF EXTG STEPS ARE ABSENT.

LAST REVISION DATE: DEC 2015	
FLAT TOP MANHOLE FOR 21" PIPE AND SMALLER (NTS)	
PHILOMATH, OR	DETAIL NO. 402

NOTE: PER ORS 92.044(7), MANHOLE MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

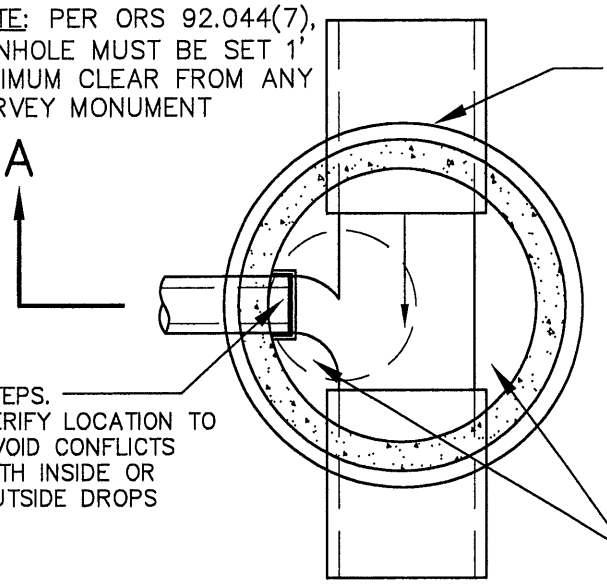

PLAN

VACUUM TESTING OF EXTG MANHOLES REQUIRED AFTER NEW CONNECTIONS. SEAL MH AS REQUIRED TO PASS.

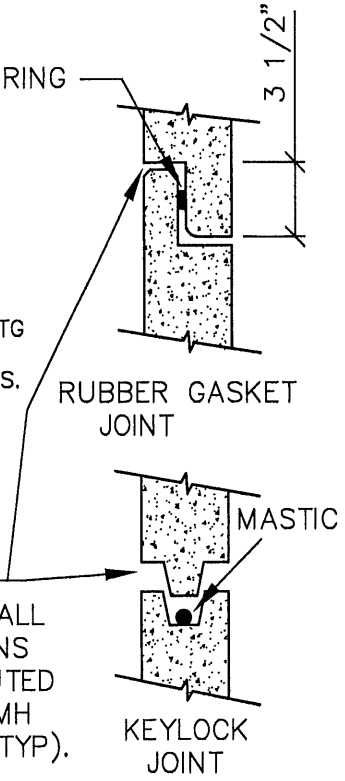

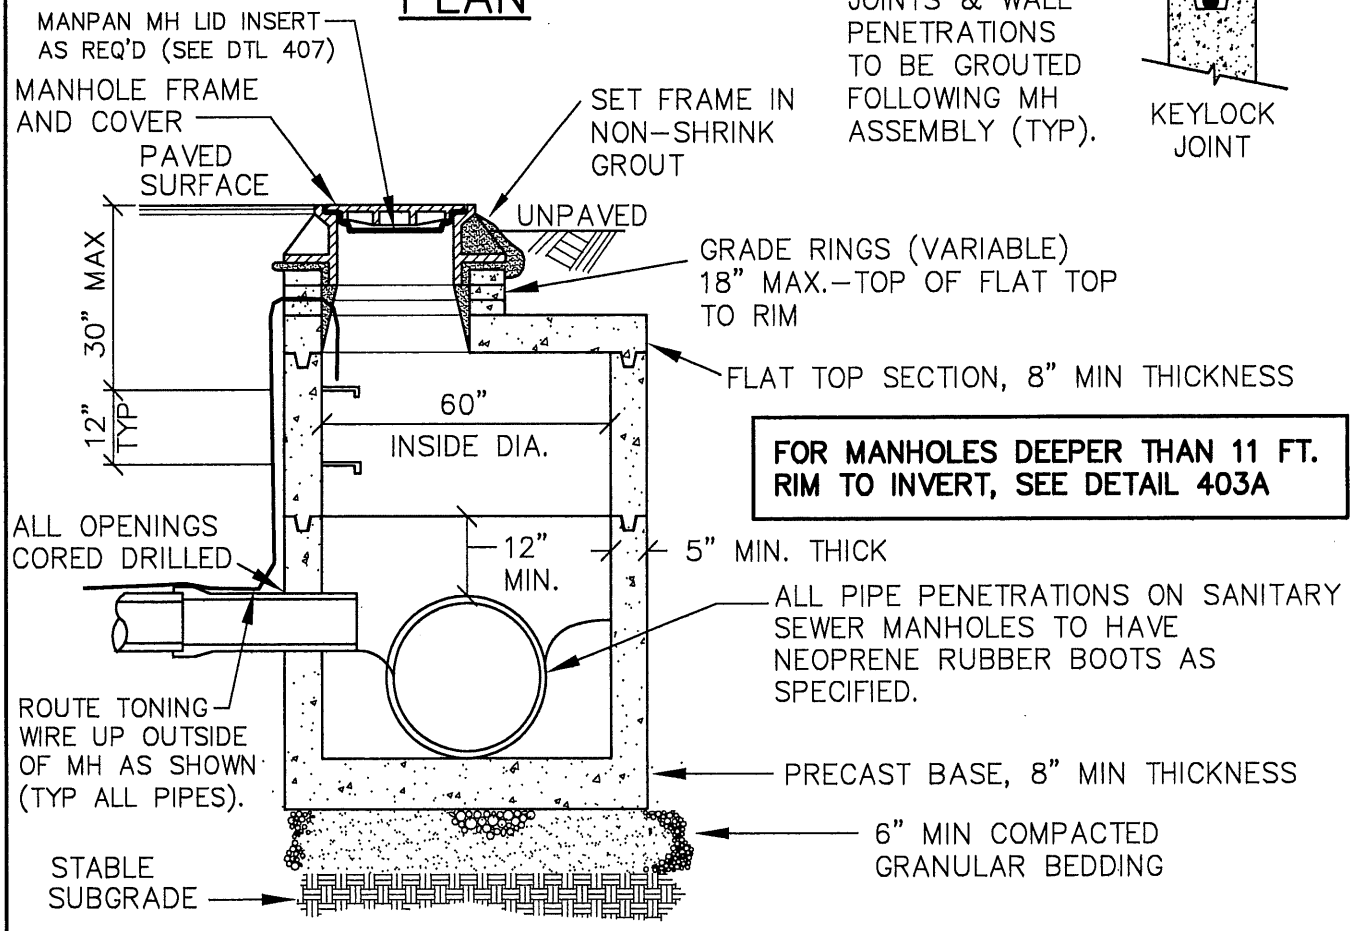

FOR MANHOLES DEEPER THAN 11 FT. RIM TO INVERT, SEE DETAIL 403A

SECTION A-A

NOTES:

1. PRECAST SECTIONS SHALL MEET OR EXCEED ASTM C-478.
2. WATERTIGHT O-RING OR MASTIC KEYLOCK JOINTS REQUIRED.
3. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD. ADD STEPS TO EXTG CONNECTION MH IF EXTG STEPS ARE ABSENT.

LAST REVISION DATE: DEC 2015	
MANHOLE FOR 24" AND 27" PIPE (NTS)	
PHILOMATH, OR	DETAIL NO. 403

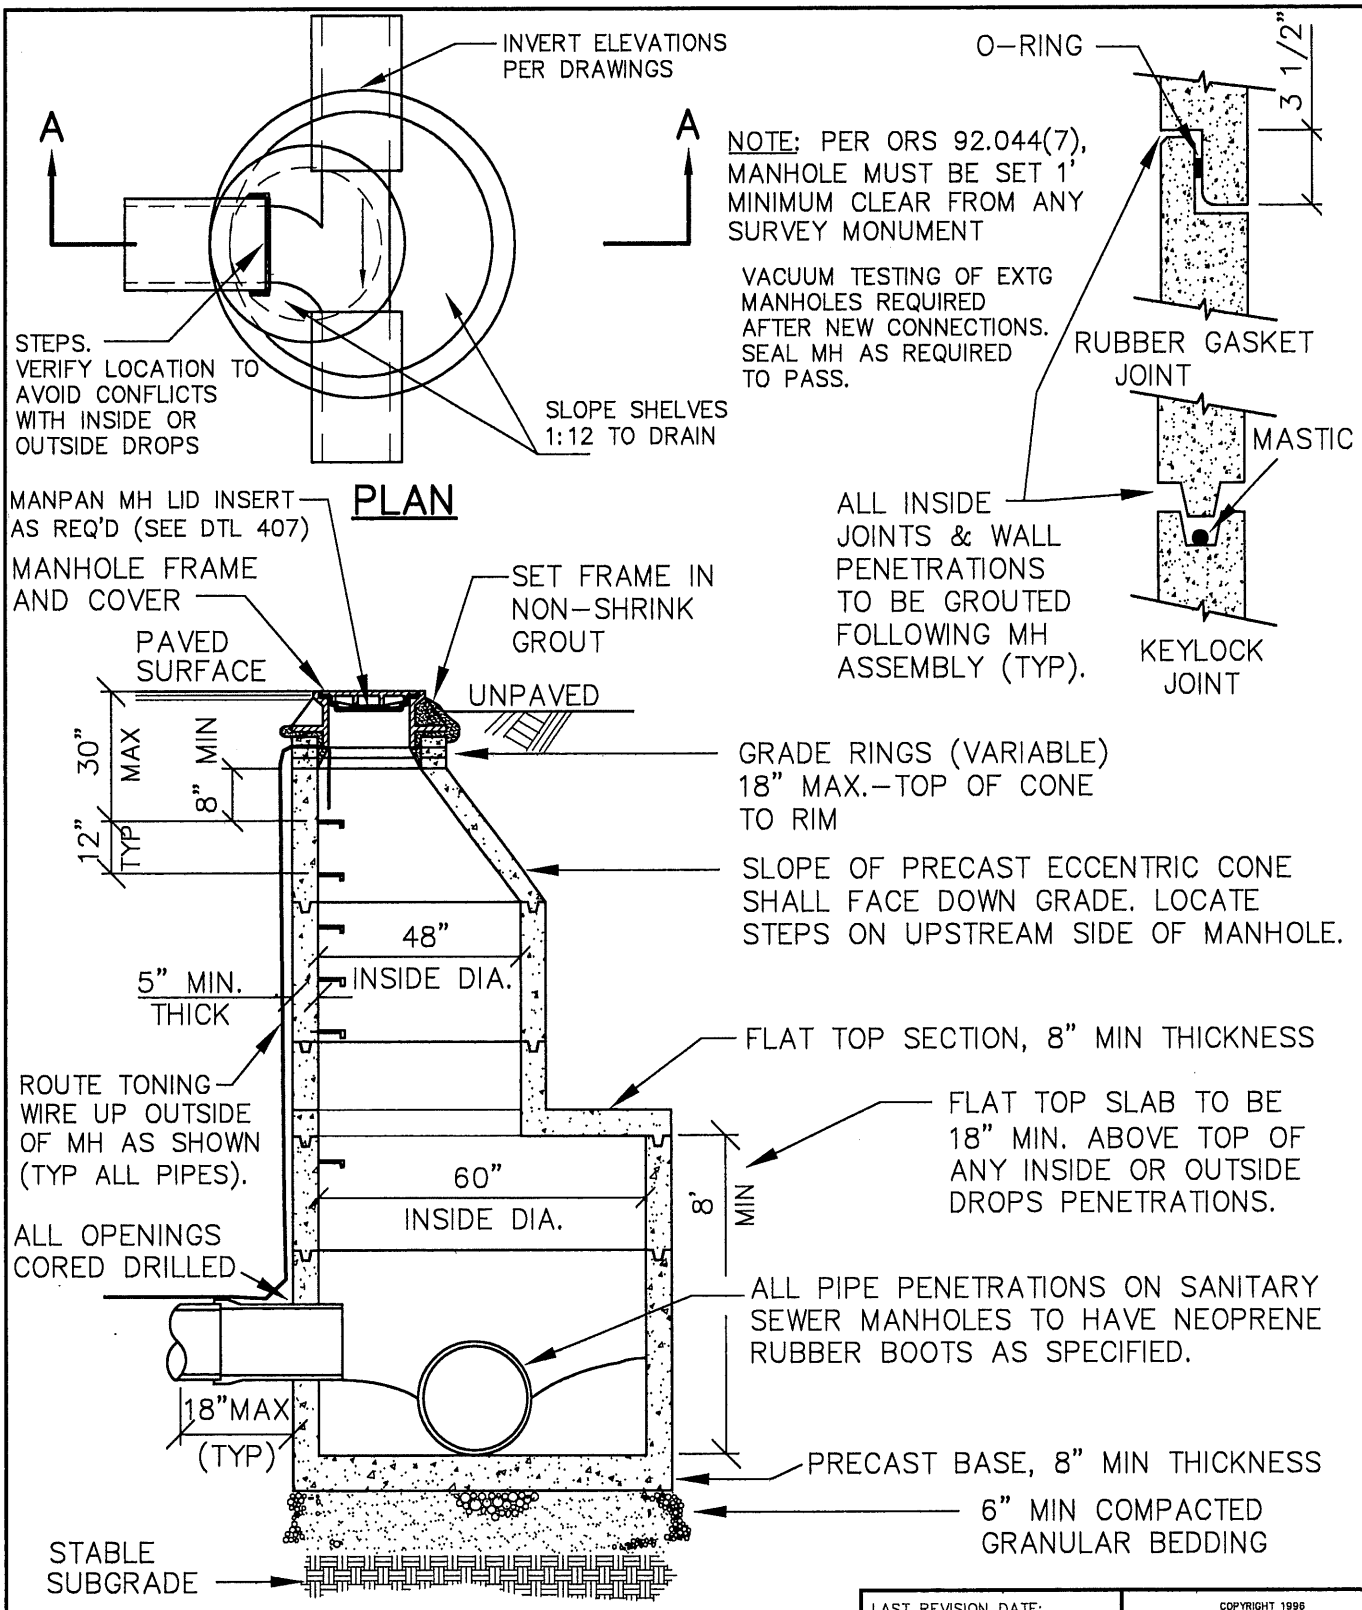

SECTION A-A

NOTES:

1. PRECAST SECTIONS SHALL MEET OR EXCEED ASTM C-478.
2. WATERTIGHT O-RING OR MASTIC KEYLOCK JOINTS REQUIRED.
3. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD. ADD STEPS TO EXTG CONNECTION MH IF EXTG STEPS ARE ABSENT.

LAST REVISION DATE: DEC 2015	
DEEP MANHOLE FOR 24" AND 27" PIPE (NTS)	
PHILOMATH, OR	DETAIL NO. 403A

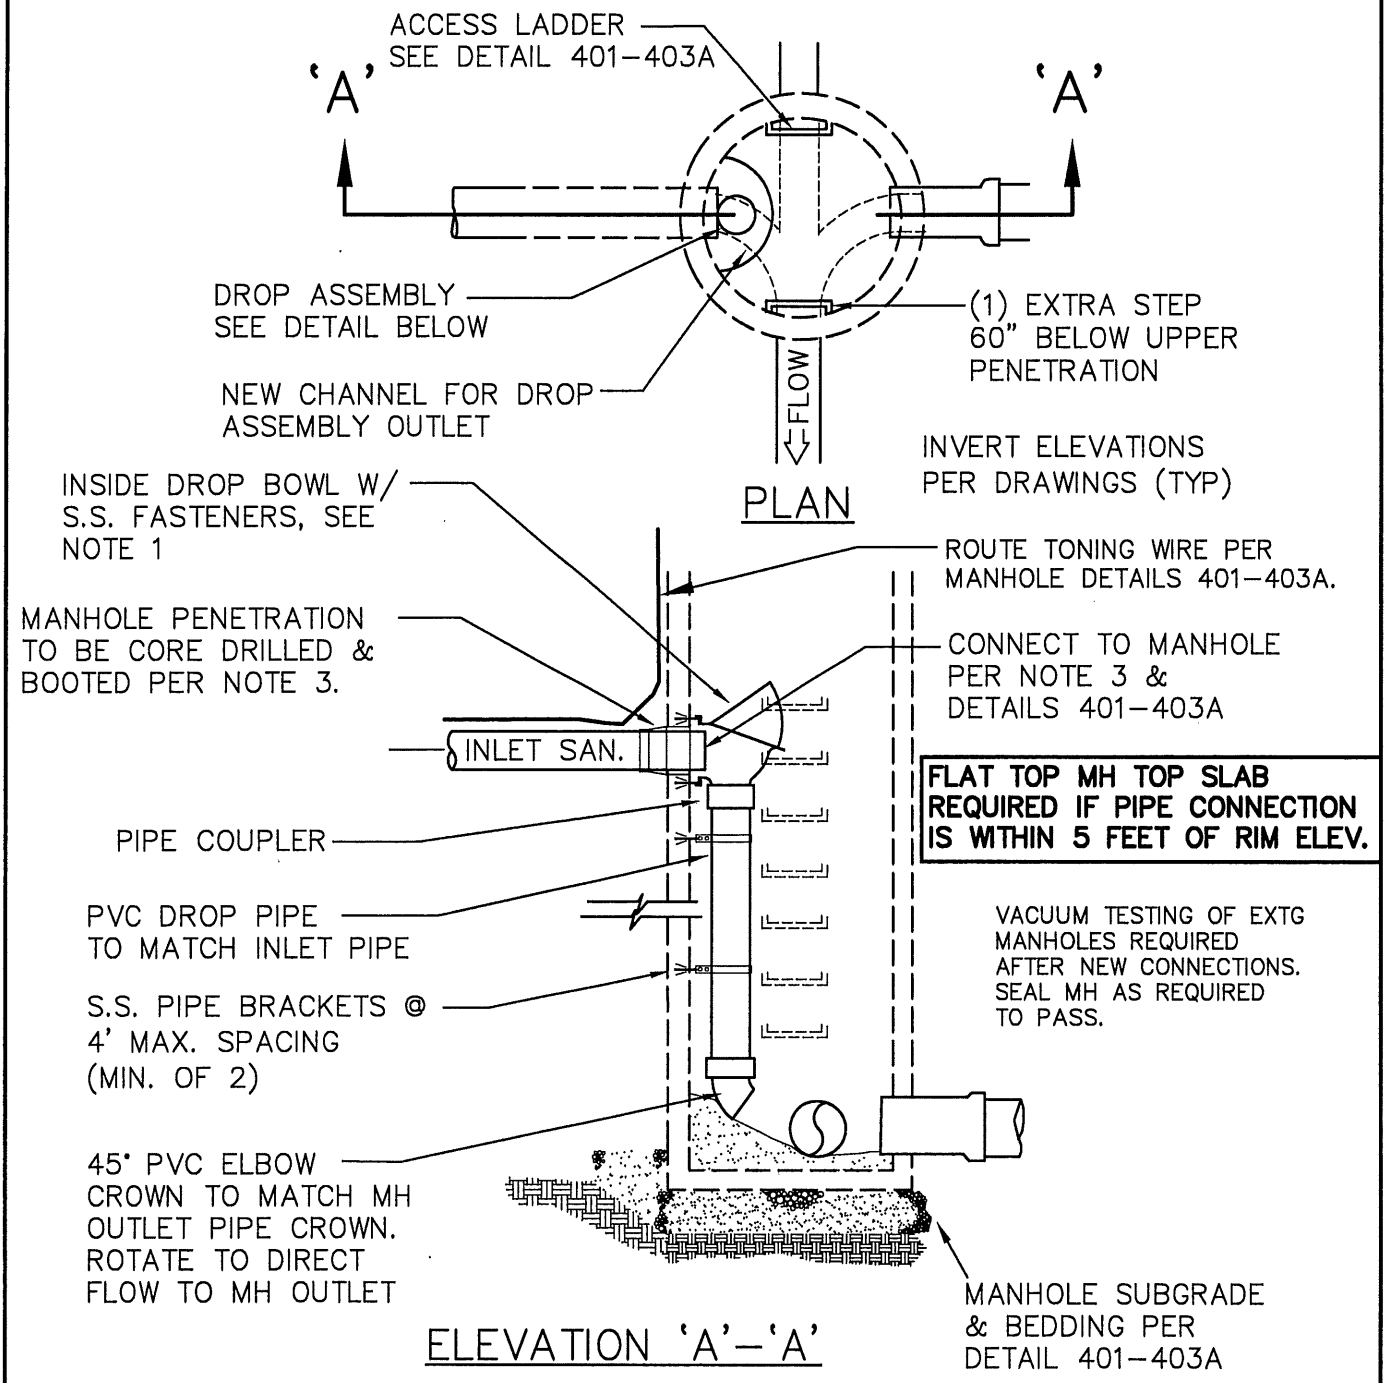

NOTES:

1. ALL INSIDE DROPS MUST BE APPROVED ON A CASE BY CASE BASIS BY THE PUBLIC WORKS SUPERINTENDANT. MINIMUM 60" DIAMETER MANHOLE REQUIRED FOR INSIDE DROPS UNLESS OTHERWISE APPROVED IN WRITING BY THE PUBLIC WORKS SUPERINTENDANT.
2. "RELINER" INSIDE DROP BOWL BY DURAN, INC. OR APPROVED EQUIVALENT. FOR INLET PIPES WITH SLOPES GREATER THAN 5%, PROVIDE BOWL WITH OPTIONAL HOOD.
3. ALL PIPE PENETRATIONS SHALL HAVE NEOPRENE RUBBER BOOTS. MANHOLE BASE, BARREL & TOP TO CONFORM WITH DETAILS 401-403A.
4. STEPS TO BE POLYPROPYLENE PLASTIC WITH GRADE 60 REINFORCING ROD. ADD STEPS TO EXTG CONNECTION MH IF EXTG STEPS ARE ABSENT.

LAST REVISION DATE: JULY 2015	
INSIDE DROP CONNECTION FOR SANITARY SEWER OR STORM MANHOLE (NTS)	
PHILOMATH, OR	DETAIL NO. 404

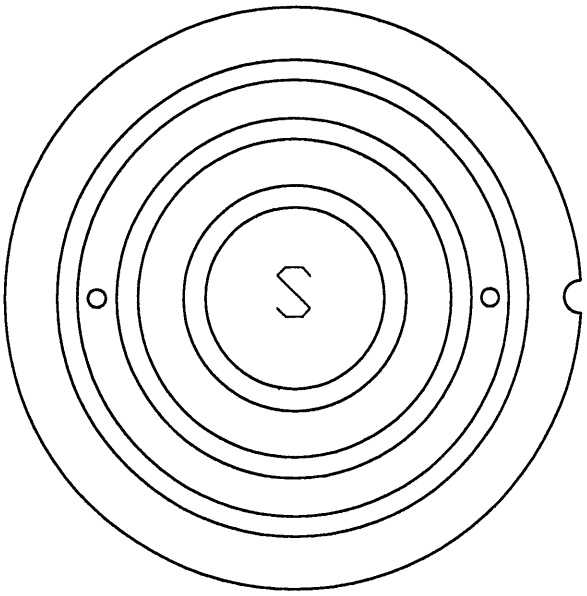

SANITARY

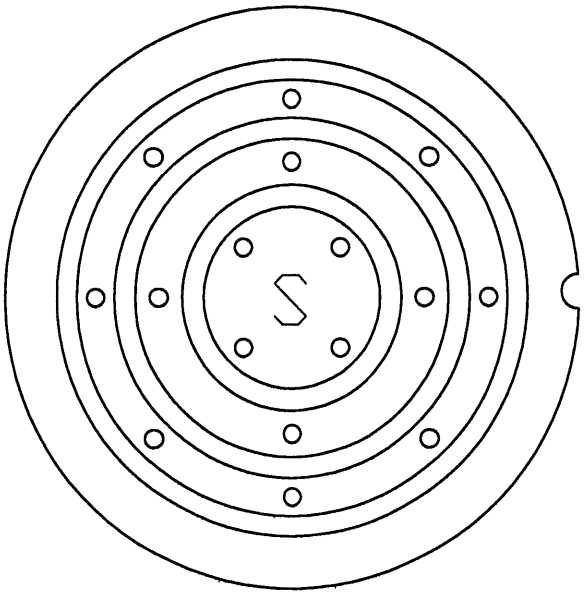

STORM

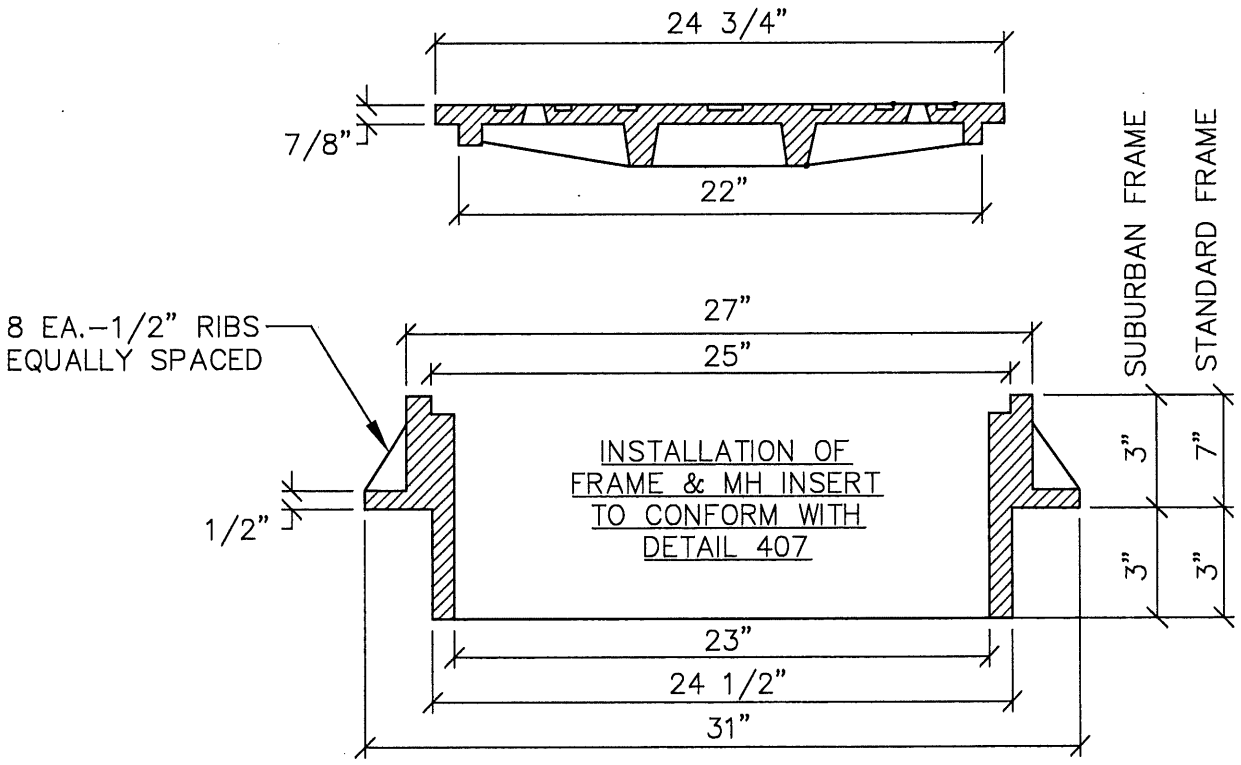

NOTES:

1. COVER AND FRAME SHALL BE GRAY CAST IRON ASTM A–48, CLASS 30.
2. COVER AND FRAME TO BE MACHINED TO A TRUE BEARING ALL AROUND.
3. NOTCH LID FOR LIFTING HOOK.

LAST REVISION DATE: DEC 2015	
MANHOLE FRAME AND COVER (STANDARD AND SUBURBAN) (NTS)	
PHILOMATH, OR	DETAIL NO. 405

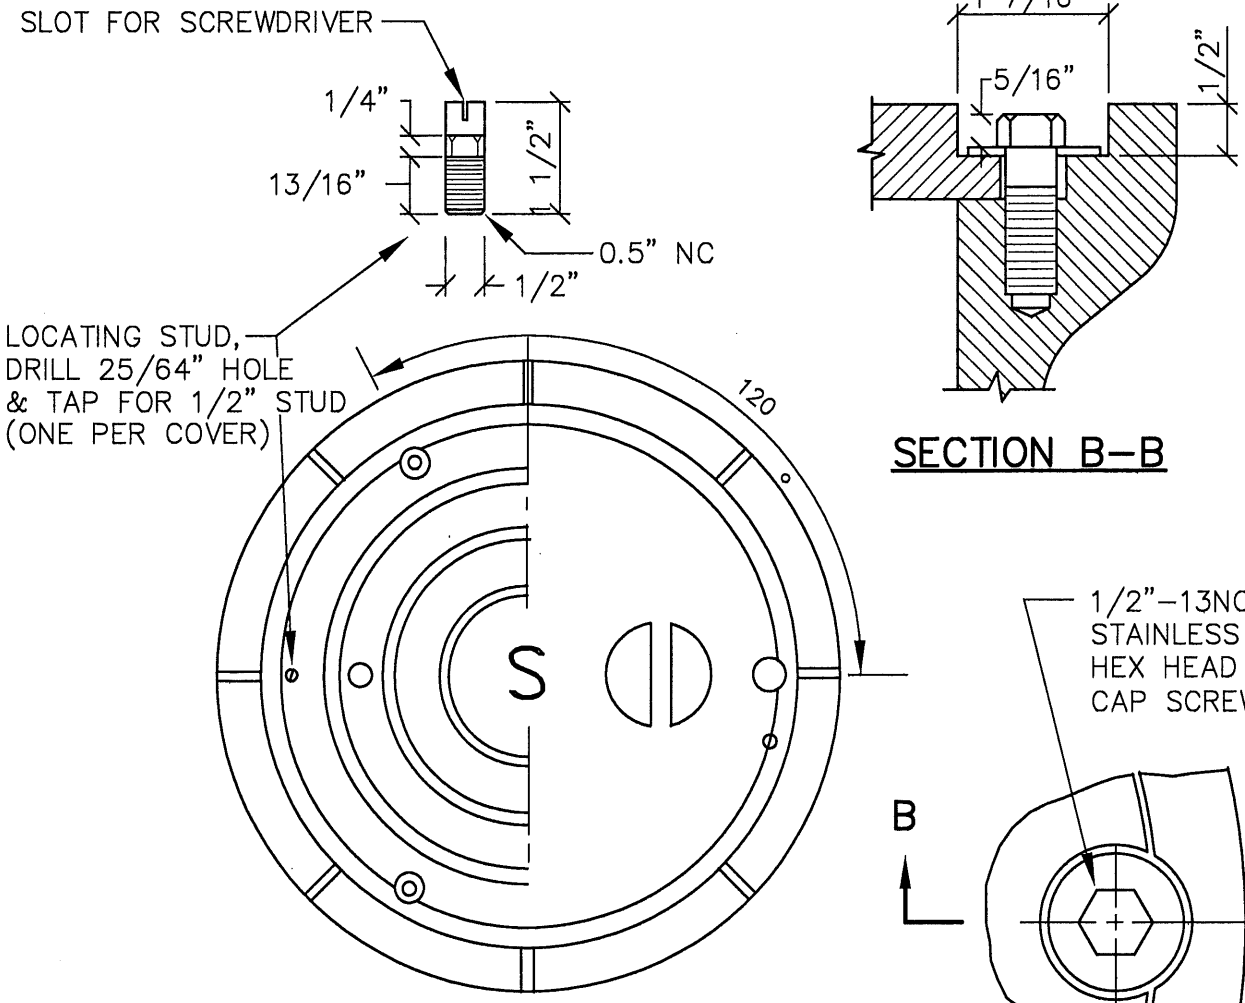

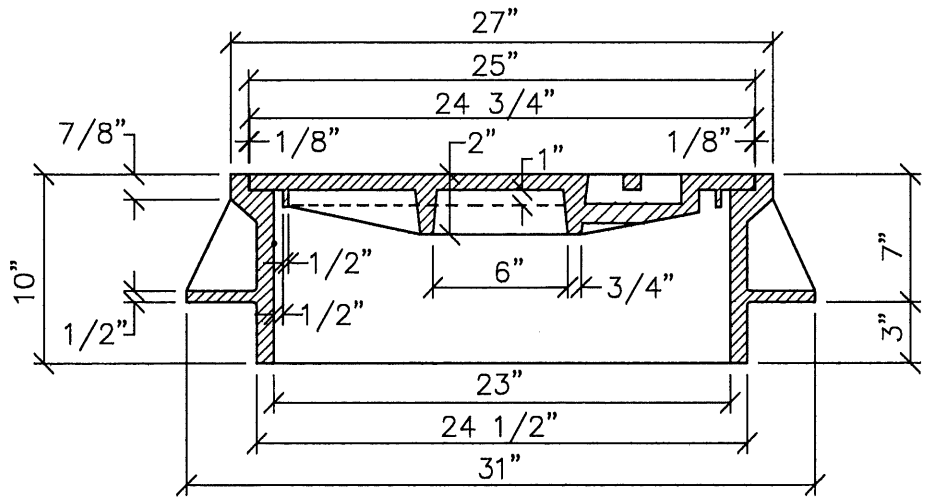

SECTION A–A

INSTALLATION OF FRAME & MH INSERT TO CONFORM WITH DETAIL 407

NOTES:

1. COVER AND FRAME TO BE MACHINED TO A TRUE BEARING ALL AROUND.
2. MATERIAL SHALL BE OF GRAY CAST IRON, ASTM A–48, CLASS 30.
3. LOCKDOWN FRAME & COVER SHALL BE USED ONLY WHERE SPECIFICALLY REQUIRED BY PUBLIC WORKS.

LAST REVISION DATE: DEC 2015	
LOCKDOWN MANHOLE FRAME AND COVER (NTS)	
PHILOMATH, OR	DETAIL NO. 406

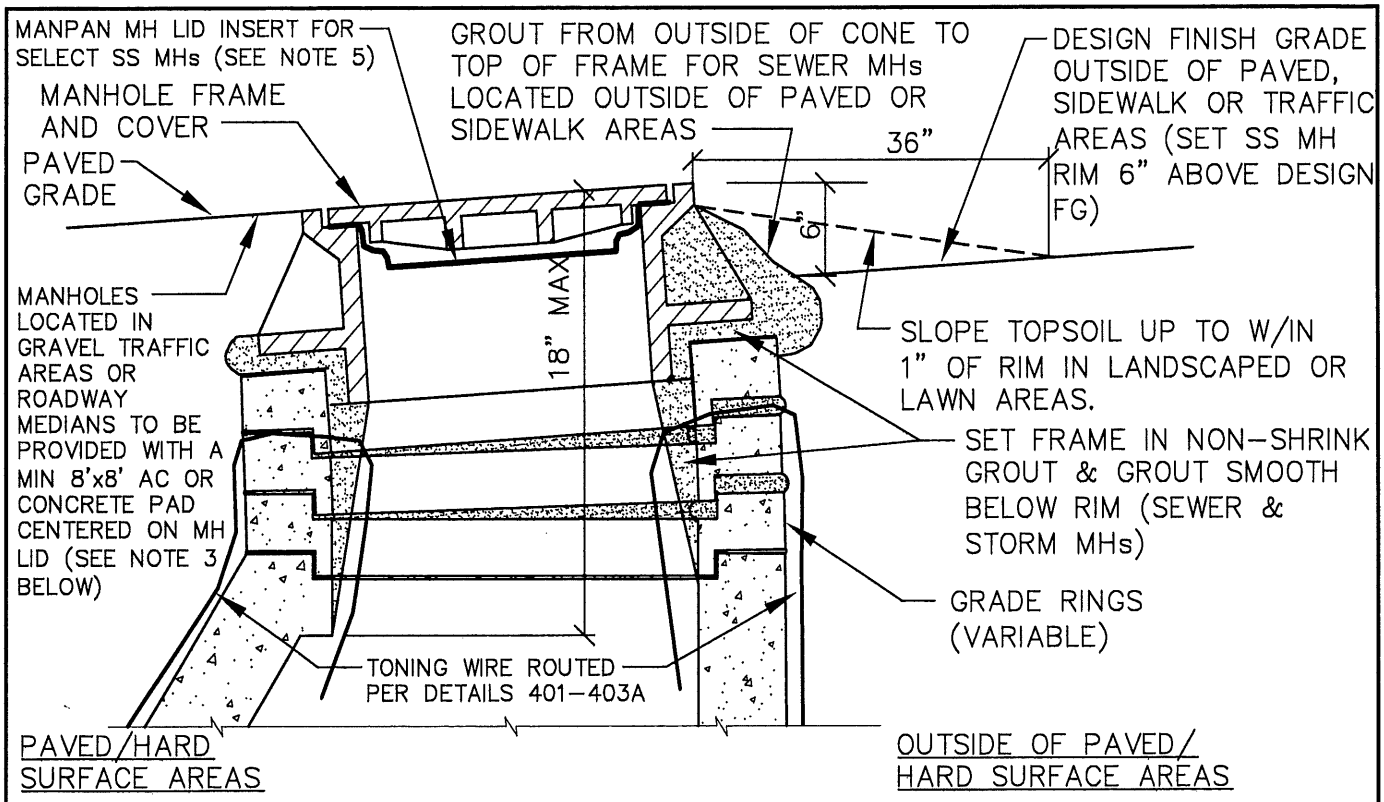

TYPICAL MANHOLE GRADE ADJUSTMENT

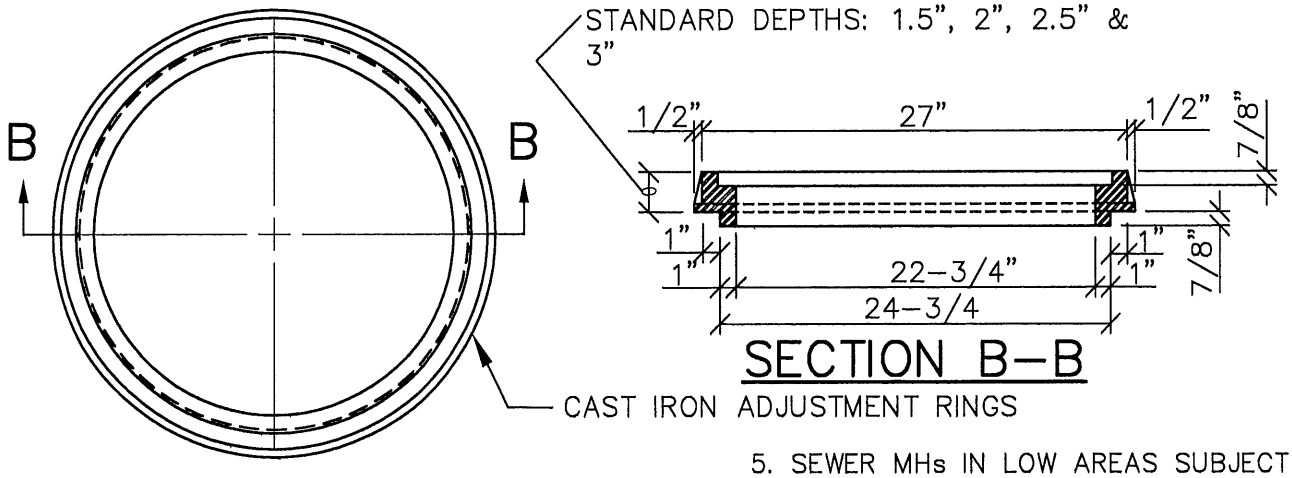

SECTION B-B

MANHOLE ADJUSTMENT RINGS FOR RESURFACING ONLY

NOTES:

1. CAST IRON ADJUSTMENT RINGS ALLOWED ONLY WITH OVERLAYS AND NOT ON NEW MANHOLES. MAXIMUM 1 ADJUSTMENT RING PER MANHOLE.
2. SANITARY SEWER MHs – 2 HOLE LIDS
   STORM DRAIN MHs – 16 HOLE LIDS
3. MH PADS IN UNPAVED TRAFFIC AREAS – 8'x8' MIN SIZE OF (A) 3" MIN. AC OVER 10" COMPACTED BASEROCK (OR PUBLIC ROAD STANDARD THICKNESS IF LOCATED IN R.O.W), OR (B) 8" CONCRETE OVER 2" BACKROCK.
4. MH PADS IN ROAD MEDIAN PLANTER AREAS – 4" CONC (PER DTL 212, 10' MIN SQUARE W/5' SCORING PATTERN).
5. SEWER MHs IN LOW AREAS SUBJECT TO FLOODING OR WATER PONDING (SEE CITY STANDARD CONSTRUCTION NOTES FOR LOCATION CRITERIA) SHALL BE PROVIDED WITH INFLOW PROTECTOR LID INSERTS (MAN PAN OR EQUAL).

LAST REVISION DATE: DEC 2015	JO #
MANHOLE RIM ADJUSTMENT DETAILS (NTS)	
PHILOMATH, OR	DETAIL NO. 407

CLEANOUT COVERS: ALL SEWER CLEANOUT LIDS TO READ "SEWER"
ALL STORM CLEANOUT LIDS TO READ "STORM" OR "C/O".

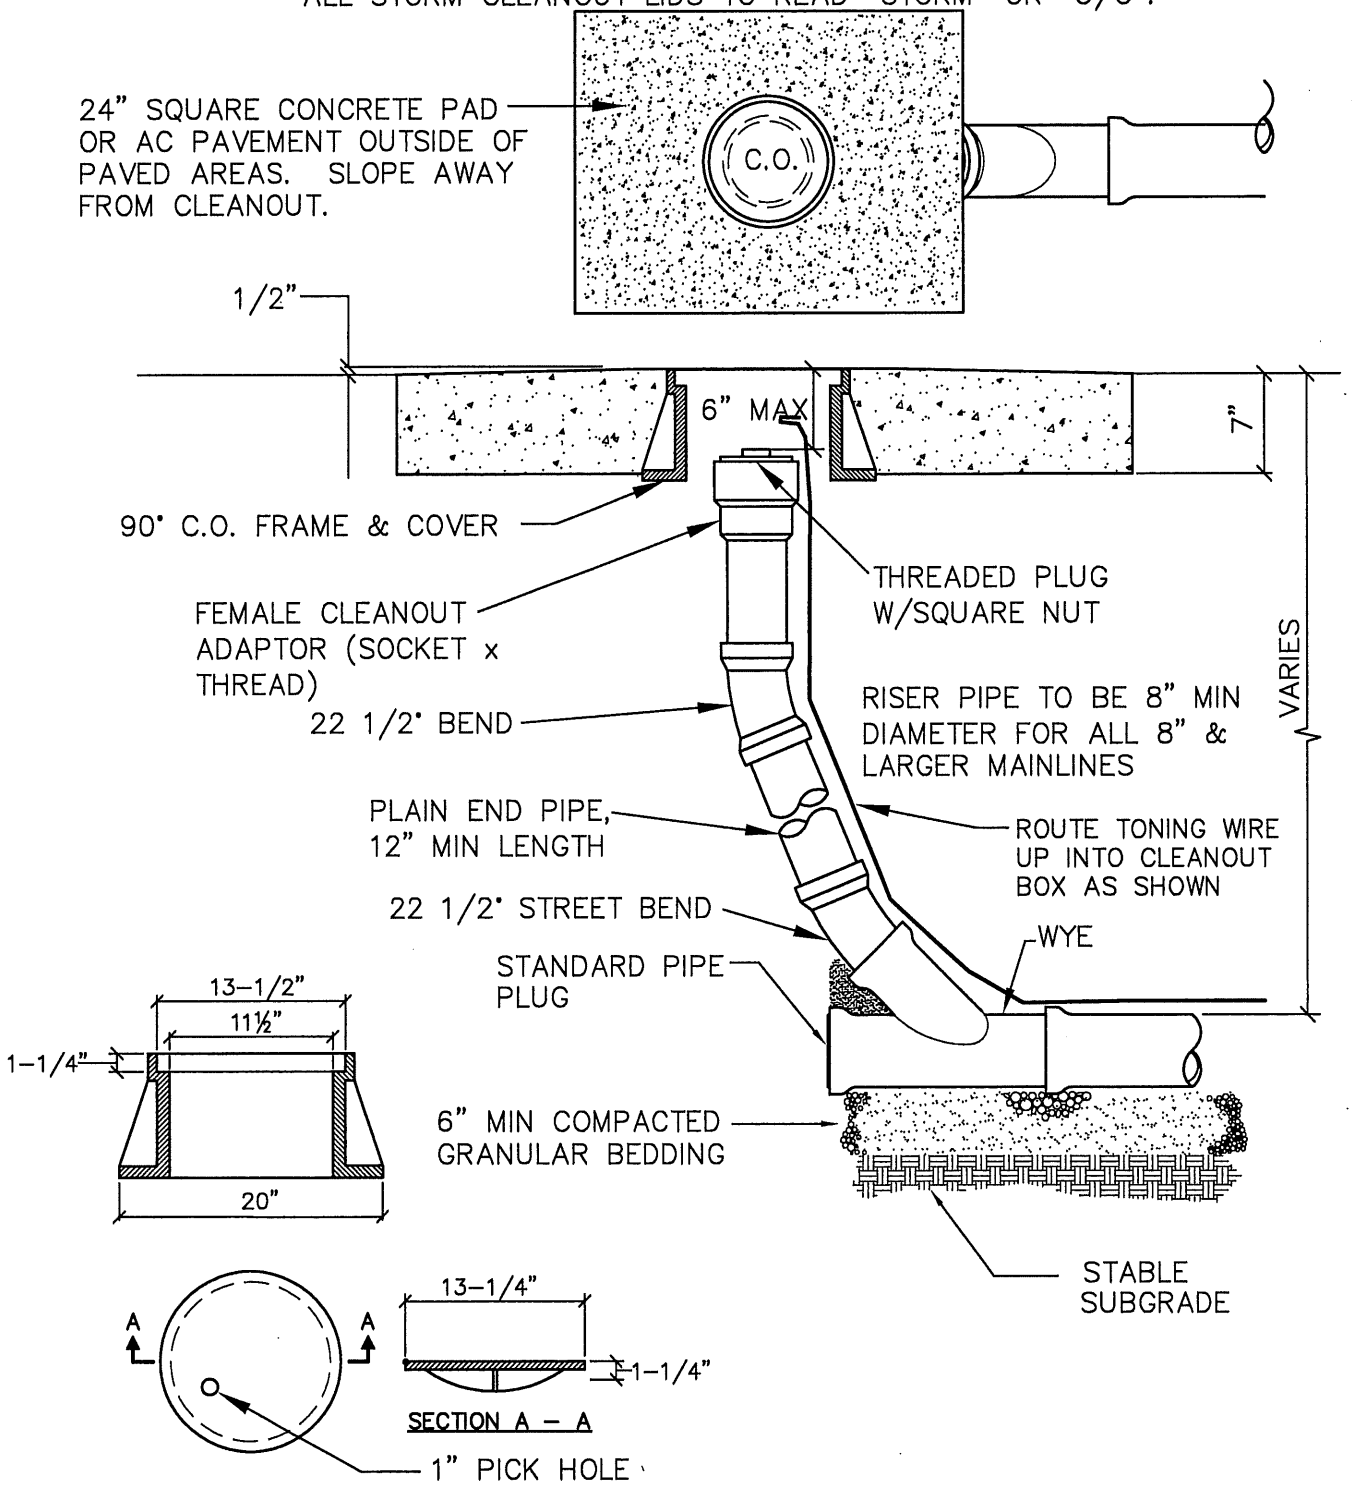

CLEANOUT FRAME & COVER

NOTES:

1. USE OLYMPIC FOUNDRY MODEL M1035 FRAME & COVER IN ALL AREAS.
2. COVER AND FRAME SHALL BE GRAY CAST IRON ASTM A-48, CLASS 30.
3. COVER AND FRAME TO BE MACHINED TO A TRUE BEARING ALL AROUND.

LAST REVISION DATE: JULY 2015	
MAINLINE CLEANOUT (NTS)	
PHILOMATH, OR	DETAIL NO. 410A

NOTE: NO VERTICAL OR HORIZONTAL BENDS GREATER THAN 22-1/2° WITHIN RIGHT-OF-WAY OR PUBLIC UTILITY EASEMENT (IE. FROM MAINLINE WYE TO CLEANOUT).

NOTE: PER ORS 92.044(7), SERVICE LINES MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

PRESSURE TREATED 2" X 4" WIRED TO INVERT AND EXTENDING ABOVE FINISH GRADE. STAKE SHALL BE CONTINUOUS AND REMAIN VERTICAL AFTER BACKFILLING. END SHALL BE PAINTED & LABELED (WHITE FOR SEWER) (GREEN FOR STORM), AND LABELED WITH DEPTH TO PIPE. EXTEND TONING WIRE TO SURFACE.

STAMP 2" TALL "S" OR "D" IN TOP OF CURB & GUTTER PAN AT POINT OF CROSSING.

NOTES:

1. MIN. 18" SEPARATION BETWEEN ADJACENT LATERALS.
2. ONE FULL LENGTH OF PVC PIPE (AT CROSSING) REQUIRED FOR ALL SEWER LATERALS WHICH CROSS UNDER WATER LINES WITH LESS THAN 18" MINIMUM VERTICAL CLEARANCE BETWEEN WATER LINE AND SERVICE LATERAL.
3. SERVICE SHALL NOT BE BACKFILLED PRIOR TO INSPECTION BY PUBLIC WORKS.
4. INSTALL A CONTINUOUS 12 GUAGE SOLID CORE GREEN INSULATED TRACER WIRE FROM MAINLINE WIRE TO END OF LATERAL.

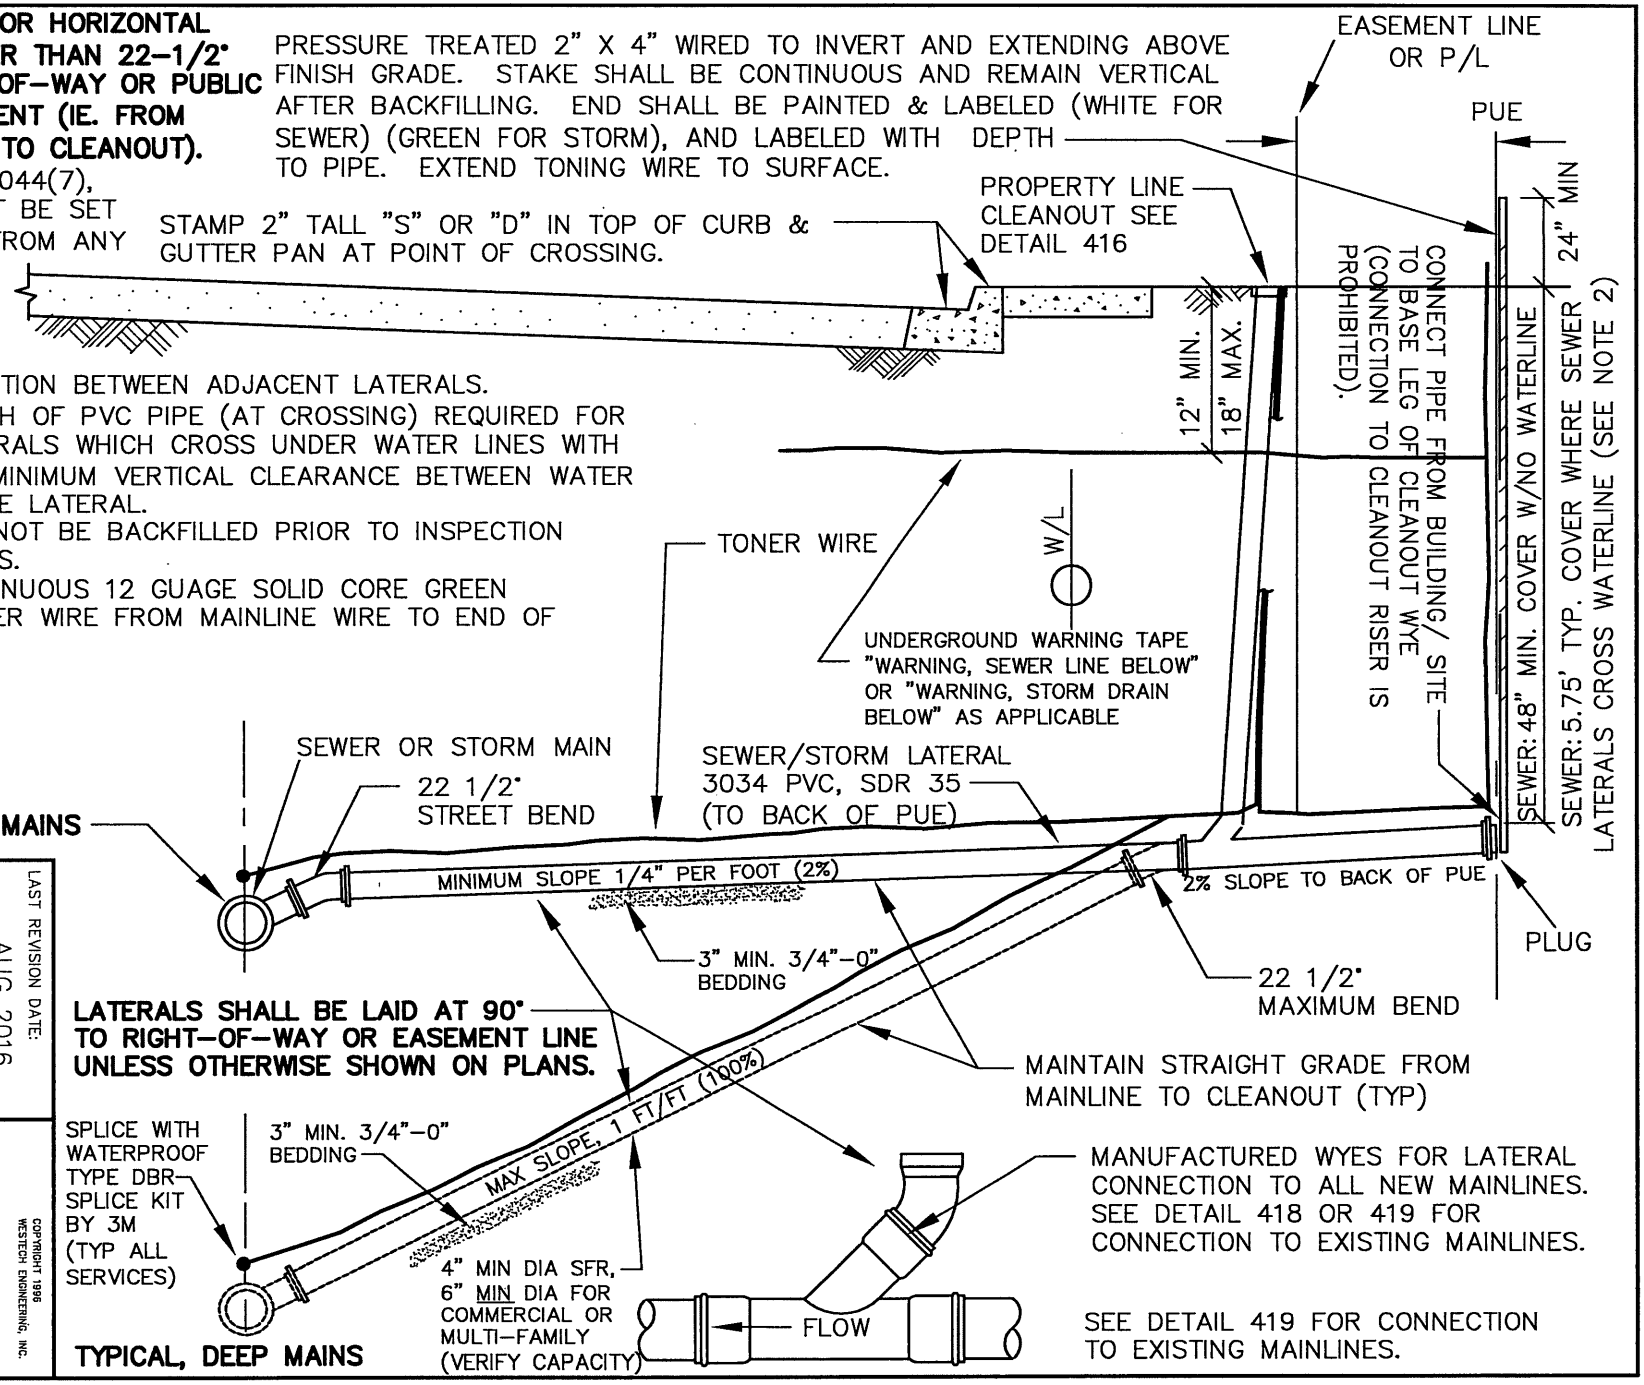

PHILOMATH, OR

(NTS)

SEWER AND STORM SERVICE LATERALS

LAST REVISION DATE: AUG 2016

DETAIL NO. 415

CLEANOUT COVERS: ALL SEWER CLEANOUT LIDS TO READ "SEWER"
ALL STORM CLEANOUT LIDS TO READ "STORM" OR "C/O".

1. NON-TRAFFIC AREAS:
   CARSON MODEL 910 T-COVER OR EQUAL (GREEN FOR SEWER, GREY FOR STORM).
2. TRAFFIC AREAS, INCLUDING DRIVEWAYS:
   8" X 4" CAST IRON FRAME & COVER, OLYMPIC M1007 OR EQUAL.
   8" X 6" CAST IRON FRAME & COVER, OLYMPIC M1018 OR EQUAL.
   (FOR CI CLEANOUTS IN UNPAVED AREAS, SET IN 6" THICK CONCRETE PAD)

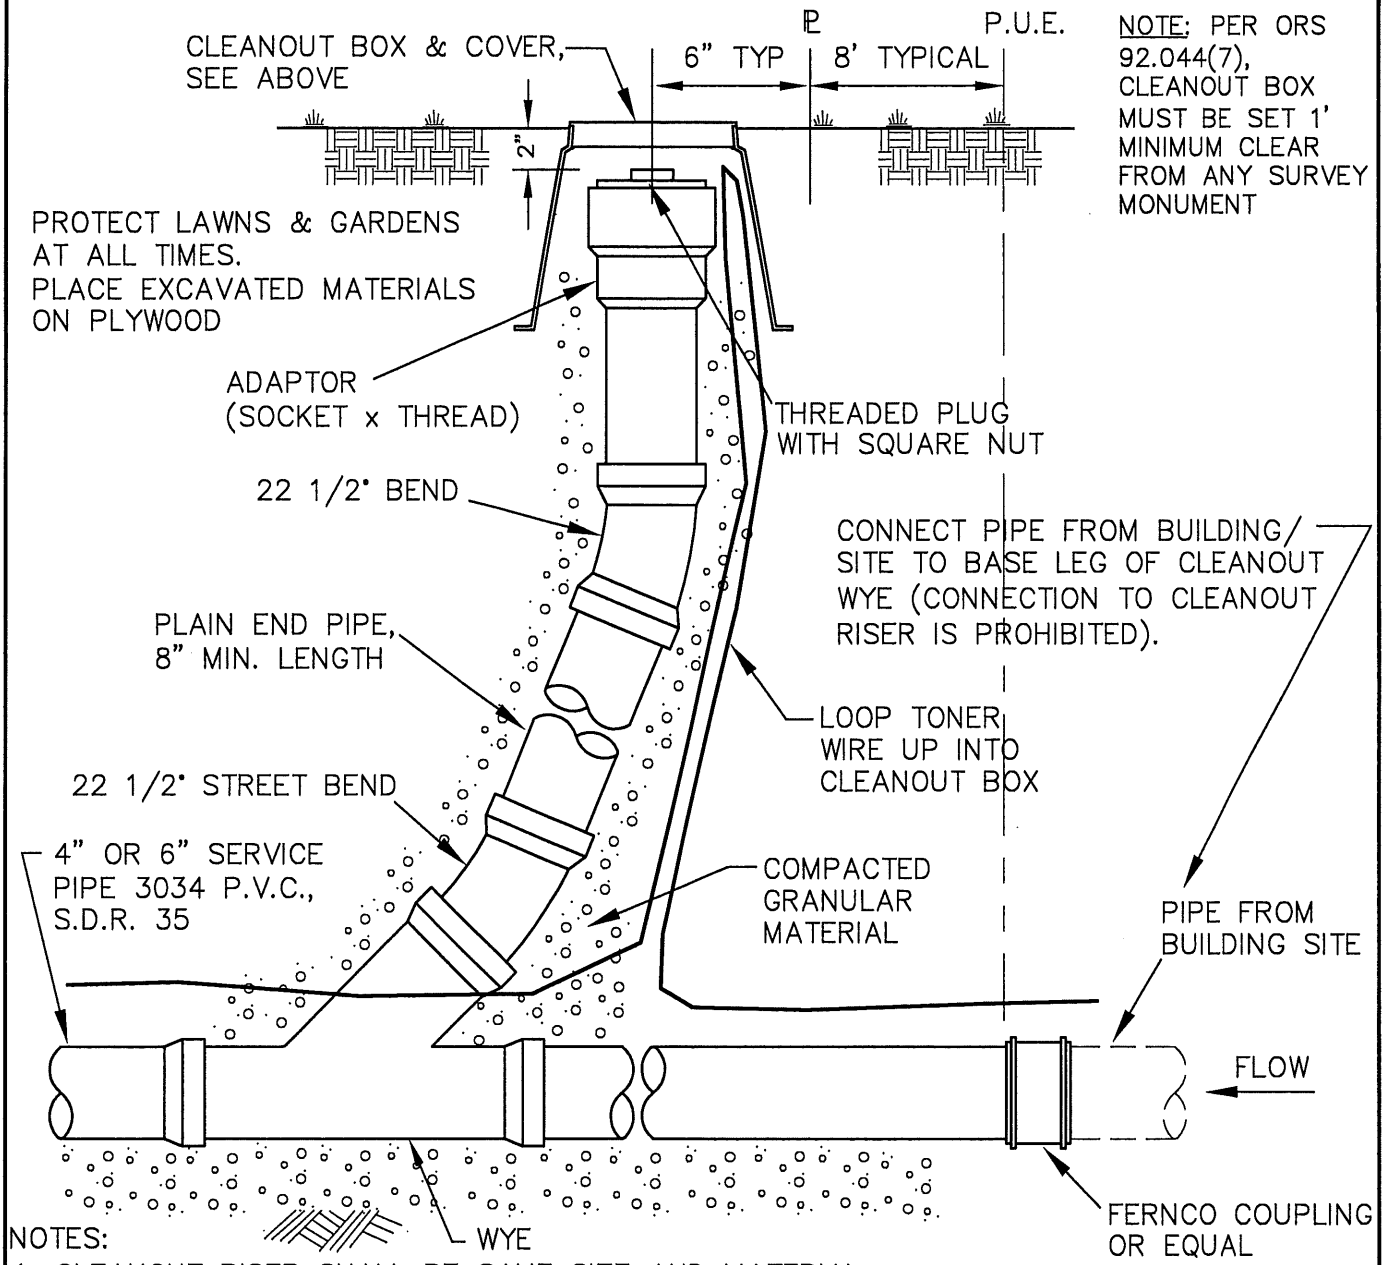

NOTES:

1. CLEANOUT RISER SHALL BE SAME SIZE AND MATERIAL AS LATERAL PIPE.
2. PROVIDE CASTING FOR CLEANOUTS LOCATED IN DRIVEWAYS OR TRAFFIC AREAS (CONCRETE PAD TO BE 6" LARGER THAN TOP OF CLEANOUT BOX).
3. CLEANOUT PIPE SHALL BE LEFT A MINIMUM OF 18" ABOVE EXISTING GRADE UNTIL ALL CURBING IS INSTALLED AND ALL PRIVATE UTILITY TRENCHES ARE BACKFILLED. CLEANOUTS SHALL THEN BE SET NO MORE THAN 6" BELOW FINISH GRADE, AND CLEANOUT BOXES SET FLUSH WITH FINISH GRADE.

LAST REVISION DATE: AUG 2016	
STANDARD SERVICE LATERAL CLEANOUT (SEWER & STORM) (NTS)	
PHILOMATH, OR	DETAIL NO. 416

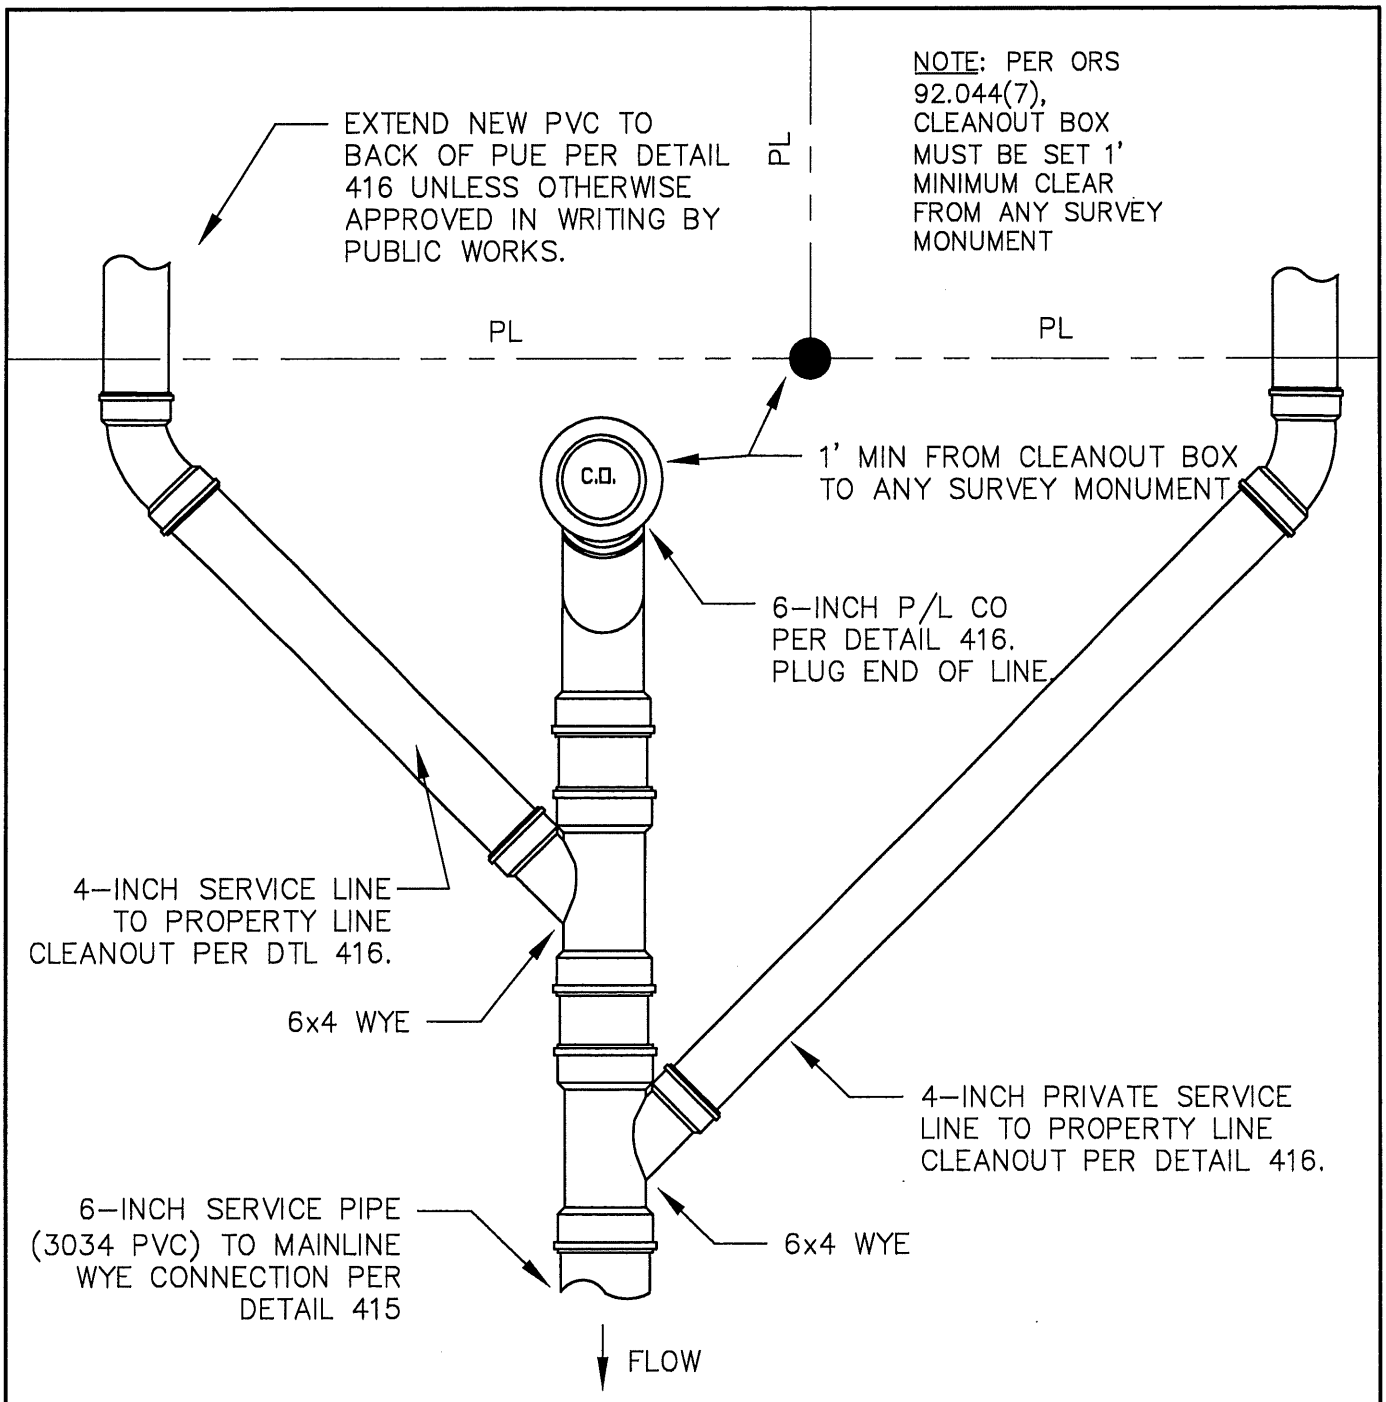

NOTES:

1. SEE DETAIL 415 FOR CONNECTION OF 6-INCH COMMON SERVICE LINE TO MAIN, AND DETAIL 416 FOR CONFIGURATION OF PROPERTY LINE CLEANOUTS (ONE 6-INCH & TWO 4-INCH CLEANOUTS).
2. PLUG THE P/L END OF THE 6" BASE WYE.
3. CLEANOUT BOX STYLE & CONFIGURATION TO CONFORM WITH DETAIL 416.
4. SERVICE LINES SHALL CONFORM TO OREGON PLUMBING CODE REQUIREMENTS.

LAST REVISION DATE: JAN 2014	
REPLACEMENT COMMON 6-INCH SERVICE LATERAL SERVING 2 PROPERTIES (NTS)	
PHILOMATH, OR	DETAIL NO. 417

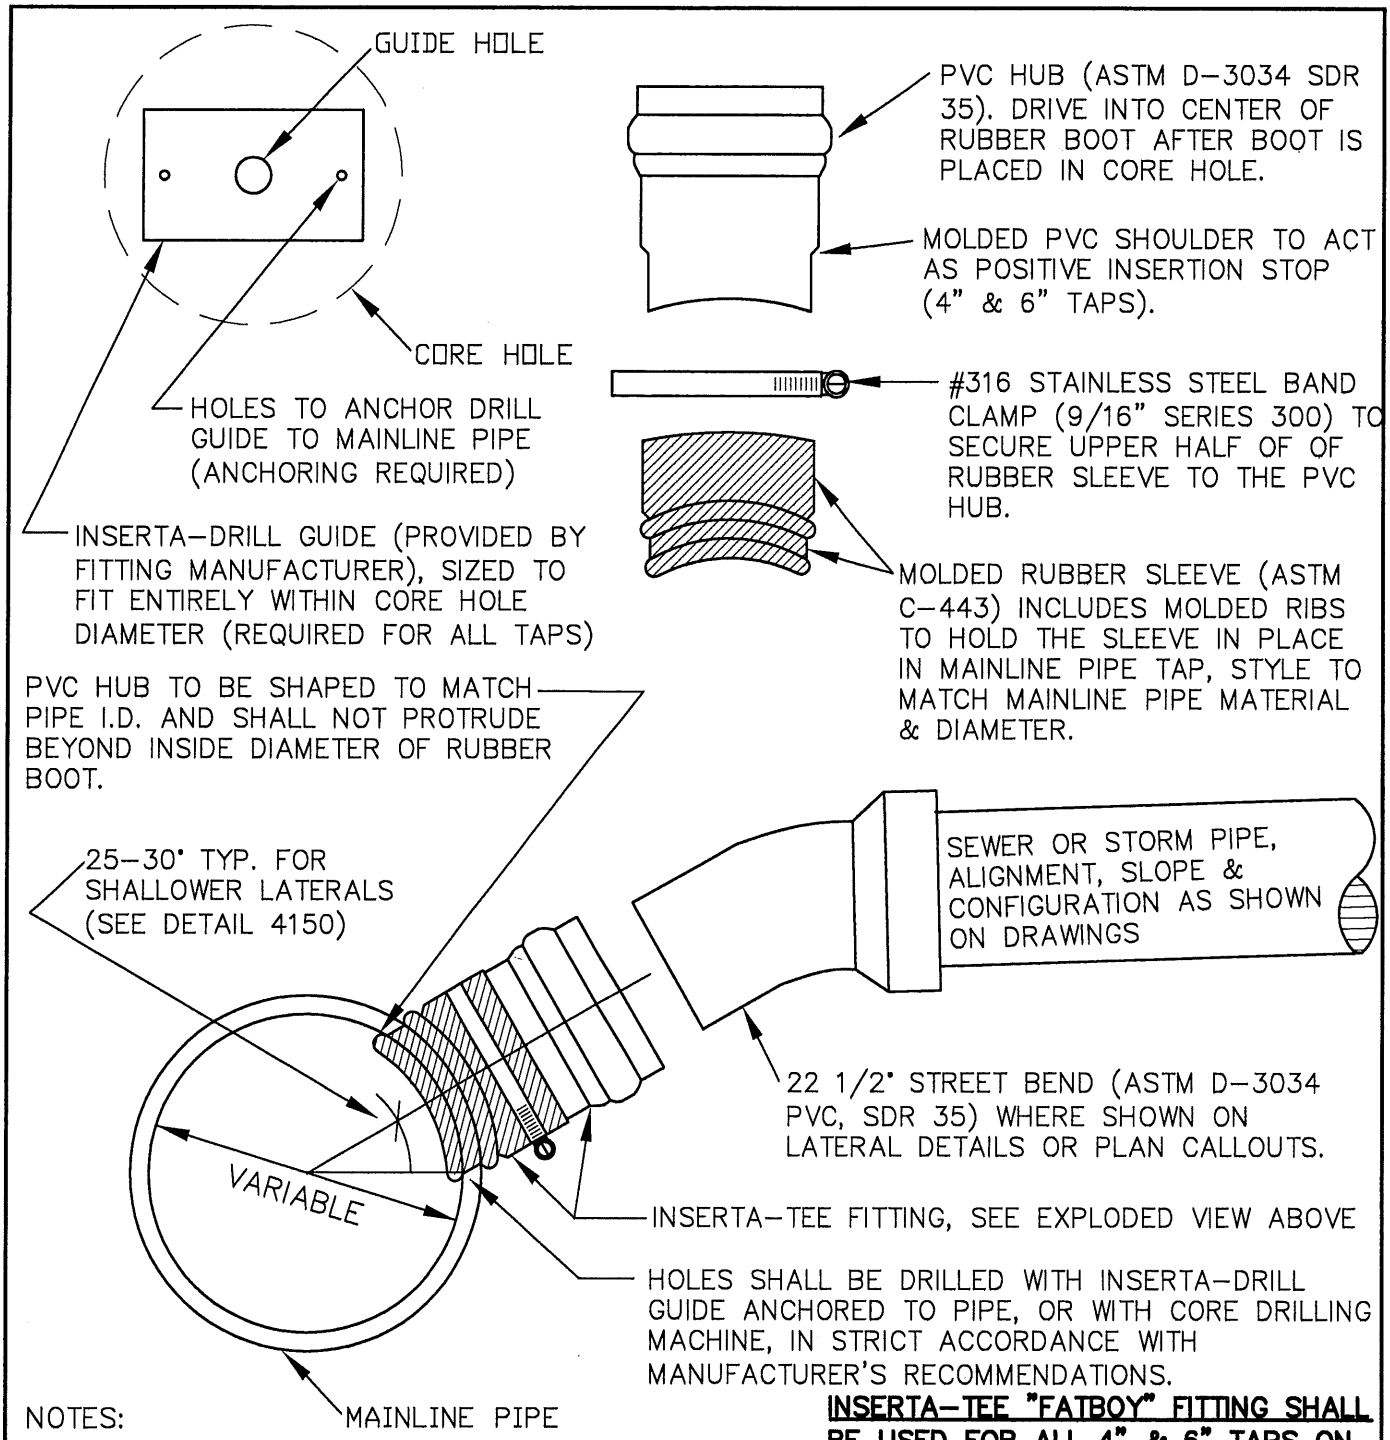

NOTES:

1. EXISTING SANITARY SEWERS – INSERTA-TEES ALLOWED ON EXISTING PVC OR DUCTILE IRON SEWER MAINS. USE ON OTHER PIPE TYPES IS SUBJECT TO CITY APPROVAL AND ACCEPTABLE PIPE CONDITION.
2. EXISTING STORM DRAINS – INSERTA-TEES ALLOWED ON ALL PIPE TYPES, SUBJECT TO CITY APPROVAL AND ACCEPTABLE PIPE CONDITION.
3. NEW MAINLINES – MANUFACTURED FITTINGS (PER DETAIL 415) SHALL BE USED FOR CONNECTION ON ALL NEW SEWER AND STORM MAINLINES.
4. THE TAP SHALL NOT BE MADE EXCEPT IN THE PRESENCE OF A CITY INSPECTOR; NOR SHALL ANY CONNECTION BE MADE WITHOUT PRIOR CITY APPROVAL.
5. CENTERLINE OF TAP SHALL BE ABOVE SPRINGLINE.

INSERTA-TEE "FATBOY" FITTING SHALL BE USED FOR ALL 4" & 6" TAPS ON EXTG PIPE (TV & 95% MANDREL TESTING OF EXISTING MAINLINES AFTER TAP MAY BE REQUIRED AT DISCRETION OF PUBLIC WORKS DIRECTOR).

LAST REVISION DATE:	JO #
DEC 2015	STANDARD

INSERTA-TEE CONNECTION TO EXISTING SEWER OR STORM DRAIN

(NTS)

PHILOMATH, OR	DETAIL NO. 419

MANHOLE VACUUM TEST REPORT

Project Location: (City)	Project Name:
Inspector: (Print)	Date: (Separate Report Required for Each Test Session)
Testing Company: (Name & Phone #)	

Manhole No.	Manhole Diameter (inch)	Manhole Depth (ft)	Surface Restoration Complete?	Time Required[3] (sec)	Time to Drop from 10"" Hg to 9"" Hg (sec)	Results	Comments
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	
			Yes / No			Pass / Fail	

1. All adjacent surface restoration shall be completed prior to conducting manhole acceptance tests, including finish paving and final adjustments to grade. Any test conducted prior to completion of surface restoration shall be considered informal, and will not count for acceptance.

2. The vacuum test head seal shall be inflated in accordance with the manufacturer's recommendations, but in all cases the grade rings and casting shall be included in the test. A vacuum of 10-inches of mercury shall be drawn and the vacuum pump shut off. With the valves closed, the time shall be measured for the vacuum to drop to 9-inches.

3. The manhole shall pass if the time for the vacuum reading to drop to 9-inches meets or exceeds the values indicated on the following table. Times for deeper depths as required by the City Engineer. Note: Visible groundwater infiltration or leakage constitutes a failed test.

REQUIRED MANHOLE VACUUM TEST TIMES

Manhole Depth (feet)	Required Time (sec)		
	48-inch diameter	60-inch diameter	72-inch diameter
8	20	26	33
10	25	33	41
12	30	39	49
14	35	46	57
18	40	52	65
20	45	59	73
22	50	65	81

SANITARY SEWER AIR TEST REPORT

Project Location:	Project Name:
Inspector: (Print)	Date: (Separate Report Required for Each Test Session)
TV Inspection Required? Yes / No	Mandrel Testing Completed? Date Completed or Scheduled:

Station (& Manhole #)		Main/ Lateral	Size & Material	Total Length (ft)	C[1]	K[1]	Test Time (Seconds) for Pressure Drop Shown (psi)			Comments
From	To						Required[2]	4.0 - 3.5	3.5 - 2.5	
		Main								Pass / Fail
		Laterals								
		Totals								
		Main								Pass / Fail
		Laterals								
		Totals								
		Main								Pass / Fail
		Laterals								
		Totals								
		Main								Pass / Fail
		Laterals								
		Totals								

[1] For C and K values, see table and formulas on reverse side.
[2] For total C ≤ 1.0, test time (seconds) required = 2 times K
For total C > 1.0, test time (seconds) required = 2 times (K/C)

TEST PROCEDURE

1. Add air slowly to the portion of the pipe installation under test until the internal air pressure is raised to 4.0 psig (or higher pressure as required to address groundwater). *Increase the test pressure by 0.433 psi for each foot of average ground water depth over the exterior crown of the pipe under test, with the maximum test pressure not to exceed 9.0 psi.*
2. Add air slowly until the internal air pressure is raised to 4.0 psig (or higher pressure as required due to groundwater).
3. After required test pressure is reached, allow 2-minutes minimum for air temperature to stabilize, adding only the amount of air required to maintain pressure.
4. After the temperature stabilization period, disconnect the air supply.
5. Record the time required for the internal air pressure to drop from 3.5 psi (or higher as required due to groundwater backpressure) to 2.5 psi (or higher as required due to groundwater backpressure). If this time exceeds the required time (or if there is less than 1.0 psi pressure drop), the test is successful.

ACCEPTANCE: The tested sewer section shall be considered acceptable if the pressure drop during the test time is less than 1.0 psi from the starting pressure.

SEWER AIR TEST C AND K VALUES

Pipe Size (inch)	C-Value[1] per foot length	K-Value[2] per foot length
4	0.00155	0.176
6	0.00233	0.396
8	0.00311	0.704
10	0.00388	1.100
12	0.00466	1.584
15	0.00582	2.475
18	0.00699	3.564
21	0.00815	4.851

[1] $C = 0.0003882dL$ Where d = diameter (inches)
[2] $K = 0.011d^2L$ L = Length (ft)

Example:

Air Test a system consisting of two mainline segments as follows:
Segment 1: 395 feet of 8-inch mainline, 100 feet of 4-inch laterals, and 35 feet of 6 inch laterals.
Segment 2: 200 feet of 8-inch mainline, 30 feet of 4-inch laterals, and 20 feet of 6 inch laterals.

Station (& Manhole #)		Main/ Lateral	Size & Material	Total Length (ft)	C[1]	K[1]	Test Time (Seconds) for Pressure Drop Shown (psi)			Comments
From	To						Required[2]	4.0 - 3.5	3.5 - 2.5	
0+00 MH A1	3+95 MH A2	Main	8" PVC	395	1.227	278.1	310/1.46= 212			Pass / Fail
		Laterals	4" PVC 6" PVC	100 35	0.155 0.082	17.6 13.86	212*2= 414 sec			
		Totals			1.464	309.54				
3+95 MH A2	5+95 MH A3	Main	8" PVC	200	0.621	140.8	2*154=			Pass / Fail
		Laterals	4" PVC 6" PVC	20 30	0.047 0.047	5.28 7.92	308 sec			
		Totals			0.714	154.0				

Note: For total C ≤ 1.0, test time (seconds) required = 2 times K
For total C > 1.0, test time (seconds) required = 2 times (K/C)

The tested sewer section shall be considered acceptable when tested as described herein if the section under test does not loose air at a rate greater than 0.0015 cfm per square foot of internal sewer surface.

SANITARY SEWER MANDREL TEST REPORT

Project Location: (City)	Project Name:
Inspector: (Print)	Date: (Separate Report Required for Each Test Session)
Mandrel Diameters Verified? Yes / No	

Station (& Manhole #)		Size & Material	Length (ft)	Results	Backfill Compaction Completed?	Date Sewer Flushed & Cleaned	Comments
From	To						
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		
				Pass / Fail	Yes / No		

1. Mandrel testing shall conducted on a manhole to manhole (or cleanout) basis and shall be done after the line has been completely flushed out with water.

2. Mandrel testing shall be conducted after trench backfill and compaction has been completed.

3. The mandrel diameter shall be 95% of the pipe initial inside diameter. The inspector shall verify the diameter of each mandrel used during each test session.

SANITARY SEWER PIPELINE TV INSPECTION REPORT

Page ___ of ____

Date:	Client: City:					Basin No.	
Technician:	Inspector:		Weather:	Cleaned By:		Report No.	Tape No.
From M.H. #: Street:	Pipe Dia. (in)	Joint Length (ft)	Section Length (ft)	Joint Type:	Pipe Material	To M.H. #: Street:	

PIPELINE DATA;

Cleanliness: _____

Alignment: _____

Grade: _____

Age: _____

%Est. Leaking Joints: _____

Other:_____

_____

Footage	Problem Code	Comments	I/I (gpm)

PROBLEM CODE LEGEND:

BP = Broken Pipe
CC = Circumferential Crack
LC = Longitudinal Crack
G = Break in Grade
L = Leak
PJ = Pulled Joint
PT = Protruding Tap
ST = Service Tap
SL = Service Left
SR = Service Right
RT = Roots
U = Unpassable

PIPE MATERIAL **LEGEND:**

AC = Asbestos Cement
CIP = Cast Iron Pipe
C(M) = Conc., Mortar Joint
C(R) = Conc., Rubr. Gasket Jnt
DI = Ductile Iron Pipe
PVC = Polyvinylchloride Pipe
TC = Terra Cotta
VC = Vitrified Clay

TURNAROUND:

Requested (Date/time):_____

Authorized (Date/time):_____

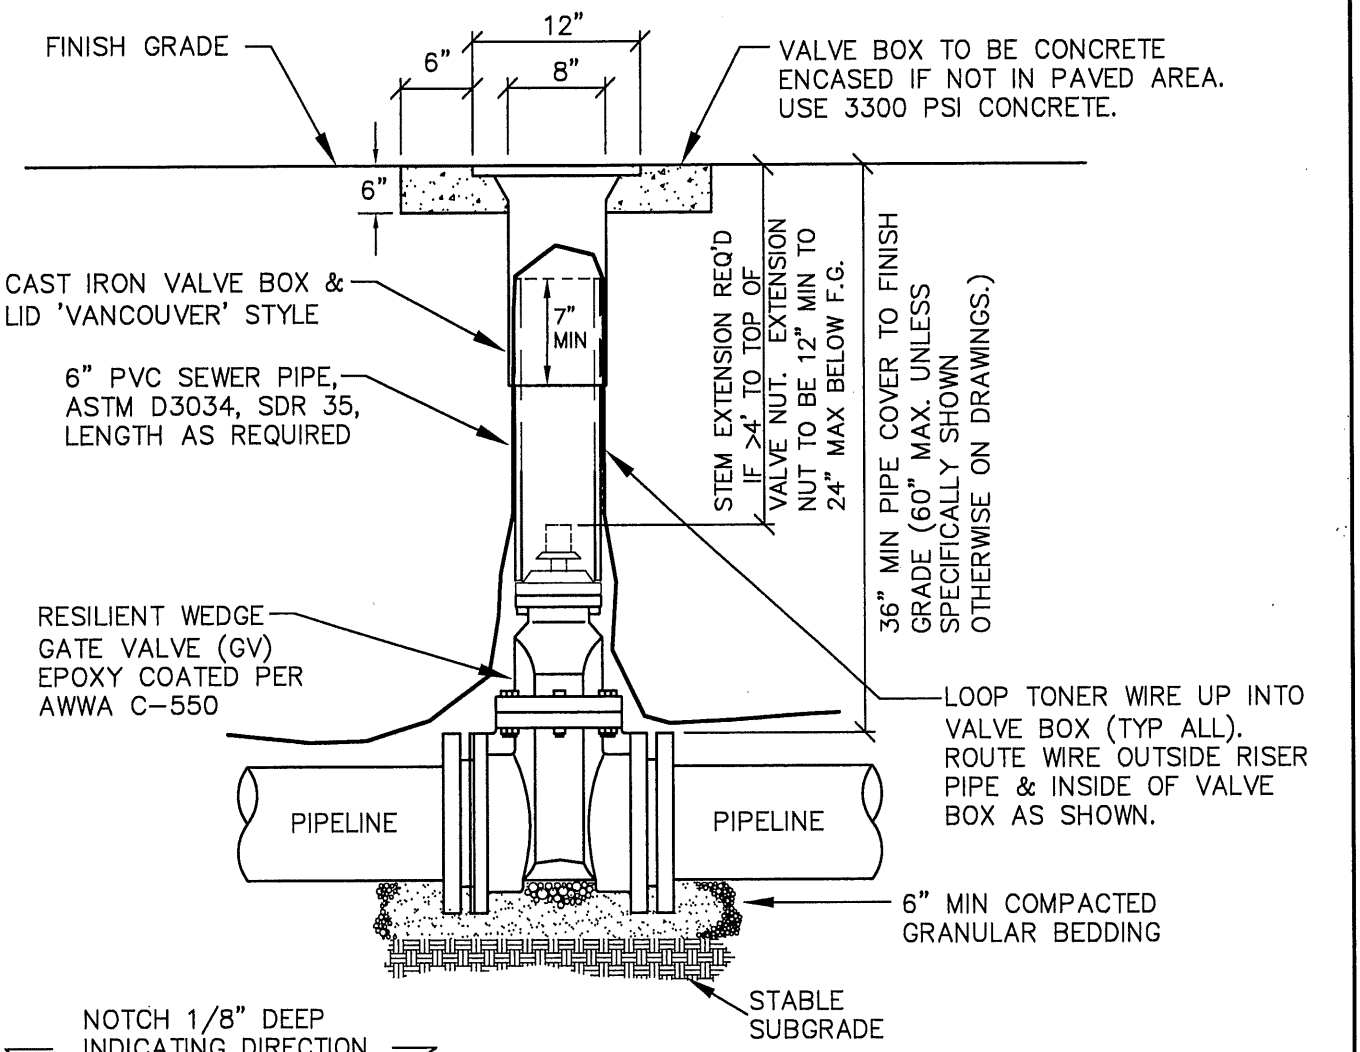

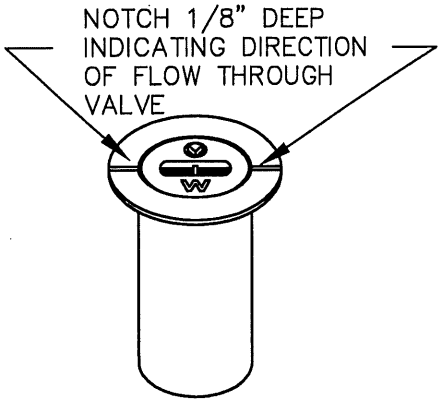

VANCOUVER '910' STYLE
18" TALL VALVE BOX

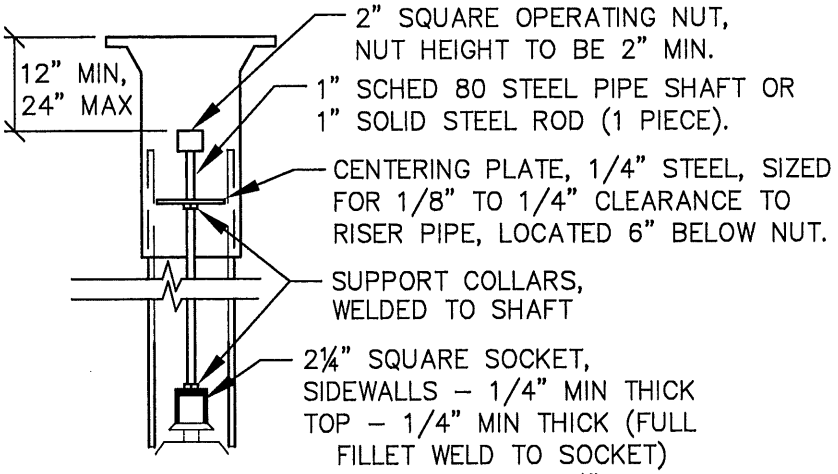

STEM EXTENSION

NOTES:

1. GV SHALL CONFORM TO AWWA C-509.
2. VALVE BOXES SHALL BE PLUMB AND CENTERED DIRECTLY OVER THE VALVE NUT.
3. VALVE BOX TOP SHALL BE ADJUSTED TO FINISHED GRADE.
4. PVC SHALL BE ONE CONTINUOUS PIECE, NO BELLS OR COUPLERS.
5. VALVE BOXES ON PRESSURE SEWERS TO READ "S" OR "SEWER".

LAST REVISION DATE: JUNE 2015	JO # STANDARD
GATE VALVE AND VALVE BOX DETAIL (NTS)	
PHILOMATH, OR	DETAIL NO. 501

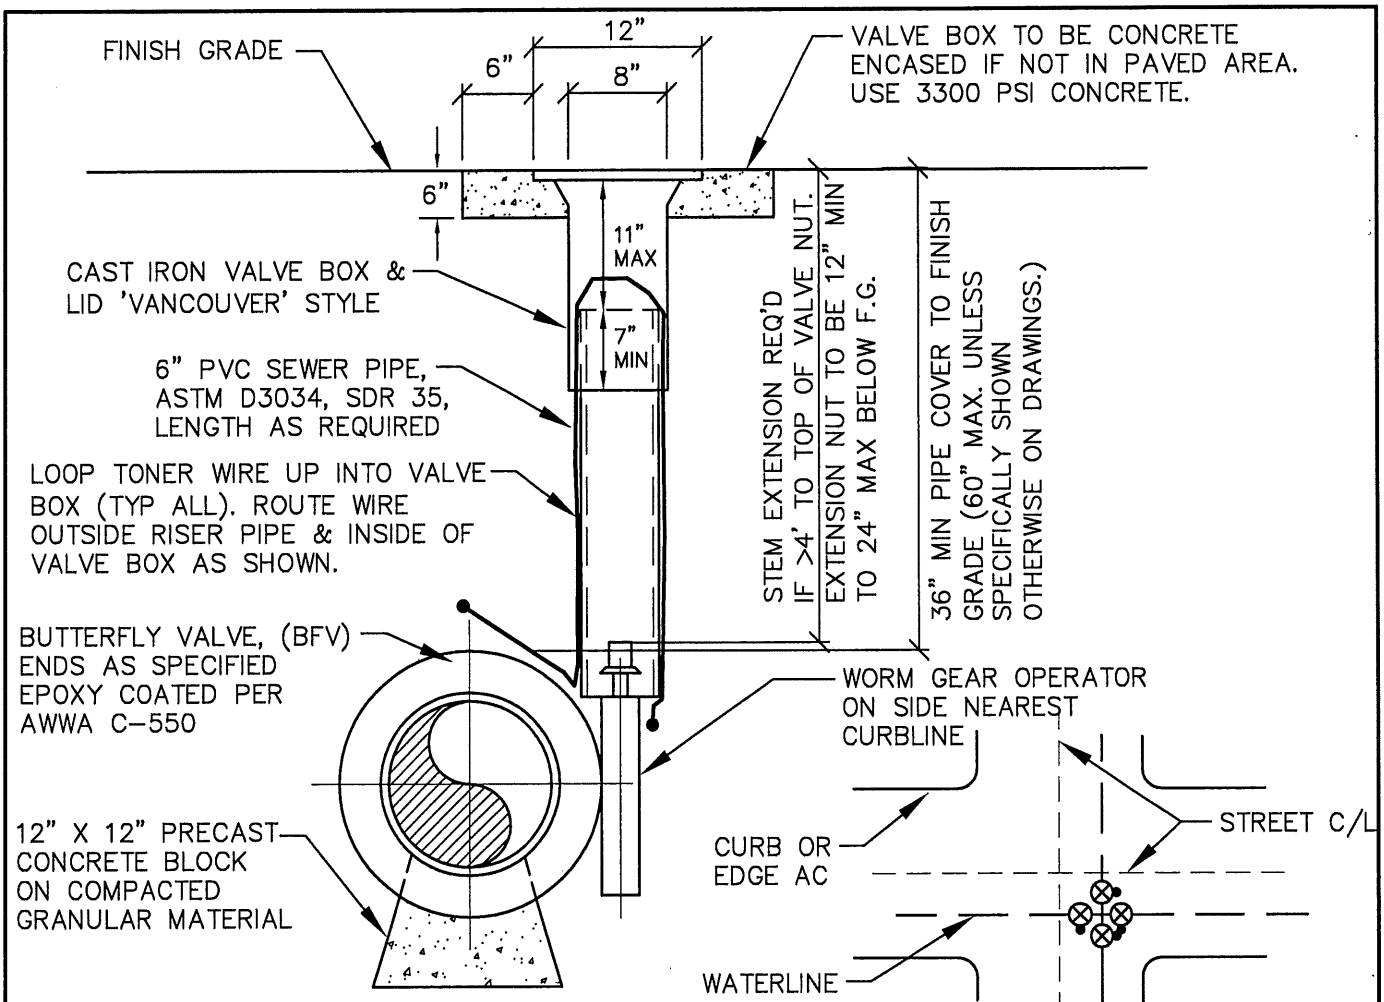

BFV OPERATOR POSITION

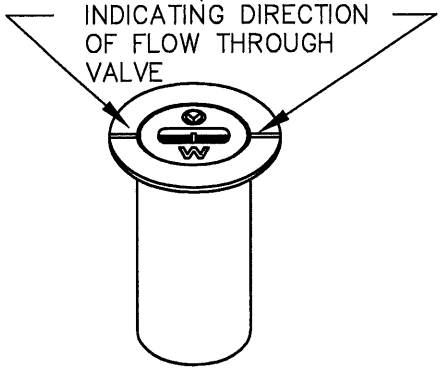

VANCOUVER '910' STYLE

18" TALL VALVE BOX

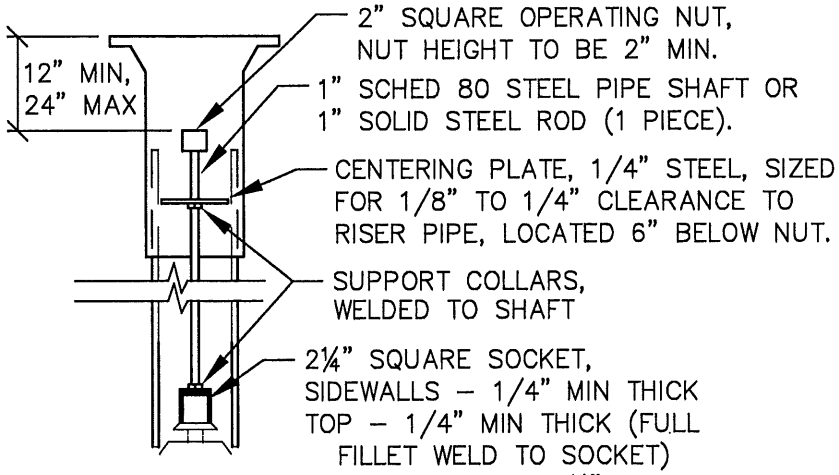

STEM EXTENSION

NOTES:

1. BFV SHALL BE SHORT BODY TYPE B VALVE PER AWWA C-504.
2. VALVE BOXES SHALL BE PLUMB AND CENTERED DIRECTLY OVER THE VALVE NUT.
3. VALVE BOX TOP SHALL BE ADJUSTED TO FINISHED GRADE.
4. PVC SHALL BE ONE CONTINUOUS PIECE, NO BELLS OR COUPLERS.
5. BFV ACTUATOR TO BE LOCATED ON THE CURBLINE SIDE OF WATERLINE AS SHOWN. INSTALL DI SPOOLS OR FLEX ADAPTER IF REQUIRED FOR ACTUATOR CLEARANCE.

LAST REVISION DATE: JUNE 2015	JO # STANDARD
BUTTERFLY VALVE AND VALVE BOX DETAILS (NTS)	
PHILOMATH, OR	DETAIL NO. 502

NOTE: HYDRANT COLOR TO BE FACTORY YELLOW

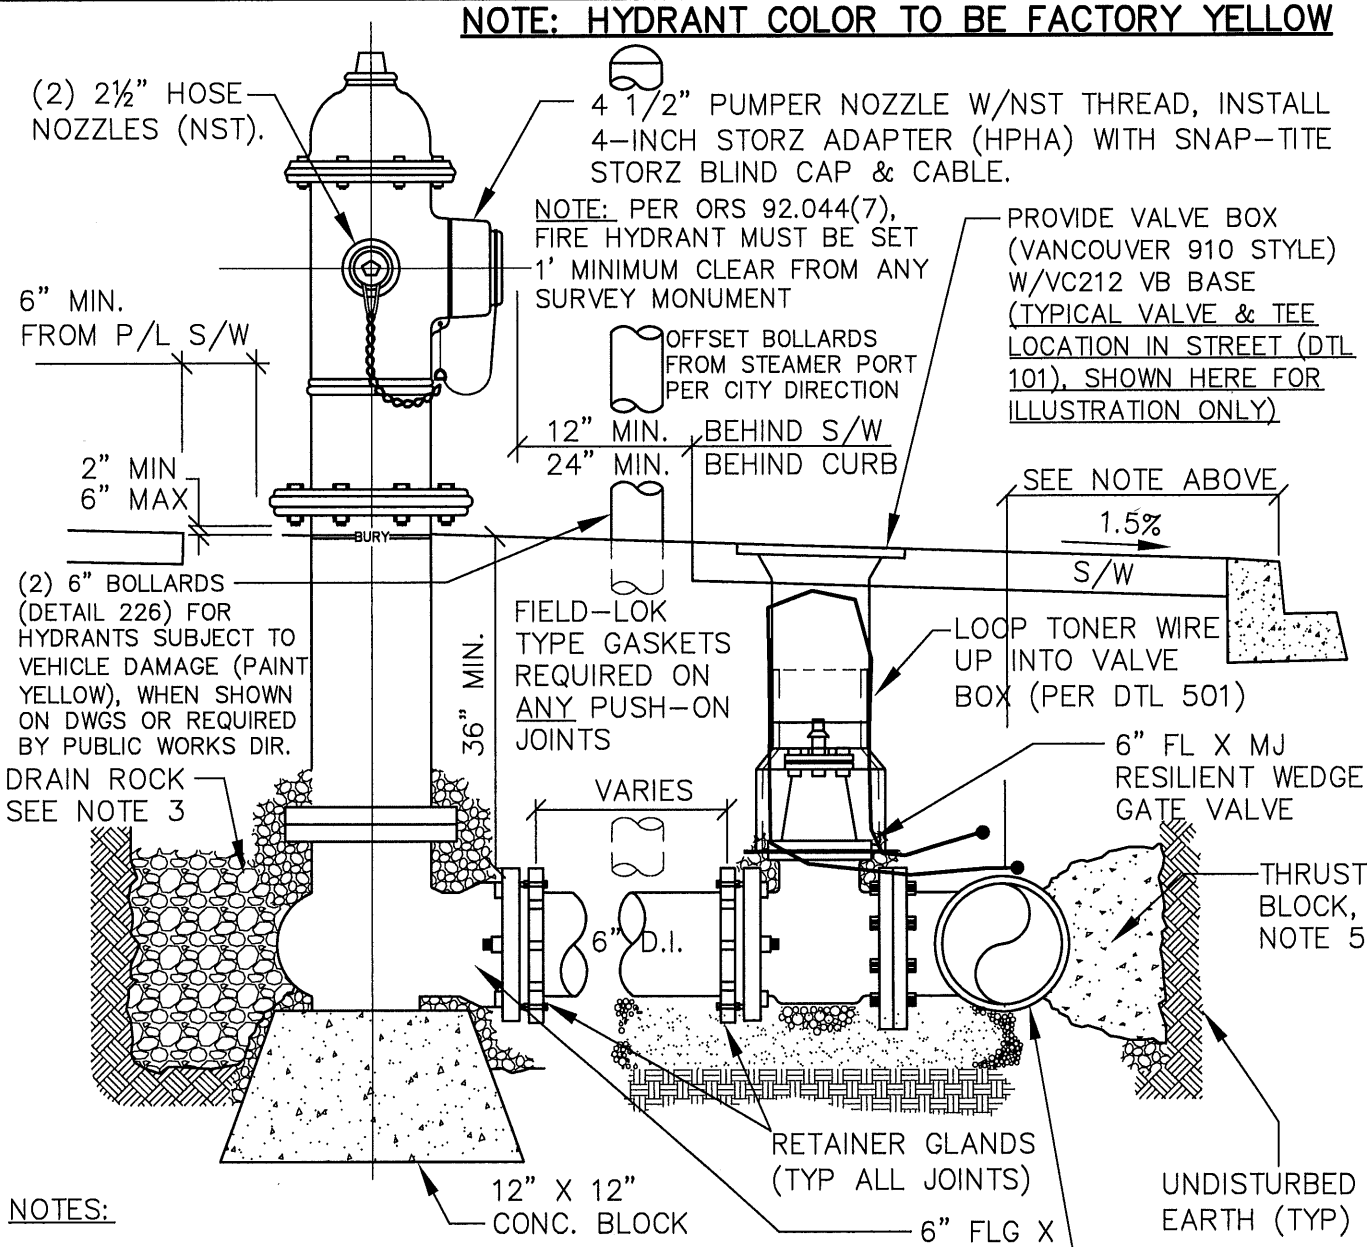

NOTES:

1. HYDRANTS TO BE CLOW MEDALLION or KENNEDY GUARDIAN K81D WITH FULL SIZE (5¼") FOOT VALVE.
2. **ALL FITTINGS IN CONTACT WITH CONCRETE SHALL BE WRAPPED IN PLASTIC.** HYDRANT DRAIN HOLES TO REMAIN OPEN TO DRAIN ROCK AND OPERATIONAL.
3. 1-1/2" TO 3/4" CLEAN DRAIN ROCK SHALL BE PLACED A MIN. OF 6" ABOVE DRAIN OUTLET.
4. WHERE PLANTER STRIP EXISTS, HYDRANT SHALL BE PLACED SO FRONT PORT IS A MIN. OF 24" BEHIND FACE OF CURB.
5. THRUST BLOCK AT STANDARD 6" FIRE HYDRANT TEE SHALL HAVE MIN. 3.7 SQ. FT. BEARING AREA.
6. ALL HYDRANTS SHALL BE SET PLUMB.
7. FOR HYDRANT LEADS LONGER THAN 30', AN ADDITIONAL GATE VALVE SHALL BE PROVIDED WITHIN 3 FT. OF THE HYDRANT.
8. RESTRAIN ALL JOINTS ON ALL HYDRANT LEADS. RETAINER GLANDS SHALL TO BE USED IN LEIU OF THRUST BLOCK BEHIND HYDRANT.
9. PAINT CURB YELLOW 10 FEET EACH WAY FROM HYDRANT & INSTALL REFLECTIVE BLUE TRAFFIC MARKER @ STREET CENTERLINE.

LAST REVISION DATE: SEPT 2016	
STANDARD FIRE HYDRANT ASSEMBLY (NTS)	
PHILOMATH, OR	DETAIL NO. 503

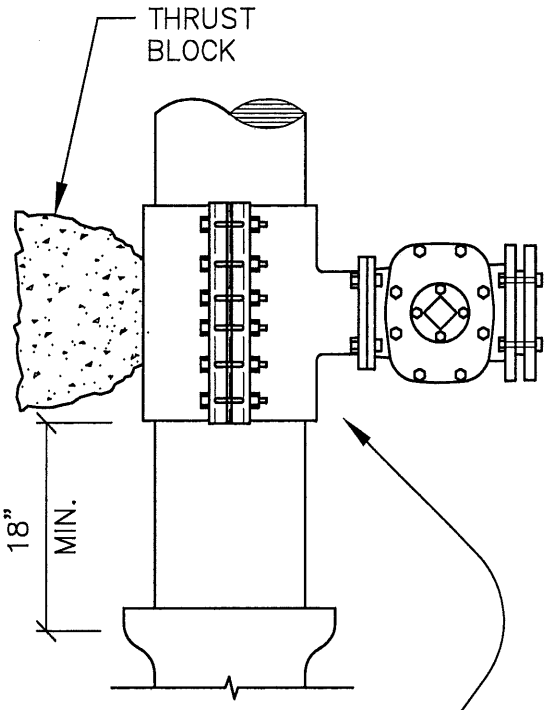

ROMAC SST/SSTIII, MUELLER H304,
JCM MODEL 432 OR APPROVED EQUAL
(STAINLESS STEEL SLEEVE & FLANGE)

TOP VIEW

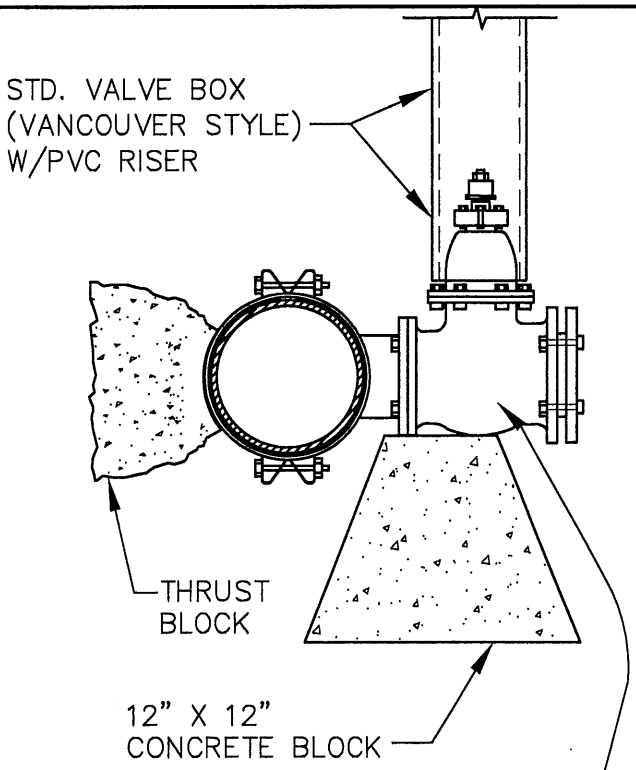

RESILIENT WEDGE GATE VALVE
(FL x MJ UNLESS OTHERWISE
NOTED ON PLANS)

SIDE VIEW

NOTES:

1. WATER MAIN SHALL BE CLEANED & SPRAYED WITH CHLORINE SOLUTION IN TAP AREA BEFORE ATTACHING SLEEVE.
2. TAPPING SLEEVE SHALL BE ALL STAINLESS STEEL WITH FULL PERIMETER GASKET.
3. TAPPING VALVE SHALL BE EPOXY COATED PER AWWA C-550.
4. SLEEVE AND VALVE SHALL BE PRESSURE TESTED BEFORE MAKING TAP. PRESSURE TEST AND TAP SHALL BE MADE IN THE PRESENCE OF AN AUTHORIZED CITY REPRESENTATIVE.
5. APPROVED TAPPING MACHINE SHALL BE USED TO MAKE TAP.
6. 3/4" GRANULAR BACKFILL SHALL BE PLACED AND COMPACTED TO 92% OF MAXIMUM DENSITY AS DETERMINED BY AASHTO T-180.
7. THRUST BLOCKING PER DETAIL 510.
8. TAP SHALL BE MADE NO CLOSER THAN 18" FROM THE NEAREST JOINT.
9. **SLEEVE AND VALVE SHALL BE WRAPPED WITH 8 MIL PLASTIC PRIOR TO CONCRETE PLACEMENT.**
10. CONCRETE BLOCK(S) SHALL COMPLETELY SUPPORT TAPPING TEE AND VALVE.
11. CONTRACTOR SHALL COORDINATE ALL TAPS WITH CITY AND PERFORM ALL TAPS WITH PUBLIC WORKS STAFF PRESENT.
12. ALL TAPPING EQUIPMENT (AND ANY TOOL COMING IN CONTACT WITH THE PIPE THOUGH THE TAPPING SLEEVE) SHALL BE CHLORINE DISINFECTED WITH A 300 MG/L CHLORINE SOLUTION.

LAST REVISION DATE: DEC 2015	
TAPPING TEE AND VALVE (NTS)	
PHILOMATH, OR	DETAIL NO. 505

BLOW–OFF SIZES REQUIRED (ASSUMES 40 PSI RESIDUAL PRESS.)	
MAIN SIZE	BLOW–OFF SIZE
6" – 8"	2"
10" – 12"	4"
>12"	BY ENGR.

PROVIDE ONE RISER ASSEMBLY FOR EACH 3 BLOWOFFS OR PORTION THEREOF.

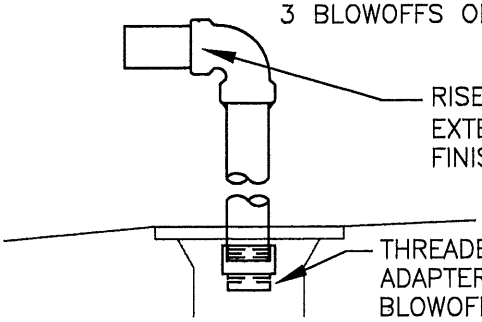

B.O. RISER

NOTE: PER ORS 92.044(7), VALVE BOXES MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

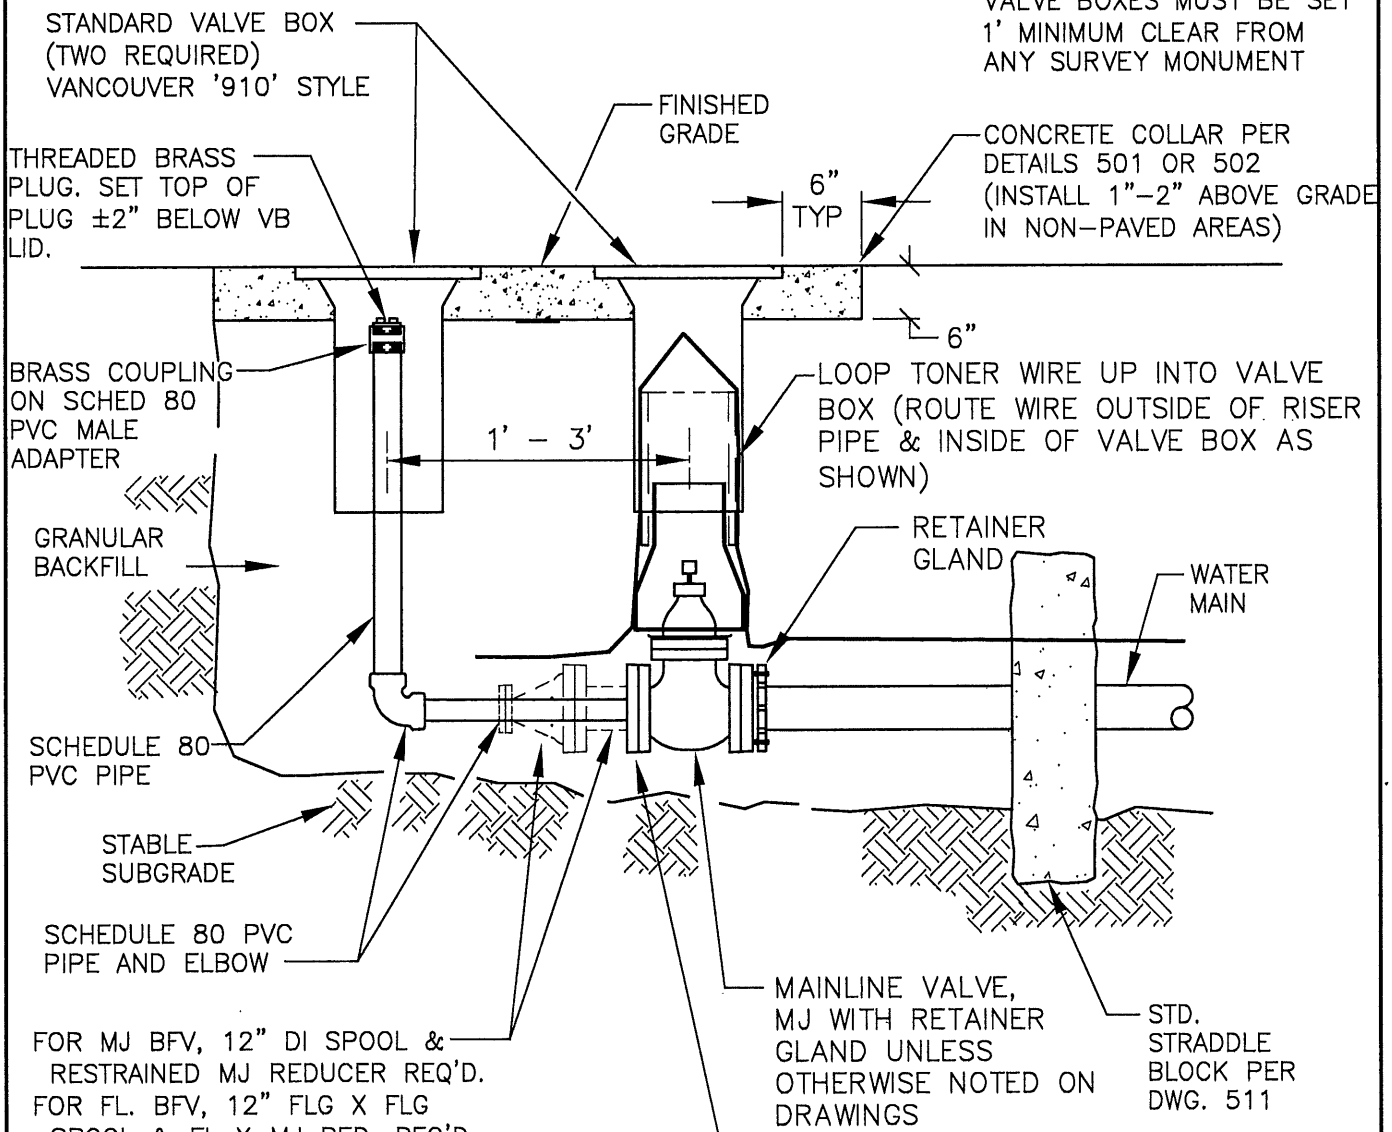

NOTES:

1. BACKFILL WITH GRANULAR BACKFILL.
2. REQUIRED ON ALL LINES WHICH MAY BE EXTENDED IN FUTURE OR AS DIRECTED BY CITY ENGINEER.
3. ALL CONCRETE TO BE 3300 PSI @ 28 DAYS.
4. FLANGED DUCTILE IRON PIPE AND FITTINGS MAY BE REQUIRED FOR 4" & LARGER BLOWOFFS.

LAST REVISION DATE: DEC 2015	

MAINLINE BLOWOFF ASSEMBLY

(NTS)

PHILOMATH, OR	DETAIL NO. 506

PROVIDE ONE RISER ASSEMBLY FOR EACH 3 BLOWOFFS OR PORTION THEREOF.

NOTE: PER ORS 92.044(7), VALVE BOXES MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

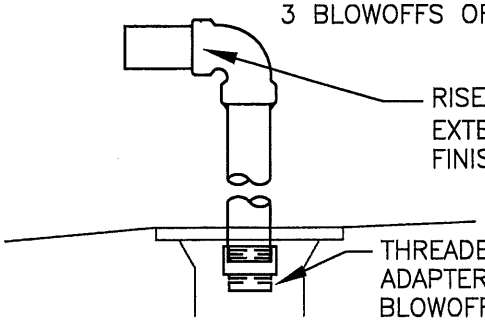

B.O. RISER

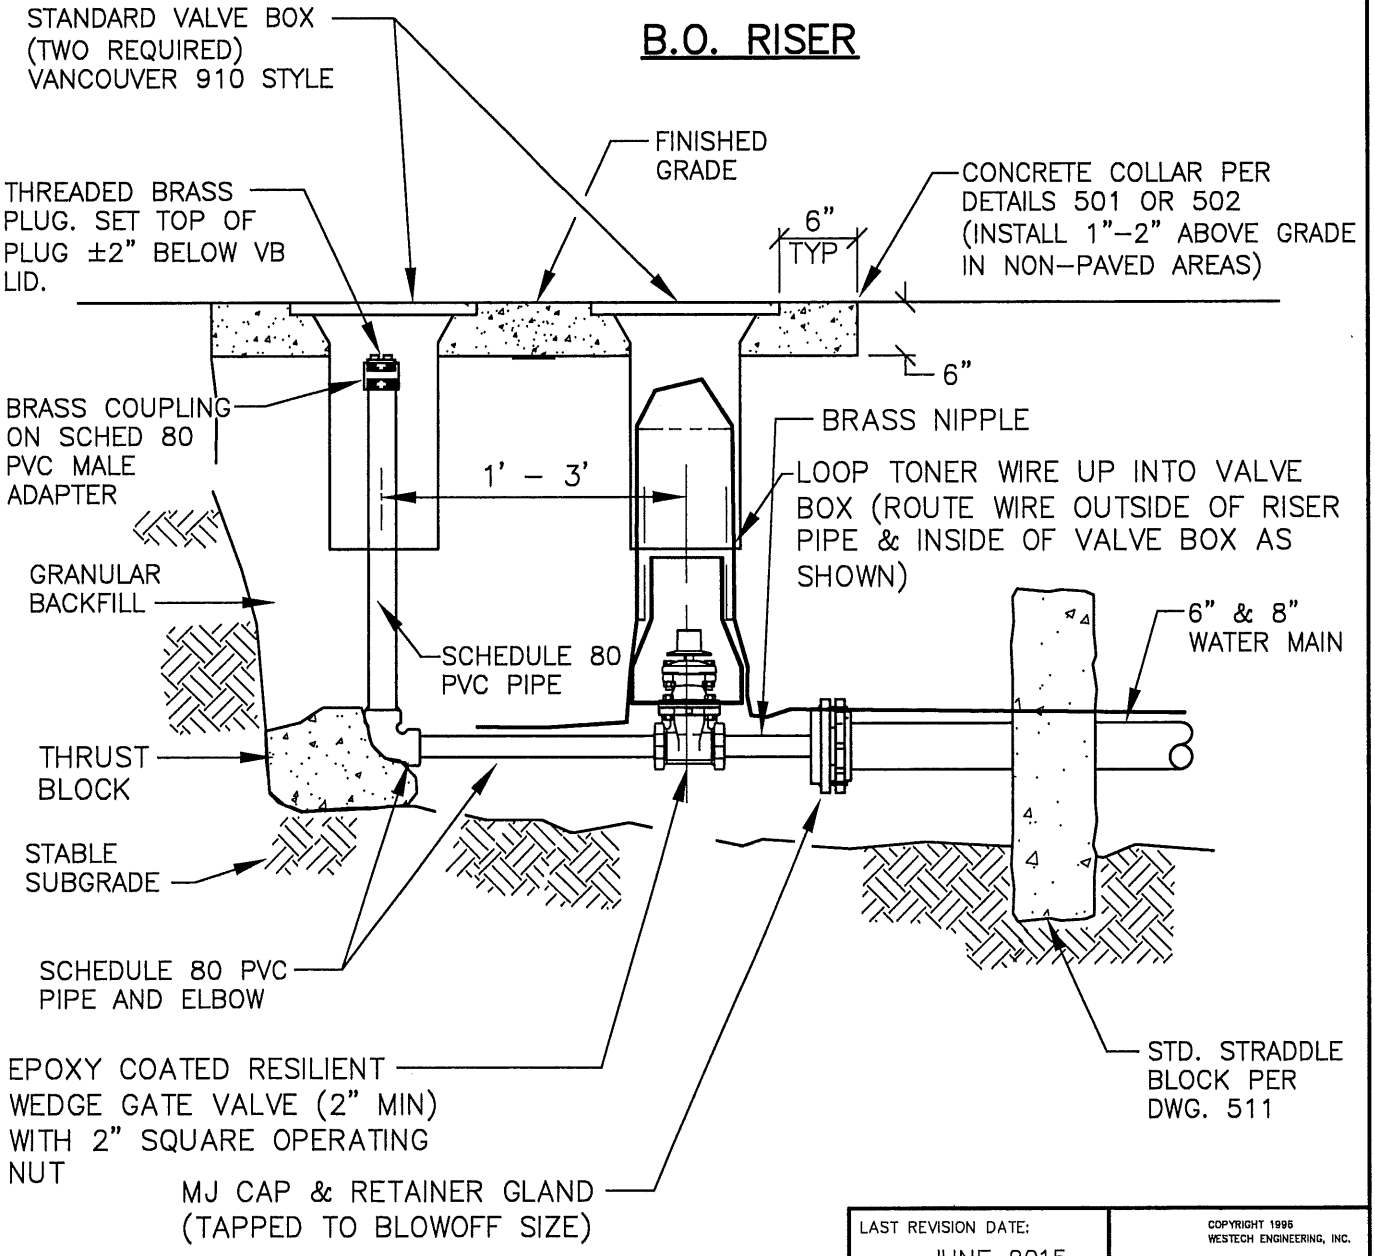

NOTES:

1. BACKFILL WITH GRANULAR BACKFILL.
2. ALLOWED ONLY ON PERMANENT DEAD END LINES IN CUL–DE–SACS WHICH CANNOT BE EXTENDED IN THE FUTURE.
3. ALL CONCRETE TO BE 3300 PSI @ 28 DAYS.
4. 2" BLOWOFF SIZE ASSUMES 40 PSI RESIDUAL PRESSURE.

LAST REVISION DATE: JUNE 2015	
STANDARD BLOWOFF WITH PLUGGED END (NTS)	
PHILOMATH, OR	DETAIL NO. 507

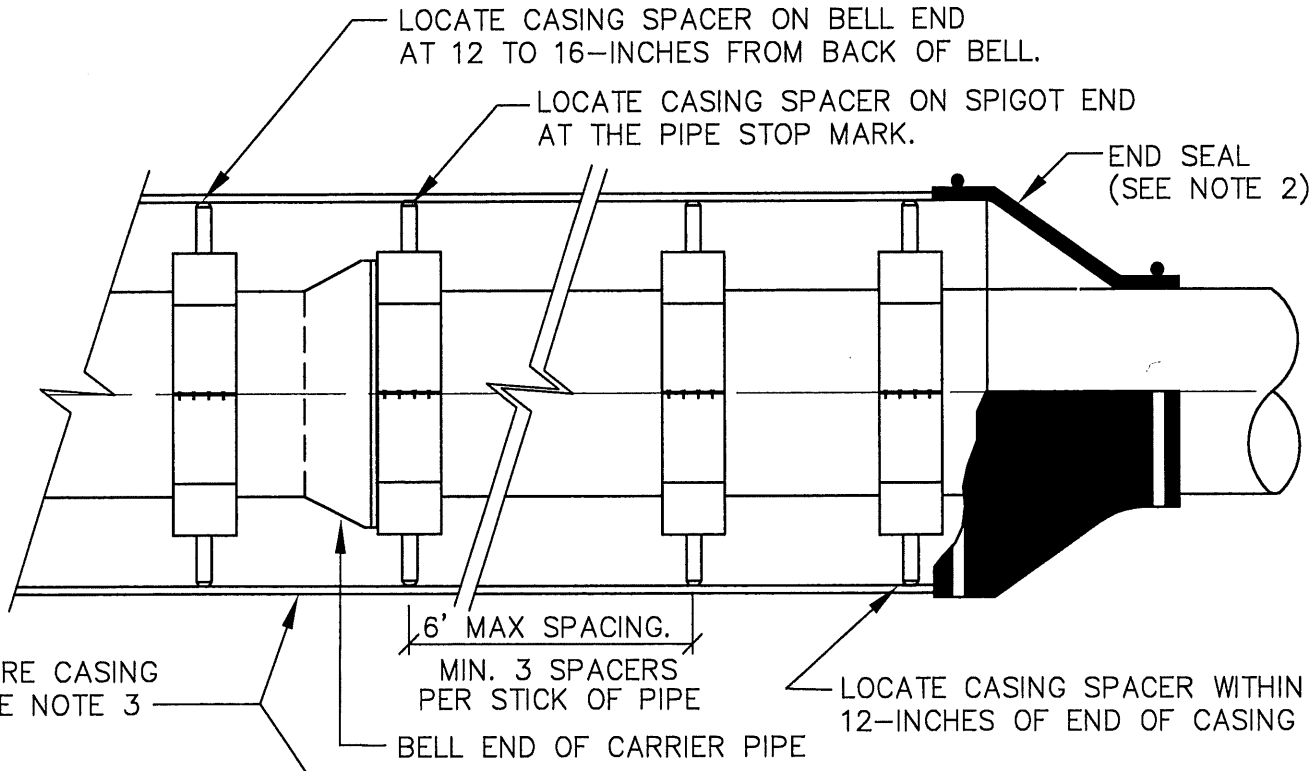

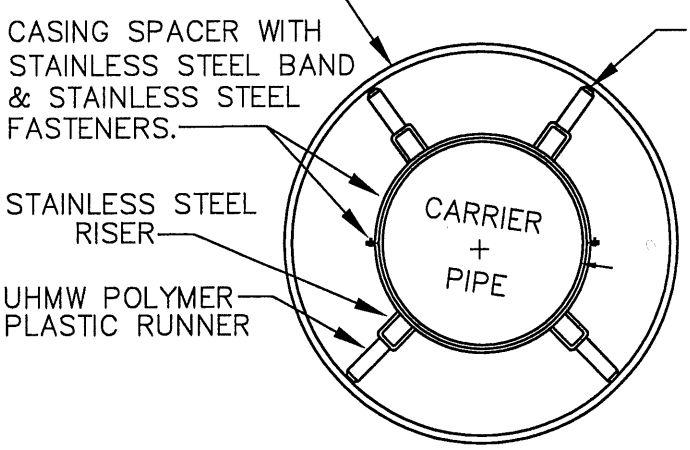

CARRIER PIPE DIAMETER	MIN. DIA. CASING (*1, *2)	MIN CASING WALL THICKNESS (INCH)
6"	12"	0.25 (1/4)
8"	14"	0.25 (1/4)
10"	16"	0.312 (5/16)
12"	18"	0.375 (3/8)

*1: CASING SIZE LISTED IS FOR PRESSURE PIPE. LARGER DIA CASING REQ'D FOR GRAVITY PIPE.
*2: SEE PWDS 5.8.m FOR GRAVITY PIPE CASING SIZE REQUIREMENTS OR LARGER CASING SIZES.

NOTES:

1. CASING SPACERS – APS MODEL SSI, CALPICO M–SS SERIES OR APPROVED EQUIV. 4"–18" CARRIER PIPE, USE 8" WIDE BAND. >18" CARRIER PIPE, USE 12" WIDE BAND.
2. SEAL BOTH ENDS OF BORE CASING WITH END SEALS. WITHOUT SAND FILL, USE APS MODEL AZ OR APPROVED EQUIV. FASTEN TO CASING AND CARRIER PIPE WITH ST. STEEL BANDS. WITH SAND FILL, USE GROUT END CAPS (PLUG VENT TUBES AFTER SAND FILL).
3. CASING SHALL BE WELDED SMOOTH STEEL PIPE CONFORMING TO ASTM A–53, GRADE B OR APPROVED EQUIVALENT (Fy = 35,000 psi).
4. CARRIER PIPE DIAMETER & MATERIAL AS PER DWGS.
5. FOR GRAVITY SEWER OR STORM CARRIER PIPES, THE CASING ANNULAR SPACE SHALL BE COMPLETELY FILLED WITH SAND TO PREVENT FLOATATION OF CARRIER PIPE BY GROUNDWATER.
6. CARRIER PIPE SHALL BE COMPLETELY FILLED WITH WATER PRIOR TO INSTALLING OR BLOWING SAND.
7. INCREASE CASING DIA AS REQ'D TO ALLOW TRIMMING OF CASING SPACERS ON GRADE CRITICAL BORES

LAST REVISION DATE:	
AUG 2015	

BORE CASING, CARRIER PIPE AND CASING SPACER DETAIL

(NTS)

PHILOMATH, OR	DETAIL NO. 508

FITTING SIZE (Inches)	TEE, WYE, & ① HYDRANTS	90° BEND ② PLUGGED CROSS TEE PLUGGED–RUNS	45° BEND ③	22 1/2° BEND ③	11 1/4° BEND ③
2	*	*	*	*	*
4	1.7	2.4	1.3	*	*
6	3.7	5.3	2.9	1.5	*
8	6.7	9.5	5.1	2.7	1.3
10	10.5	14.8	8	4.1	2
12	15.1	21.3	11.6	5.9	2.9
16	26.8	37.9	20.5	10.4	5.2
18	33.9	47.9	25.9	12.8	6.7
LARGER	* *	* *	* *	* *	* *
	BEARING AREA OF THRUST BLOCKS (sq. ft.)				

1. ALL VALUES ARE BASED ON THE FOLLOWING ASSUMPTIONS:
   AVG. PRESSURE = 100 PS1 x 2 (safety factor); 1500 PSF SOIL BEARING CAPACITY;
   NORMAL DISTRIBUTION SYSTEM DESIGN VELOCITY NOT TO EXCEED 5 FPS.
2. **ALL FITTINGS SHALL BE WRAPPED IN PLASTIC PRIOR TO PLACEMENT OF CONCRETE.**
3. BEARING SURFACE OF THRUST BLOCKING SHALL BE AGAINST UNDISTURBED SOIL.
4. TRUCK–MIXED CONCRETE MIX SHALL HAVE A MIN. 28 DAY STRENGTH OF 3300 PSI (5" MAX SLUMP). USE OF HAND–MIXED SACK–CRETE TYPE CONCRETE REQUIRES WRITTEN CITY APPROVAL PRIOR TO USE, AND SHALL BE 4000 PSI MIX, MIXED WITH MIN AMOUNT OF WATER NECESSARY FOR WORKABILITY (5" MAX SLUMP). USE OF DRY SACK–CRETE MIX (BAGS OR LOOSE MIX) IS PROHIBITED FOR PERMANENT THRUST RESTRAINT.
5. ALL PIPE ZONES SHALL BE BACKFILLED WITH GRANULAR BACKFILL AND COMPACTED.
6. THRUST BLOCKS FOR PLUGGED CROSS AND PLUGGED TEE SHALL HAVE #4 REBAR LIFTING LOOPS INSTALLED AS SHOWN.
7. VERTICAL THRUST DETAILS–SEE DWG. 512.
8. STRADDLE BLOCK DETAILS–SEE DWG. 511.

* BLOCK TO UNDISTURBED TRENCH WALLS

* * THRUST BLOCKS FOR PIPES LARGER THAN 18" WILL BE INDIVIDUALLY DESIGNED BY THE ENGINEER.

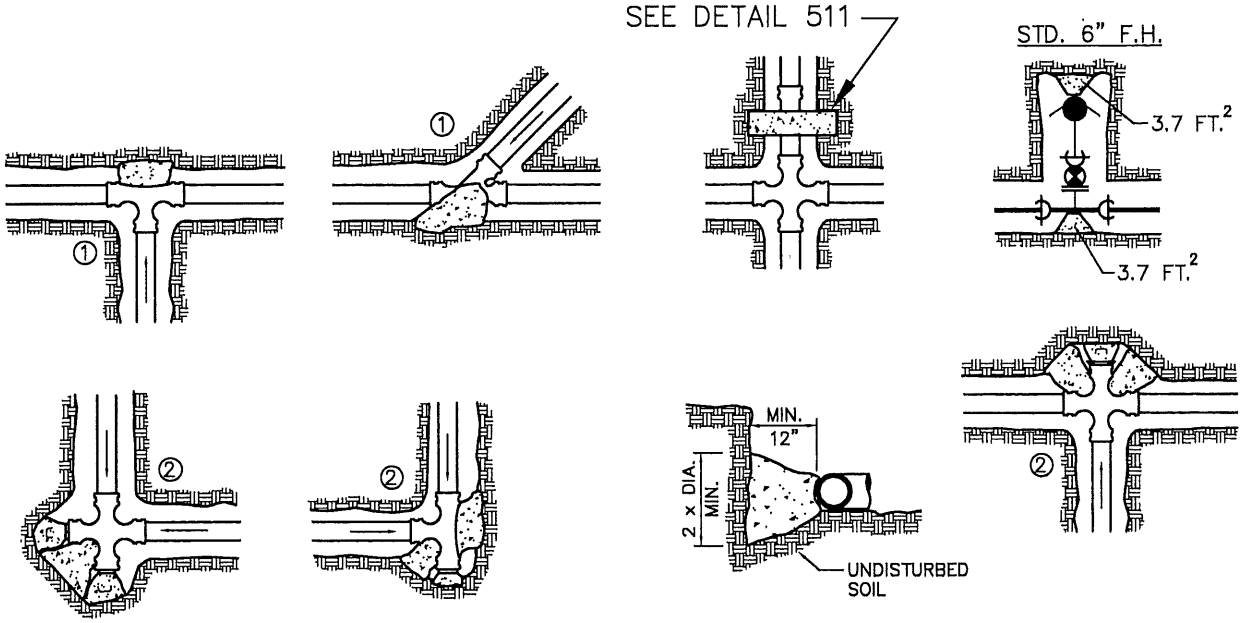

LAST REVISION DATE: SEPT 2014	
HORIZONTAL THRUST BLOCKING (NTS)	
PHILOMATH, OR	DETAIL NO. 510

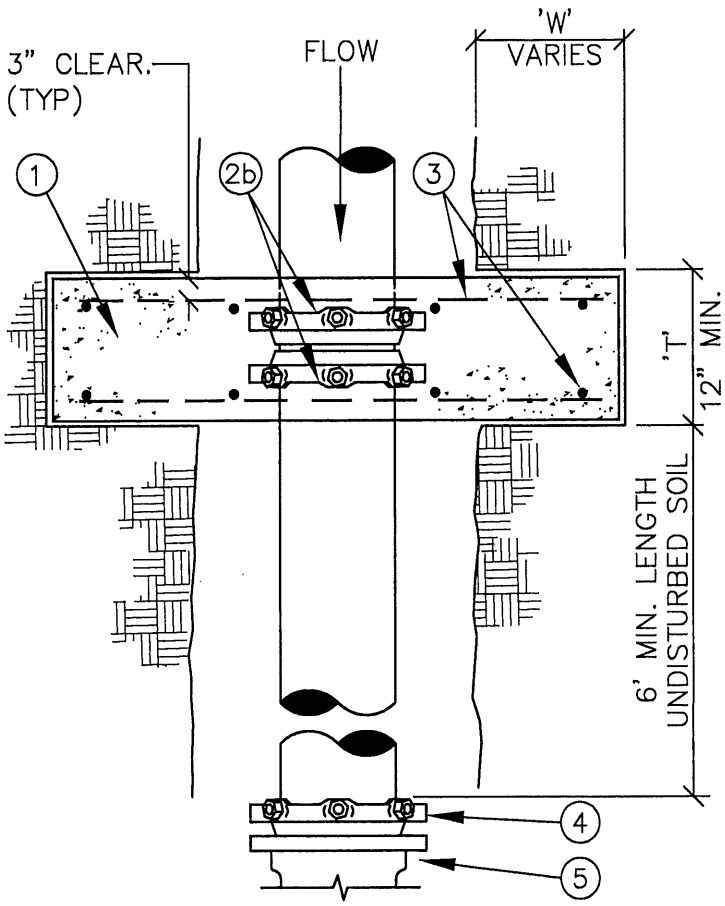

TOP VIEW

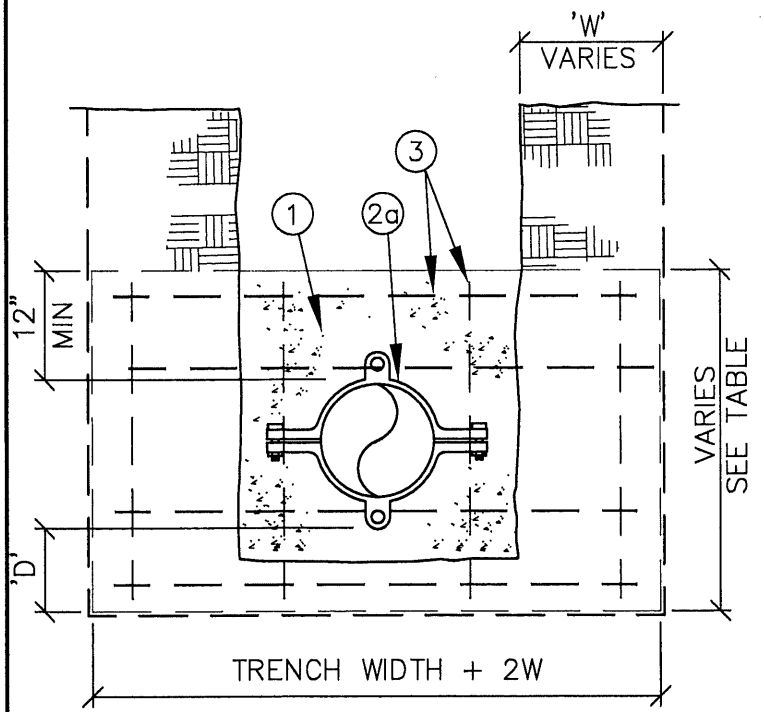

FRONT VIEW

MATERIALS

1. CONCRETE STRADDLE BLOCK.
2. –EITHER (a) ONE SERRATED–LOCK STYLE SPLIT–RING RESTRAINT HARNESS (ROMAC 600 OR EQUAL), OR (b) TWO RETAINER GLAND WEDGE–STYLE RESTRAINTS, SET OPPOSED (EBBA MEGA–LUG OR EQUAL).
   –WEDGE STYLE RESTRAINTS SHALL BE WRAPPED WITH PLASTIC PRIOR TO CONCRETE PLACEMENT.
3. #4 REBAR EA. WAY, 12" O.C.
4. RETAINER GLAND.
5. MJ FITTING, VALVE OR BLOWOFF.

PIPE SIZE	'W'	'D'	'T'
6"	12"	8"	12"
8"	16"	10"	12"
10"	20"	12"	12"
12"	24"	18"	18"
>12"	BY ENGINEER		

NOTES:

1. STRADDLE BLOCKS FOR >12" PIPE SHALL BE DESIGNED INDIVIDUALLY BY THE ENGINEER AND SHALL BE BASED ON THE FOLLOWING:
   a.) 200 PSI WATER PRESSURE.
   b.) SOIL BRG. CAPACITY, STEEL SIZE & SPACING BY THE ENGINEER.
2. BEARING AREA OF BLOCK SHALL BE AGAINST UNDISTURBED SOIL.
3. STRADDLE BLOCK SHALL HAVE A MINIMUM OF 18" COVER.
4. CONCRETE SHALL HAVE A MIN. 28 DAY STRENGTH OF 3300 PSI.

LAST REVISION DATE: JAN 2014	
STRADDLE BLOCK FOR 12" AND SMALLER PIPE (NTS)	
PHILOMATH, OR	DETAIL NO. 511

NOTES:

1. GRAVITY VERTICAL THRUST BLOCKS SHALL BE DESIGNED BY THE ENGINEER.
2. **KEEP CONCRETE CLEAR OF JOINT AND JOINT ACCESSORIES. FITTINGS SHALL BE WRAPPED IN PLASTIC PRIOR TO PLACEMENT OF CONCRETE.**
3. CONCRETE THRUST BLOCKING SHALL BE POURED AGAINST UNDISTURBED EARTH.
4. CONCRETE MIX SHALL HAVE A MIN. 28 DAY STRENGTH OF 3000 P.S.I.
5. THRUST BLOCK VOLUMES FOR VERTICAL BENDS HAVING UPWARD RESULTANT THRUSTS ARE BASED ON TEST PRESSURE OF 150 P.S.I.G. AND THE WEIGHT OF CONCRETE = 4050 LBS./CU.YD.
6. VERTICAL BENDS THAT REQUIRE A THRUST BLOCK VOLUME EXCEEDING 5 CUBIC YARDS REQUIRE SPECIAL BLOCKING DETAILS. SEE PLANS FOR VOLUMES SHOWN INSIDE HEAVY LINE IN TABLE.
7. ALL REBAR SHALL BE GALVANIZED IN ACCORDANCE WITH ASTM–123 (MIN. 3.4 MIL). REBAR SHALL BE BENT BEFORE GALVANIZATION, AND LAST 4" OF BAR SHALL BE BENT 90 DEGREES WITH A 1/2" RADIUS BEND. REBAR SHALL BE TIGHTLY FIT TO RESTRAINED FITTING.
8. FOR HORIZONTAL THRUST BLOCK DETAILS SEE DRAWING NO. 510.

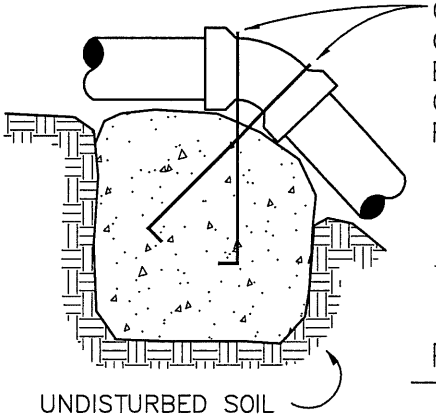

PROFILE

GRAVITY VERTICAL THRUST BLOCK

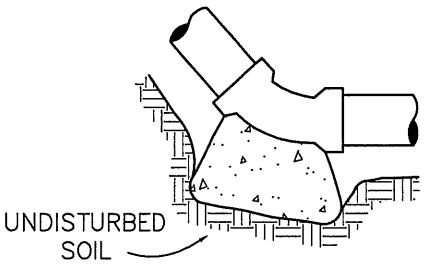

PROFILE

NORMAL VERTICAL THRUST BLOCK

VOLUME OF THRUST BLOCK IN CUBIC YARDS (VERTICAL BENDS)			
FITTING SIZE	BEND ANGLE		
	45°	22 1/2°	11 1/4°
4	1.1	0.4	0.2
6	2.7	1.0	0.4
8	4.0	1.5	0.6
10	6.0	2.3	0.9
12	8.5	3.2	1.3
14	11.5	4.3	1.8
16	14.8	5.6	2.3

FITTING SIZE	ROD SIZE	EMBED–MENT
12" AND LESS	#6	30"
14" – 16"	#8	36"

LAST REVISION DATE: JUNE 1998	
VERTICAL THRUST BLOCKING (NTS)	
PHILOMATH, OR	DETAIL NO. 512

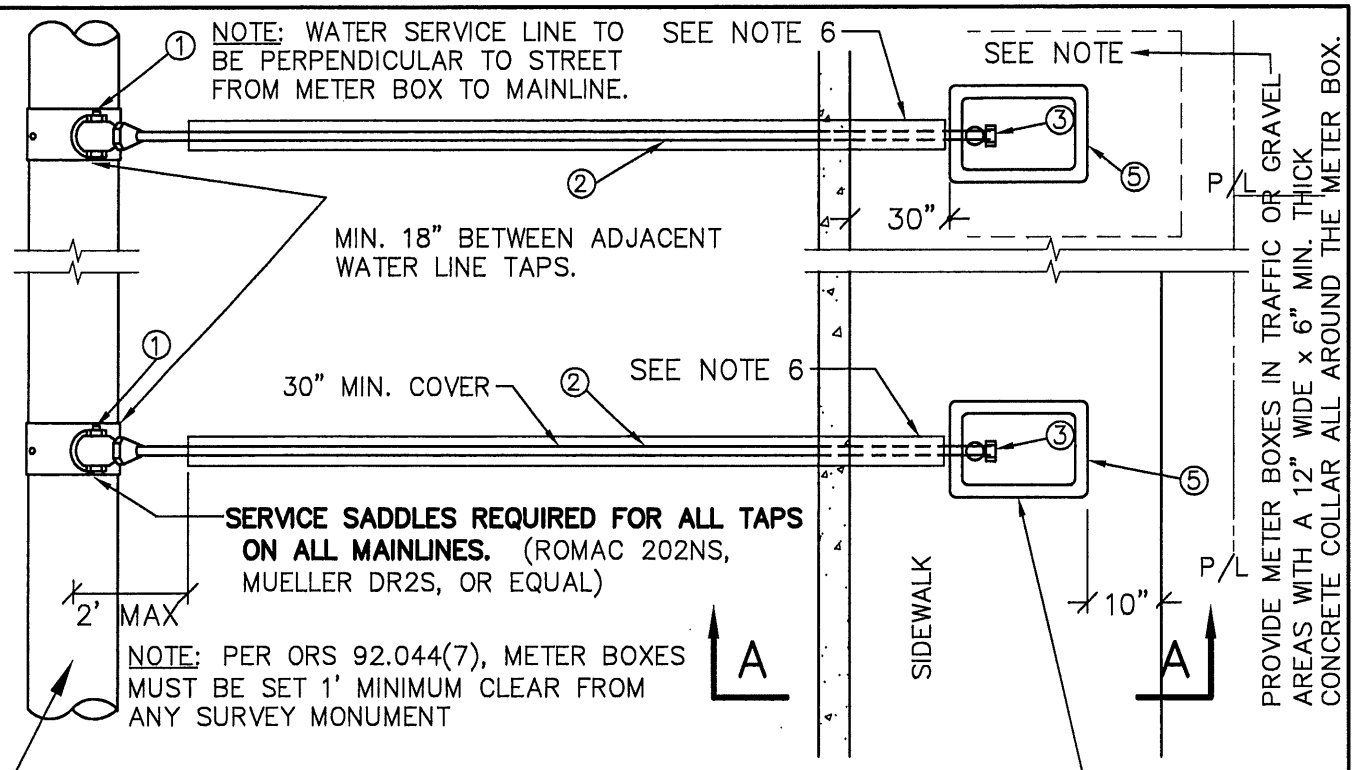

WATER MAIN

FOR RESIDENTIAL USE ONLY.

STAMP 2" TALL "W" IN TOP OF CURB AND GUTTER PAN AT POINT OF CROSSING (TYP).

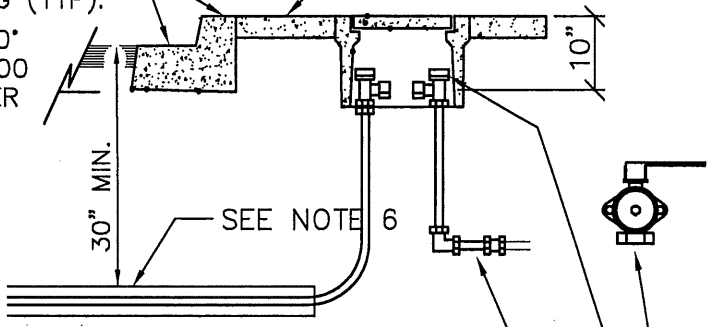

SECTION A–A

MATERIALS:

① BALL STYLE CORPORATION STOP. SET AT 30° ANGLE UP FROM HORIZONTAL. FORD FB–1100 –4Q–NL, McDONALD 74704BQ1, OR MUELLER P25028N.

② SOFT TEMPER TYPE 'K' COPPER TUBING COMPLYING W/ASTM B–88.
SINGLE RESIDENTIAL SERVICE: 1" (TYP)

③ BALL STYLE LOCKING ANGLE METER STOP, FORD BA43–444WQ–NL, AY McDONALD 74602B–3Q, OR MUELLER 24258N, W/FORD A24 OR McDONALD 710J24 ADAPTER.

④ ALL FITTINGS CONNECTING TO COPPER PIPE SHALL BE COMPRESSION. THREADED CONNECTIONS SHALL BE IRON PIPE THREAD.

⑤ WATER METER BOX PER PWDS 5.8.h.1 (12"x20" ID):
–ARMORCAST P60000485 W/BROOKS 37–TR LID IN TRAFFIC AREAS.
–ARMORCAST P6000485 W/A6000484–H ELSEWHERE
PROVIDE ALL METER BOXES WITH KNOCKOUTS FOR RADIO–READ HEADS.

INSTALL NEW BALL VALVE, RISER & COUPLING FOR RELOCATED/REPLACED METER ASSEMBLIES.

ANGLE BALL VALVE W/HANDLE (NO PADLOCK TABS). INSTALL PRIOR TO INSTALLATION OF WATER METER

NOTES:

1. SUBSTITUTES FOR ANY MATERIALS SHOWN SHALL BE APPROVED BY THE CITY ENGINEER.
2. ALL PIPE AND BACKFILL ZONES SHALL BE BACKFILLED USING 3/4" MINUS GRANULAR MATERIAL AND COMPACTED TO 92% MAX. DENSITY DETERMINED BY AASHTO T–180.
3. SET FRONT OF METER BOX 30–INCHES BEHIND BACK OF CURB LOCATION FOR CURBLINE WALKS.
4. METER BOX SHALL BE CENTERED OVER THE COMPLETED METER ASSEMBLY.
5. MIN. SIZE COMMERCIAL SERVICES SHALL BE 2–INCH.
6. FAR SIDE COMMERCIAL SERVICES SHALL BE INSTALLED IN A 4" MIN DIA SCHED 40 PVC SLEEVE WHICH BEGINS 2' FROM MAIN AND EXTENDS TO EDGE OF METER BOX.

LAST REVISION DATE: MAY 2016	
TYPICAL 1" WATER SERVICE (COPPER SERVICE PIPE) (NTS)	
PHILOMATH, OR	DETAIL NO. 515

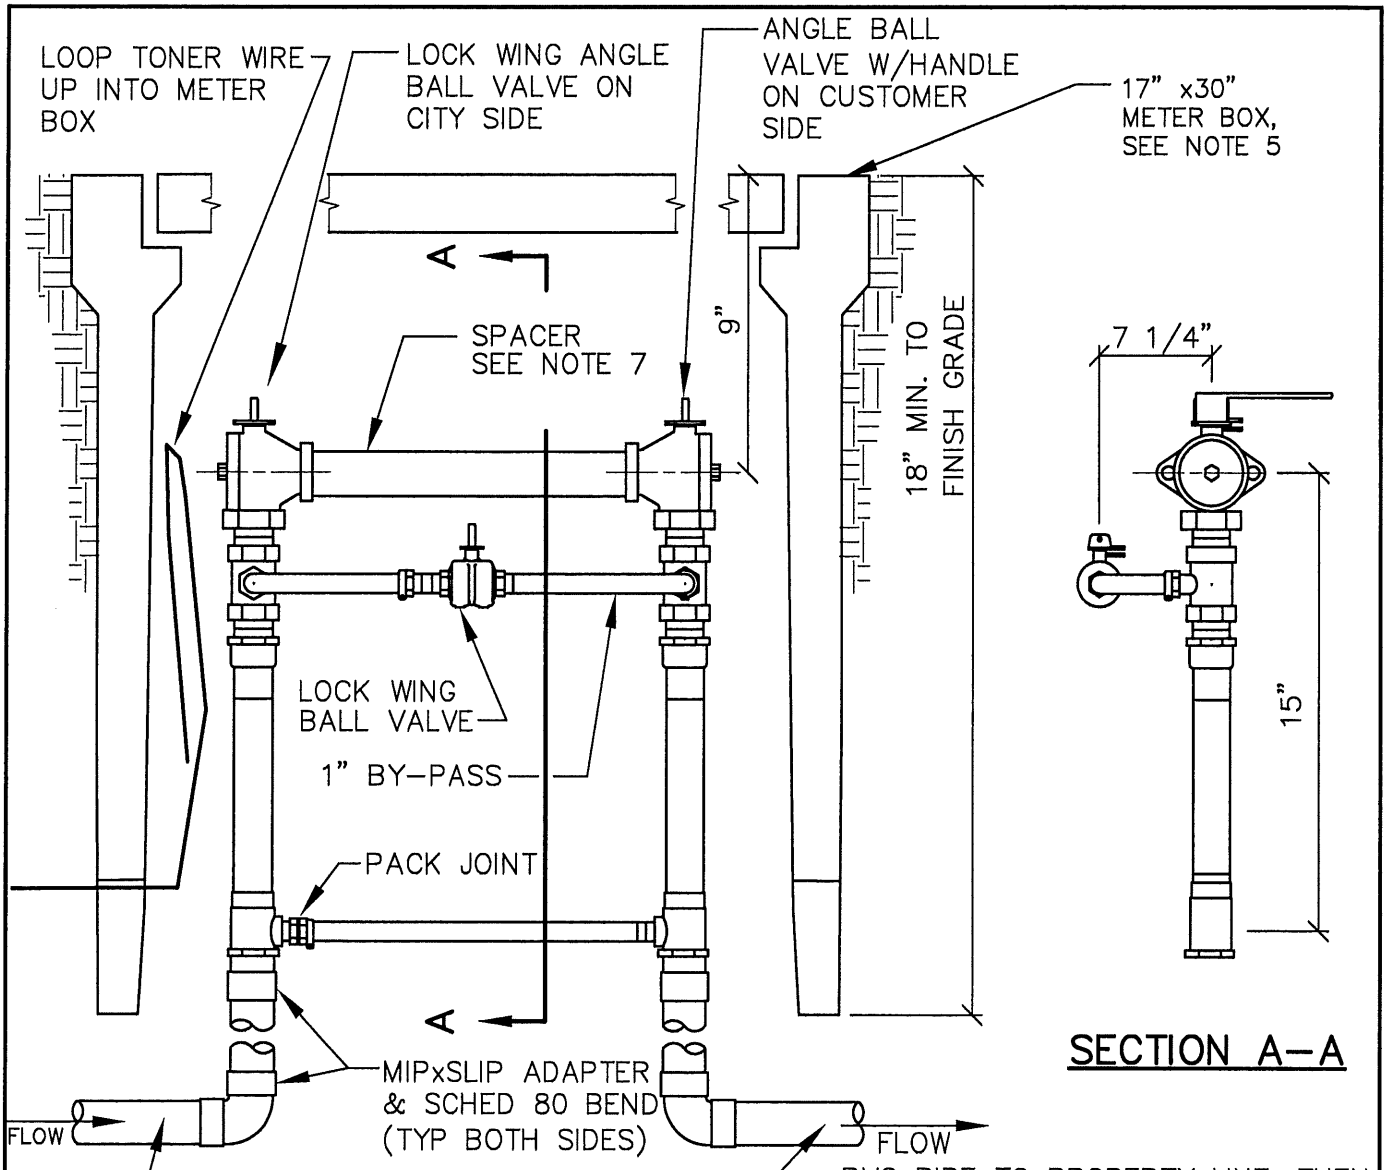

NOTES:

1. METERSET TO BE FORD COPPERSETTER #VBB87-15HB-11-77-NL (2") WITH HIGH LOCKING BYPASS OR APPROVED EQUAL.
2. SUBSTITUTES FOR ANY MATERIALS SHOWN SHALL BE APPROVED BY THE CITY ENGINEER.
3. ALL PIPE AND BACKFILL ZONES SHALL BE BACKFILLED USING 3/4" MINUS GRANULAR MATERIAL AND COMPACTED TO 92% OPTIMUM DENSITY PER AASHTO T-180.
4. SET FRONT OF METER BOX 30-INCHES BEHIND BACK OF CURB LOCATION FOR CURBLINE WALKS. NO METERS ON PRIVATE PROPERTY WITHOUT A RECORDED EASEMENT.
5. METER BOX SHALL BE CENTERED OVER THE COMPLETED METER ASSEMBLY. WATER METER BOX PER PWDS 5.8.h.1:
   - -ARMORCAST P600534x18 W/LID A6001643-H (A6000482T) IN TRAFFIC AREAS.
   - -ARMORCAST P600534x18 W/LID A6001643-H (A6000482) ELSEWHERE
6. WATER METER SET BY CITY FORCES. COPPERSETTER, METER BOX, & ALL FITTINGS PROVIDED BY DEVELOPER.
7. INSTALL METER SETTER WITH CITY-SUPPLIED SPACING SPOOL. THE CITY WILL RECOVER THE SPOOL WHEN INSTALLING THE METER.
8. **THREADED FEMALE PVC FITTINGS ARE NOT ALLOWED.**
9. PROVIDE ALL METER BOXES WITH KNOCKOUTS FOR RADIO READ HEADS.

NOTE: PER ORS 92.044(7), METER BOXES MUST BE SET 1' MINIMUM CLEAR FROM ANY SURVEY MONUMENT

LAST REVISION DATE:	
MAY 2016	

2" METER SET W/ LOCKING HIGH BY-PASS (SCHED 80 PVC SERVICE PIPE)

(NTS)

PHILOMATH, OR	DETAIL NO. 516

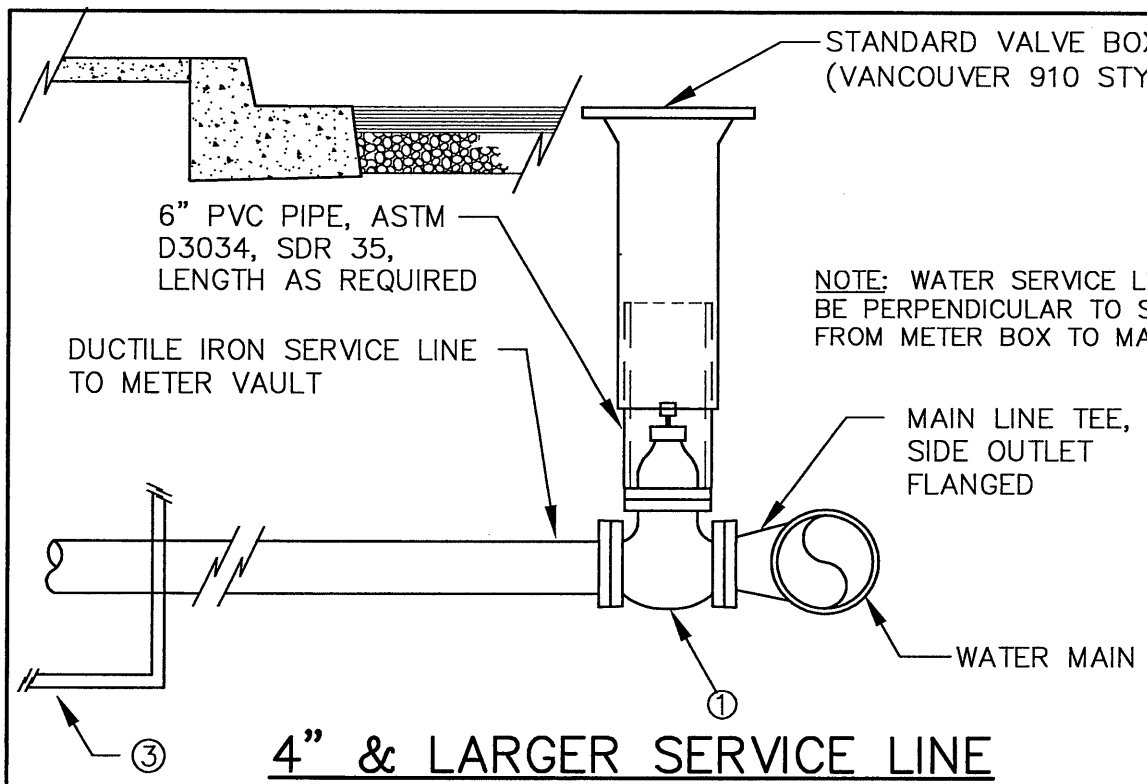

4" & LARGER SERVICE LINE

NOTE: WATER SERVICE LINE TO BE PERPENDICULAR TO STREET FROM METER BOX TO MAINLINE.

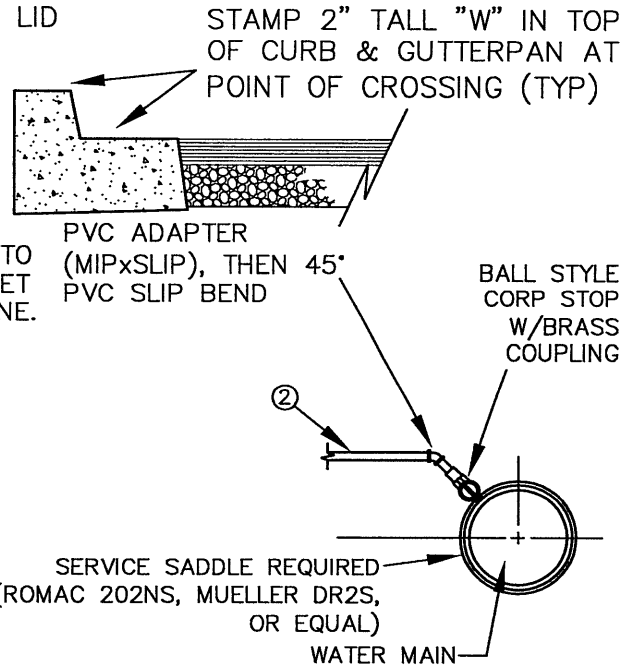

2" SERVICE

MATERIALS

① FLG X FLG RESILIENT WEDGE GATE VALVE PER AWWA C-509. 4" DIA. OR SERVICE SIZE, WHICHEVER IS LARGER. EPOXY COATED PER AWWA C-550.

② 2" SCHEDULE 80 PVC PIPE (30" MIN COVER TO METER). **FEMALE THREADED PVC FITTINGS ARE NOT ALLOWED.** SEE DETAIL 516 FOR CONFIGURATION AT METER BOX.

③ CONCRETE METER BOX FOR 3" & LARGER METER SHALL BE A METER VAULT PER PUBLIC WORKS REQUIREMENTS, METER ASSEMBLY W/LOCKING BYPASS PER PUBLIC WORKS REQUIREMENTS. SEE DETAIL 516 FOR 2" SERVICES.

NOTES

1. SUBSTITUTES FOR ANY MATERIAL SHOWN SHALL BE APPROVED BY THE CITY ENGINEER.
2. ALL PIPE AND STRUCTURE ZONES SHALL BE BACKFILLED USING 3/4" MINUS GRANULAR MATERIAL AND COMPACTED TO 95% MAX DENSITY AS DETERMINED BY ASHTO T-180.
3. METER BOX SHALL BE CENTERED OVER THE COMPLETED METER AND FITTING ASSEMBLY.
4. CUSTOMER SHALL INSTALL AN APPROVED BACKFLOW PREVENTION DEVICE ON PRIVATE PROPERTY IMMEDIATELY DOWNSTREAM OF WATER METER IF REQUIRED BY PUBLIC WORKS.
5. FAR SIDE 2" COMMERCIAL SERVICES SHALL BE INSTALLED IN A 4" MIN DIA SCHED 40 PVC SLEEVE WHICH BEGINS 2' FROM MAIN AND EXTENDS TO BACK OF FAR SIDE SIDEWALK.
7. METER BOXES IN TRAFFIC OR GRAVEL AREAS SHALL PROVIDED WITH A 12" WIDE x 6" MIN. THICK CONCRETE COLLAR ALL AROUND THE METER BOX.

TAPPING REQUIREMENTS, 2" AND LARGER SERVICE (SCHED 80 PVC SERVICE PIPE)

(NTS)

PHILOMATH, OR

DETAIL NO. 517

LAST REVISION DATE: JUNE 2016

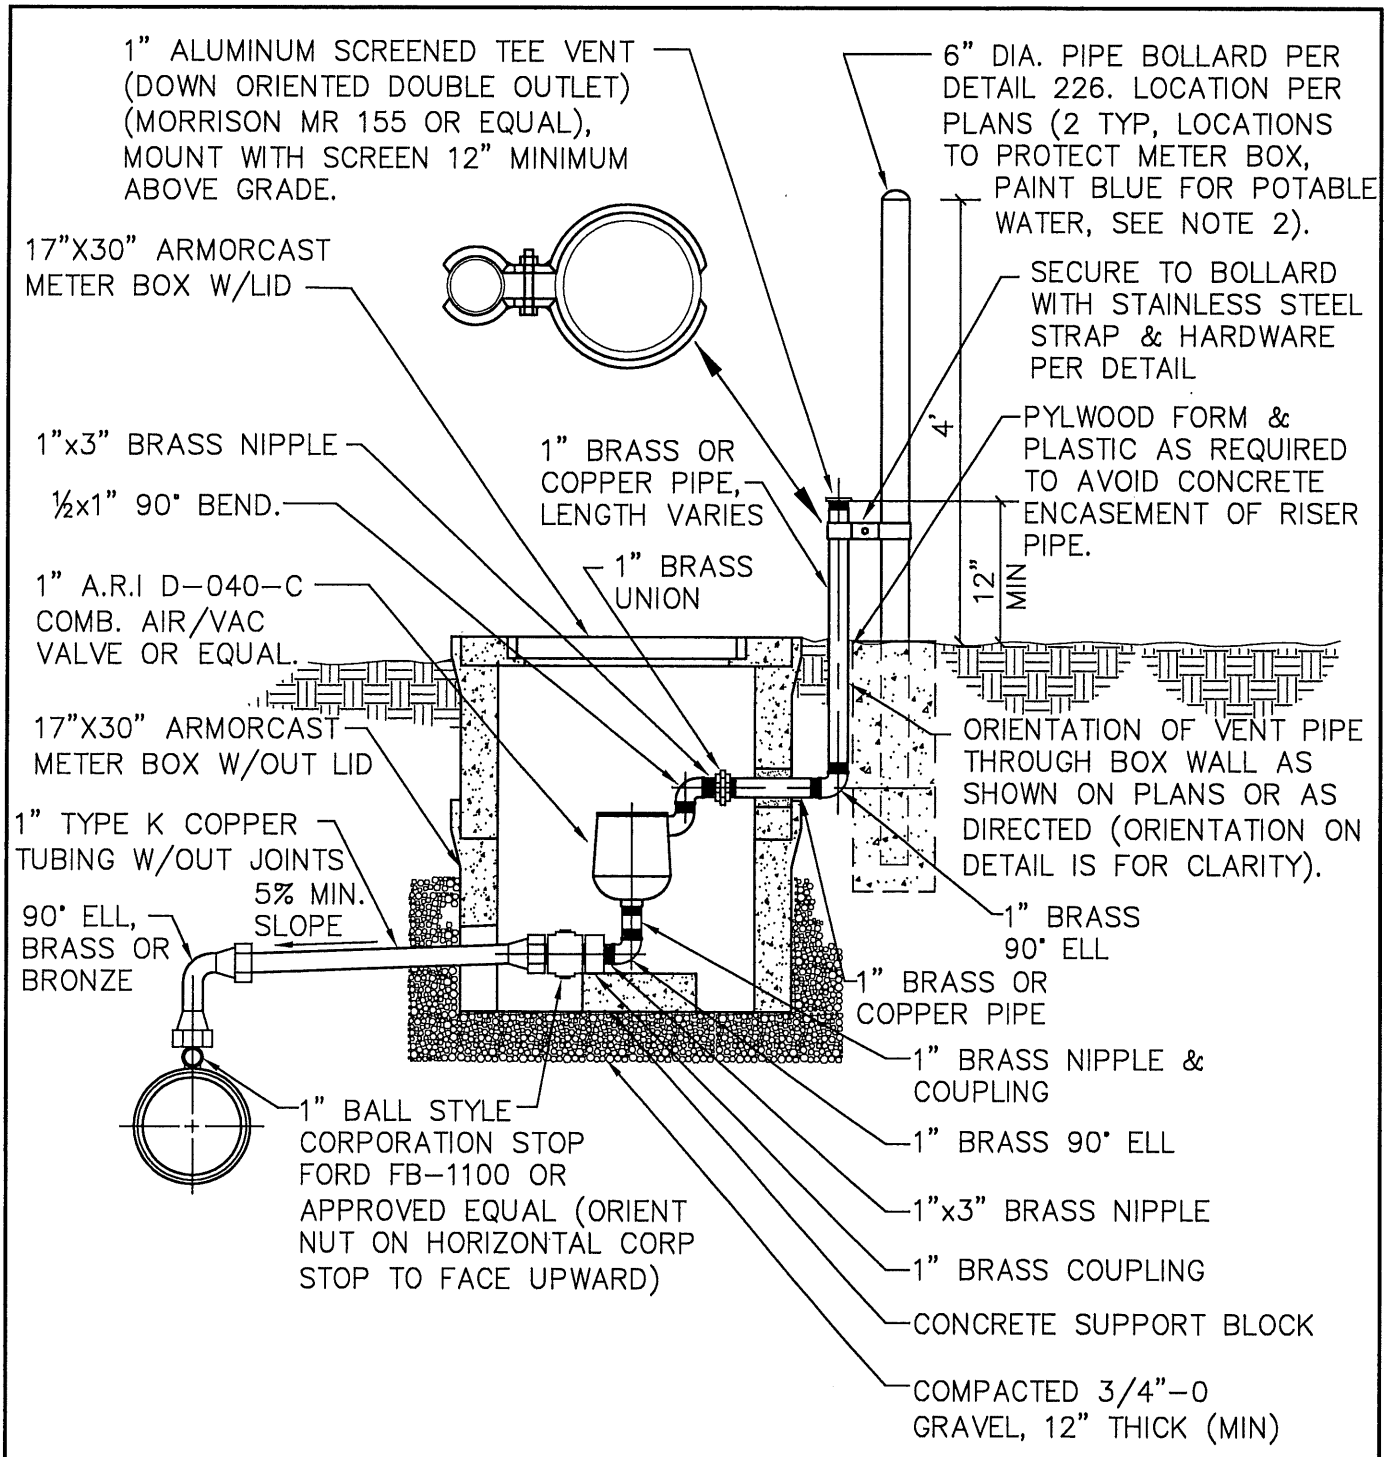

NOTES:

1. RISER SHALL BE PROTECTED FROM VEHICULAR OR PEDESTRIAN TRAFFIC AS APPROVED BY THE CITY ENGINEER & PUBLIC WORKS.
2. PAINT BOLLARD & TOP SAFETY BLUE FOR POTABLE WATER APPLICATIONS.
3. WHERE ARV ASSEMBLIES ARE INSTALLED ADJACENT TO FENCES, BOLLARDS SHALL BE SET 3" MIN CLEAR FROM FENCE UNLESS OTHERWISE APPROVED BY PROPERTY OWNER.
4. EXACT LOCATION OF RISER PENTRATION THROUGH BOX & BOLLARDS TO BE VERIFIED IN FIELD WITH CITY ENGINEER & PUBLIC WORKS PRIOR TO RISER & BOLLARD INSTALLATION.

LAST REVISION DATE: AUG 2013	JO #

1" COMBINATION AIR RELEASE VALVE (CARV)

(NTS)

PHILOMATH, OR	DETAIL NO. 518

NOTES:

1. METER VAULT & PIPING SHALL CONFORM TO REQUIREMENTS OF ALL PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.

2. METER VAULT SHALL BE PLACED WITHIN RIGHT-OF-WAY UNLESS OTHERWISE APPROVED (RECORDED EASEMENT TO THE CITY REQUIRED FOR ANY METER ON PRIVATE PROPERTY).

3. ALL MATERIALS (EXCEPT THE METER) SHALL BE FURNISHED & INSTALLED BY THE CONTRACTOR. THE CONTRACTOR SHALL INSTALL A TEMPORARY SPACER SPOOL BETWEEN METER ISOLATION VALVES FOR TESTING. THE TEMPORARY SPOOL SHALL MATCH THE LENGTH OF THE ACTUAL METER TO BE PROVIDED BY THE CITY.

4. PIPING INSIDE VAULT & THROUGH WALLS TO BE CL 52 DUCTILE IRON, EXCEPT AS OTHERWISE SHOWN.

5. METER WILL BE SUPPLIED BY THE CITY, BUT SHALL BE INSTALLED (AFTER PRESSURE & OTHER TESTING OF METER VAULT PIPING) BY THE CONTRACTOR UNDER CITY INSPECTION AND APPROVAL (MOUNT TOUCH READ HEAD ON HINGE SIDE OF ACCESS HATCH AT CITY APPROVED LOCATION).

6. ISOLATION VALVES IN METER VAULT SHALL BE NON-RISING STEM GATE VALVE (EPOXY COATED) WITH 2-INCH SQUARE OPERATING NUT.

7. ALL MJ CONNECTIONS (INCLUDING BYPASS LINE FITTINGS) SHALL BE ASSEMBLED WITH RETAINER GLANDS (EBBA MEGA-LUGS OR APPROVED EQUAL).

8. ALL PIPE OPENINGS SHALL BE CORE DRILLED (REGARDLESS OF PRESENCE OF 'KNOCKOUTS'), AND SEALED WATERTIGHT WITH NON-SHRINK GROUT.

9. PIPE SUPPORTS SHALL BE GALVANIZED STANDON S89 OR APPROVED EQUAL AT EACH ISOLATION AND BYPASS VALVE.

10. METER VAULT TO BE UTILITY VAULT 687-WA OR APPROVED EQUAL, CONFORMING WITH ASTM C-857. PROVIDE ALUMINUM ANGLE FRAME HATCH (48"x 72" MIN) BY SYRACUSE CASTINGS WEST OR APPROVED EQUAL (HATCH COVER TOP TO BE SAND BLASTED NON-SLIP).
    (1) TO BE 300 PSF PEDESTRIAN RATED WHERE LID IS SET MIN. OF 9" ABOVE GRADE.
    (2) TO BE H-20 RATED IF LID IS LESS THAN 9" ABOVE GRADE, OR IF LOCATED IN TRAFFIC AREA.

11. METER VAULT SHALL BE PROVIDED WITH AN OSHA APPROVED GALVANIZED STEEL LADDER AND ALUMINUM LADDER SAFETY EXTENSION. ATTACH TO VAULT WITH STAINLESS STEEL BOLTS.

12. CONTRACTOR TO INSTALL SUMP PUMP (5 GPM MIN) WITH 120V POWER SUPPLY, ALONG WITH PRIVATE POWER SOURCE. SUMP PUMP POWER SHALL CONFORM WITH NEC REQUIREMENTS AND BE INSTALLED IN SCHEDULE 40 CONDUIT.

13. SUMP PUMP DISCHARGE PIPE SHALL BE 2-INCH SCHEDULE 40 PVC, PROVIDED WITH UNION (FOR PUMP REMOVAL), CHECK VALVE AND ISOLATION BALL VALVE. CONNECT DISCHARGE TO GRAVITY STORM DRAIN OR CURB WEEP HOLE (AT LOCATION APPROVED BY PUBLIC WORKS).

14. SUMP TO BE 18" ROUND PVC OR CONCRETE PIPE. PROVIDE FRP SUMP GRATE WITH CUTOUT FOR DISCHARGE PIPING (GRATE TO BE REMOVABLE WITHOUT DISASSEMBLING DISCHARGE PIPING).

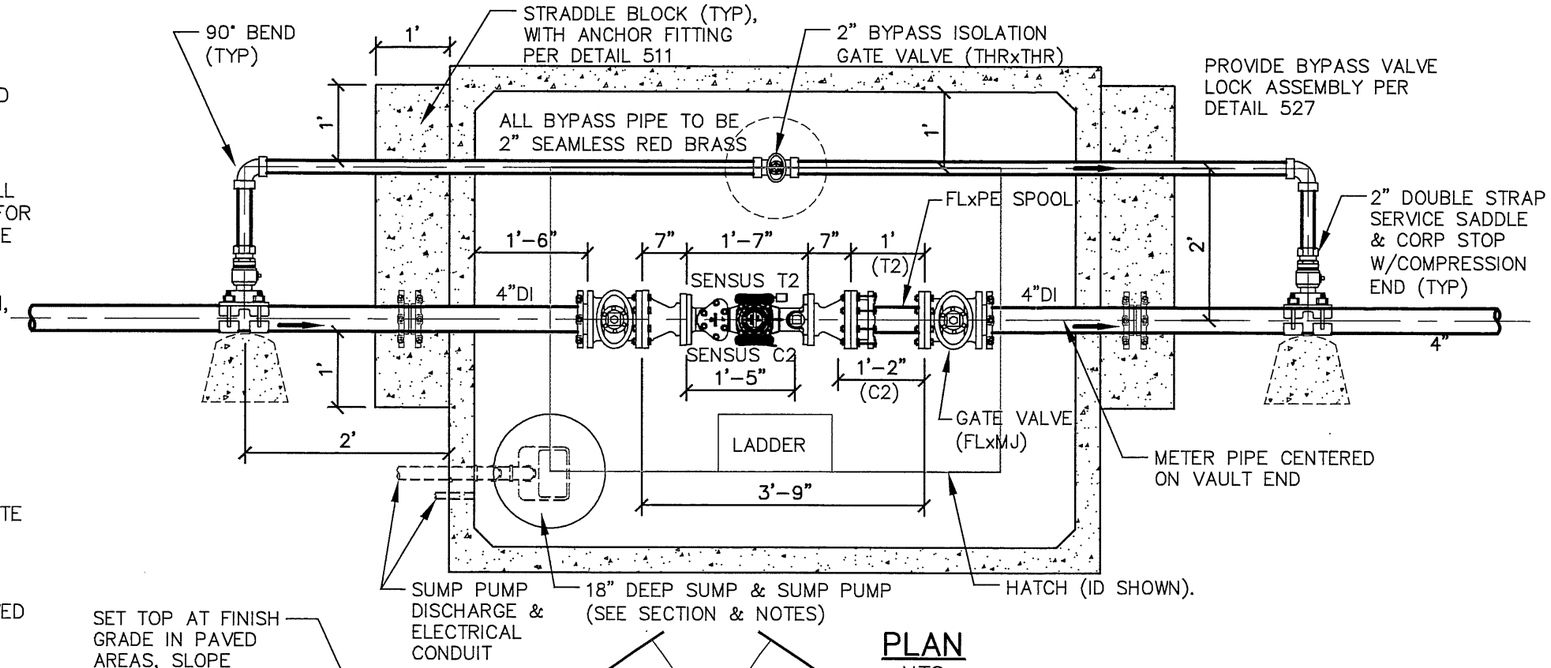

PLAN
NTS

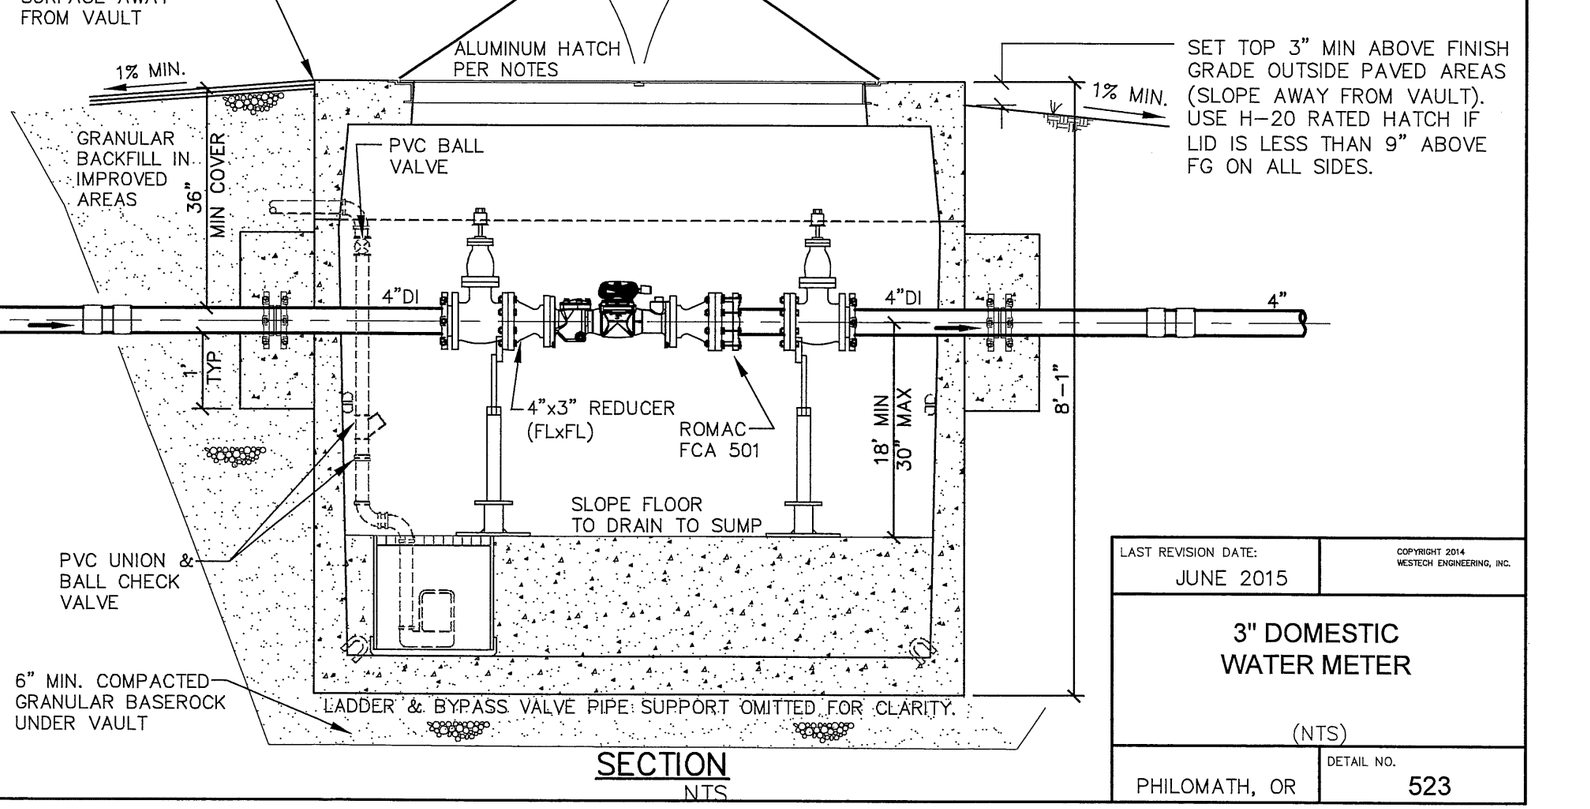

SECTION
NTS

LAST REVISION DATE: JUNE 2015

3" DOMESTIC WATER METER

(NTS)

PHILOMATH, OR

DETAIL NO. 523

NOTES:

1. METER VAULT & PIPING SHALL CONFORM TO REQUIREMENTS OF ALL PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.

2. METER VAULT SHALL BE PLACED WITHIN RIGHT-OF-WAY UNLESS OTHERWISE APPROVED (RECORDED EASEMENT TO THE CITY REQUIRED FOR ANY METER ON PRIVATE PROPERTY).

3. ALL MATERIALS (EXCEPT THE METER) SHALL BE FURNISHED & INSTALLED BY THE CONTRACTOR. THE CONTRACTOR SHALL INSTALL A TEMPORARY SPACER SPOOL BETWEEN METER ISOLATION VALVES FOR TESTING. THE TEMPORARY SPOOL SHALL MATCH THE LENGTH OF THE ACTUAL METER TO BE PROVIDED BY THE CITY.

4. PIPING INSIDE VAULT & THROUGH WALLS TO BE CL 52 DUCTILE IRON, EXCEPT AS OTHERWISE SHOWN.

5. METER WILL BE SUPPLIED BY THE CITY, BUT SHALL BE INSTALLED (AFTER PRESSURE & OTHER TESTING OF METER VAULT PIPING) BY THE CONTRACTOR UNDER CITY INSPECTION AND APPROVAL (MOUNT TOUCH READ HEAD ON HINGE SIDE OF ACCESS HATCH AT CITY APPROVED LOCATION).

6. ISOLATION VALVES IN METER VAULT SHALL BE NON-RISING STEM GATE VALVE (EPOXY COATED) WITH 2-INCH SQUARE OPERATING NUT.

7. ALL MJ CONNECTIONS (INCLUDING BYPASS LINE FITTINGS) SHALL BE ASSEMBLED WITH RETAINER GLANDS (EBBA MEGA-LUGS OR APPROVED EQUAL).

8. ALL PIPE OPENINGS SHALL BE CORE DRILLED (REGARDLESS OF PRESENCE OF 'KNOCKOUTS'), AND SEALED WATERTIGHT WITH NON-SHRINK GROUT.

9. PIPE SUPPORTS SHALL BE GALVANIZED STANDON S89 OR APPROVED EQUAL AT EACH ISOLATION AND BYPASS VALVE.

10. METER VAULT TO BE UTILITY VAULT 687-WA OR APPROVED EQUAL, CONFORMING WITH ASTM C-857. PROVIDE ALUMINUM ANGLE FRAME HATCH (48"x 72" MIN) BY SYRACUSE CASTINGS WEST OR APPROVED EQUAL (HATCH COVER TOP TO BE SAND BLASTED NON-SLIP).
    (1) TO BE 300 PSF PEDESTRIAN RATED WHERE LID IS SET MIN. OF 9" ABOVE GRADE.
    (2) TO BE H-20 RATED IF LID IS LESS THAN 9" ABOVE GRADE, OR IF LOCATED IN TRAFFIC AREA.

11. METER VAULT SHALL BE PROVIDED WITH AN OSHA APPROVED GALVANIZED STEEL LADDER AND ALUMINUM LADDER SAFETY EXTENSION. ATTACH TO VAULT WITH STAINLESS STEEL BOLTS.

12. CONTRACTOR TO INSTALL SUMP PUMP (5 GPM MIN) WITH 120V POWER SUPPLY, ALONG WITH PRIVATE POWER SOURCE. SUMP PUMP POWER SHALL CONFORM WITH NEC REQUIREMENTS AND BE INSTALLED IN SCHEDULE 40 CONDUIT.

13. SUMP PUMP DISCHARGE PIPE SHALL BE 2-INCH SCHEDULE 40 PVC, PROVIDED WITH UNION (FOR PUMP REMOVAL), CHECK VALVE AND ISOLATION BALL VALVE. CONNECT DISCHARGE TO GRAVITY STORM DRAIN OR CURB WEEP HOLE (AT LOCATION APPROVED BY PUBLIC WORKS).

14. SUMP TO BE 18" ROUND PVC OR CONCRETE PIPE. PROVIDE FRP SUMP GRATE WITH CUTOUT FOR DISCHARGE PIPING (GRATE TO BE REMOVABLE WITHOUT DISASSEMBLING DISCHARGE PIPING).

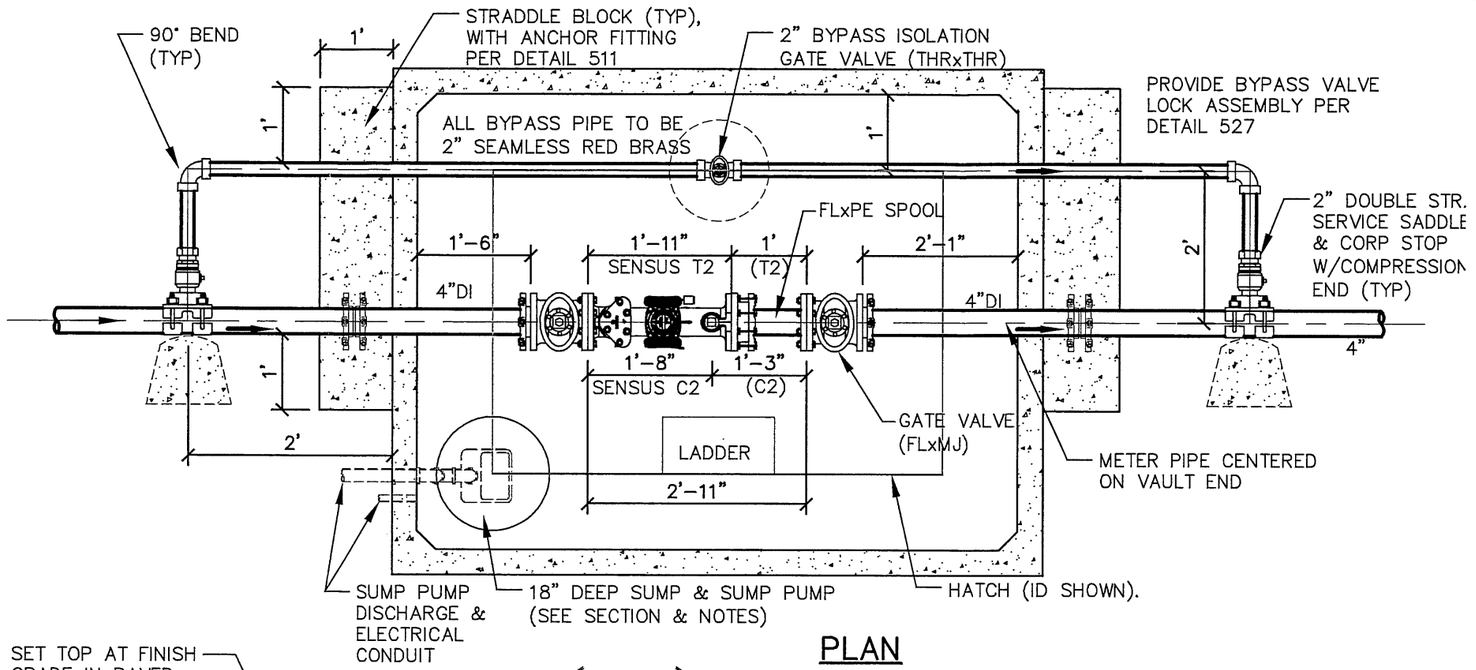

PLAN
NTS

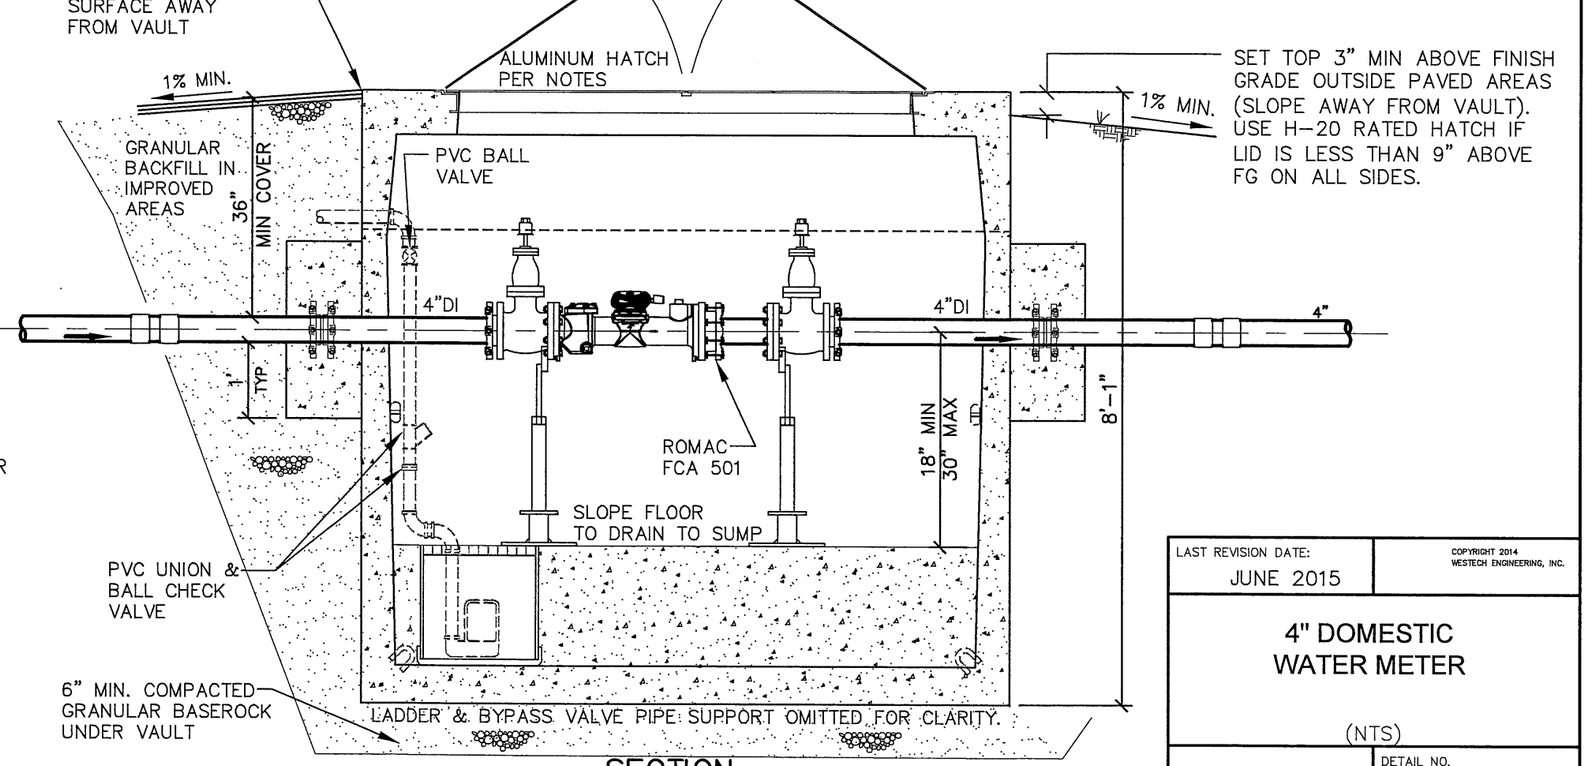

SECTION
NTS

LAST REVISION DATE: JUNE 2015

4" DOMESTIC WATER METER

(NTS)

PHILOMATH, OR

DETAIL NO. 524

NOTES:

1. METER VAULT & PIPING SHALL CONFORM TO REQUIREMENTS OF ALL PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.

2. METER VAULT SHALL BE PLACED WITHIN RIGHT-OF-WAY UNLESS OTHERWISE APPROVED (RECORDED EASEMENT TO THE CITY REQUIRED FOR ANY METER ON PRIVATE PROPERTY).

3. ALL MATERIALS (EXCEPT THE METER) SHALL BE FURNISHED & INSTALLED BY THE CONTRACTOR. THE CONTRACTOR SHALL INSTALL A TEMPORARY SPACER SPOOL BETWEEN METER ISOLATION VALVES FOR TESTING. THE TEMPORARY SPOOL SHALL MATCH THE LENGTH OF THE ACTUAL METER TO BE PROVIDED BY THE CITY.

4. PIPING INSIDE VAULT & THROUGH WALLS TO BE CL 52 DUCTILE IRON, EXCEPT AS OTHERWISE SHOWN.

5. METER WILL BE SUPPLIED BY THE CITY, BUT SHALL BE INSTALLED (AFTER PRESSURE & OTHER TESTING OF METER VAULT PIPING) BY THE CONTRACTOR UNDER CITY INSPECTION AND APPROVAL (MOUNT TOUCH READ HEAD ON HINGE SIDE OF ACCESS HATCH AT CITY APPROVED LOCATION).

6. ISOLATION VALVES IN METER VAULT SHALL BE NON-RISING STEM GATE VALVE (EPOXY COATED) WITH 2-INCH SQUARE OPERATING NUT.

7. ALL MJ CONNECTIONS (INCLUDING BYPASS LINE FITTINGS) SHALL BE ASSEMBLED WITH RETAINER GLANDS (EBBA MEGA-LUGS OR APPROVED EQUAL).

8. ALL PIPE OPENINGS SHALL BE CORE DRILLED (REGARDLESS OF PRESENCE OF 'KNOCKOUTS'), AND SEALED WATERTIGHT WITH NON-SHRINK GROUT.

9. PIPE SUPPORTS SHALL BE GALVANIZED STANDON S89 OR APPROVED EQUAL AT EACH ISOLATION AND BYPASS VALVE.

10. METER VAULT TO BE UTILITY VAULT 687-WA OR APPROVED EQUAL, CONFORMING WITH ASTM C-857. PROVIDE ALUMINUM ANGLE FRAME HATCH (48"x 72" MIN) BY SYRACUSE CASTINGS WEST OR APPROVED EQUAL (HATCH COVER TOP TO BE SAND BLASTED NON-SLIP).
    (1) TO BE 300 PSF PEDESTRIAN RATED WHERE LID IS SET MIN. OF 9" ABOVE GRADE.
    (2) TO BE H-20 RATED IF LID IS LESS THAN 9" ABOVE GRADE, OR IF LOCATED IN TRAFFIC AREA.

11. METER VAULT SHALL BE PROVIDED WITH AN OSHA APPROVED GALVANIZED STEEL LADDER AND ALUMINUM LADDER SAFETY EXTENSION. ATTACH TO VAULT WITH STAINLESS STEEL BOLTS.

12. CONTRACTOR TO INSTALL SUMP PUMP (5 GPM MIN) WITH 120V POWER SUPPLY, ALONG WITH PRIVATE POWER SOURCE. SUMP PUMP POWER SHALL CONFORM WITH NEC REQUIREMENTS AND BE INSTALLED IN SCHEDULE 40 CONDUIT.

13. SUMP PUMP DISCHARGE PIPE SHALL BE 2-INCH SCHEDULE 40 PVC, PROVIDED WITH UNION (FOR PUMP REMOVAL), CHECK VALVE AND ISOLATION BALL VALVE. CONNECT DISCHARGE TO GRAVITY STORM DRAIN OR CURB WEEP HOLE (AT LOCATION APPROVED BY PUBLIC WORKS).

14. SUMP TO BE 18" ROUND PVC OR CONCRETE PIPE. PROVIDE FRP SUMP GRATE WITH CUTOUT FOR DISCHARGE PIPING (GRATE TO BE REMOVABLE WITHOUT DISASSEMBLING DISCHARGE PIPING).

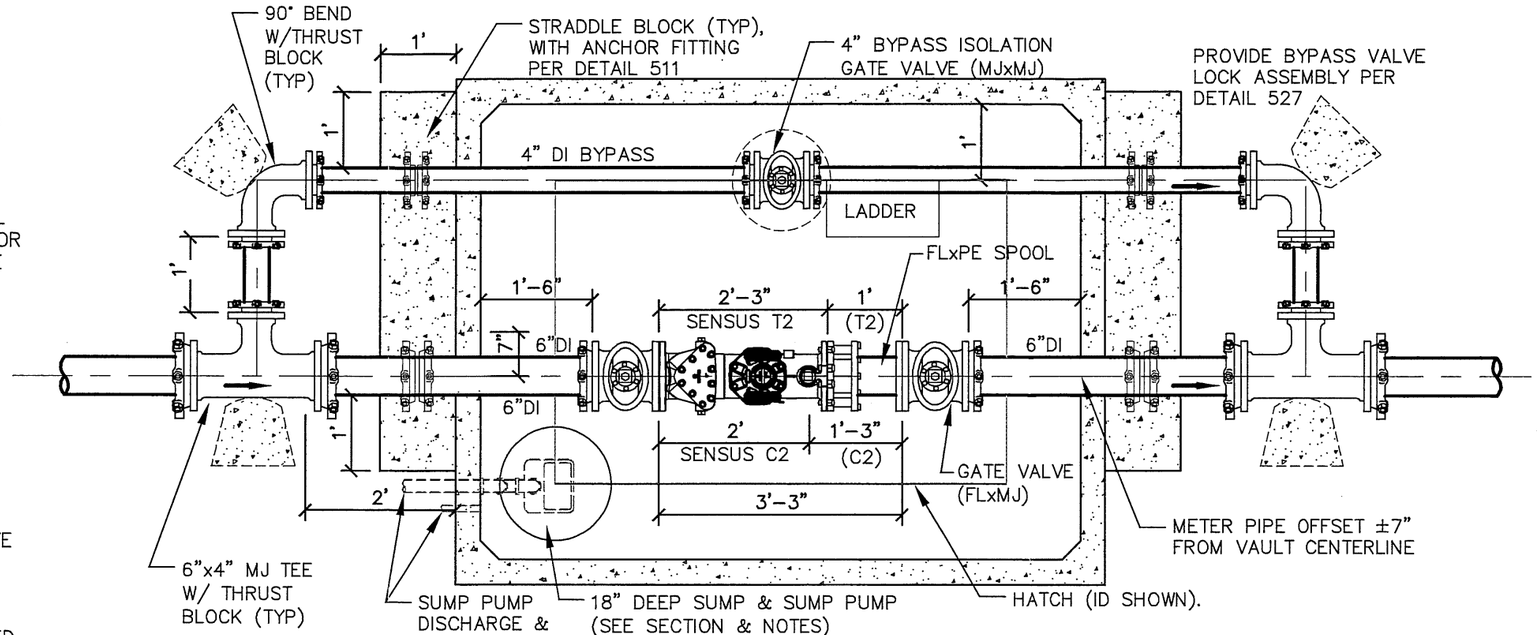

PLAN
NTS

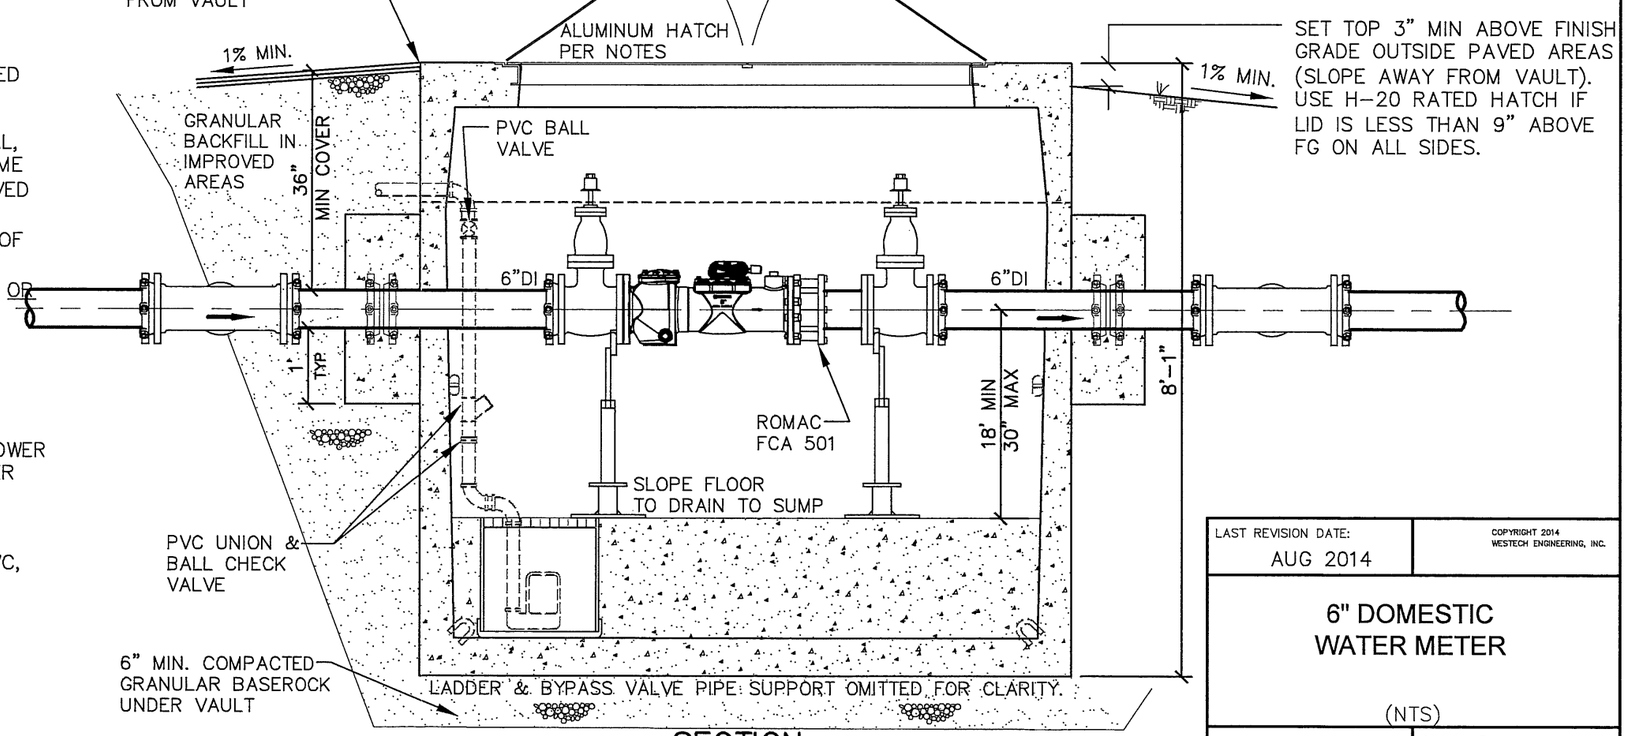

SECTION
NTS

LAST REVISION DATE: AUG 2014	
6" DOMESTIC WATER METER (NTS)	
PHILOMATH, OR	DETAIL NO. 525

NOTES:

1. METER VAULT & PIPING SHALL CONFORM TO REQUIREMENTS OF ALL PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.

2. METER VAULT SHALL BE PLACED WITHIN RIGHT-OF-WAY UNLESS OTHERWISE APPROVED (RECORDED EASEMENT TO THE CITY REQUIRED FOR ANY METER ON PRIVATE PROPERTY).

3. ALL MATERIALS (EXCEPT THE METER) SHALL BE FURNISHED & INSTALLED BY THE CONTRACTOR. THE CONTRACTOR SHALL INSTALL A TEMPORARY SPACER SPOOL BETWEEN METER ISOLATION VALVES FOR TESTING. THE TEMPORARY SPOOL SHALL MATCH THE LENGTH OF THE ACTUAL METER TO BE PROVIDED BY THE CITY.

4. PIPING INSIDE VAULT & THROUGH WALLS TO BE CL 52 DUCTILE IRON, EXCEPT AS OTHERWISE SHOWN.

5. METER WILL BE SUPPLIED BY THE CITY, BUT SHALL BE INSTALLED (AFTER PRESSURE & OTHER TESTING OF METER VAULT PIPING) BY THE CONTRACTOR UNDER CITY INSPECTION AND APPROVAL (MOUNT TOUCH READ HEAD ON HINGE SIDE OF ACCESS HATCH AT CITY APPROVED LOCATION).

6. ISOLATION VALVES IN METER VAULT SHALL BE NON-RISING STEM GATE VALVE (EPOXY COATED) WITH 2-INCH SQUARE OPERATING NUT.

7. ALL MJ CONNECTIONS (INCLUDING BYPASS LINE FITTINGS) SHALL BE ASSEMBLED WITH RETAINER GLANDS (EBBA MEGA-LUGS OR APPROVED EQUAL).

8. ALL PIPE OPENINGS SHALL BE CORE DRILLED (REGARDLESS OF PRESENCE OF 'KNOCKOUTS'), AND SEALED WATERTIGHT WITH NON-SHRINK GROUT.

9. PIPE SUPPORTS SHALL BE GALVANIZED STANDON S89 OR APPROVED EQUAL AT EACH ISOLATION AND BYPASS VALVE.

10. METER VAULT TO BE UTILITY VAULT 687-WA OR APPROVED EQUAL, CONFORMING WITH ASTM C-857. PROVIDE ALUMINUM ANGLE FRAME HATCH (48"x 72" MIN) BY SYRACUSE CASTINGS WEST OR APPROVED EQUAL (HATCH COVER TOP TO BE SAND BLASTED NON-SLIP).
    (1) TO BE 300 PSF PEDESTRIAN RATED WHERE LID IS SET MIN. OF 9" ABOVE GRADE.
    (2) TO BE H-20 RATED IF LID IS LESS THAN 9" ABOVE GRADE, OR IF LOCATED IN TRAFFIC AREA.

11. METER VAULT SHALL BE PROVIDED WITH AN OSHA APPROVED GALVANIZED STEEL LADDER AND ALUMINUM LADDER SAFETY EXTENSION. ATTACH TO VAULT WITH STAINLESS STEEL BOLTS.

12. CONTRACTOR TO INSTALL SUMP PUMP (5 GPM MIN) WITH 120V POWER SUPPLY, ALONG WITH PRIVATE POWER SOURCE. SUMP PUMP POWER SHALL CONFORM WITH NEC REQUIREMENTS AND BE INSTALLED IN SCHEDULE 40 CONDUIT.

13. SUMP PUMP DISCHARGE PIPE SHALL BE 2-INCH SCHEDULE 40 PVC, PROVIDED WITH UNION (FOR PUMP REMOVAL), CHECK VALVE AND ISOLATION BALL VALVE. CONNECT DISCHARGE TO GRAVITY STORM DRAIN OR CURB WEEP HOLE (AT LOCATION APPROVED BY PUBLIC WORKS).

14. SUMP TO BE 18" ROUND PVC OR CONCRETE PIPE. PROVIDE FRP SUMP GRATE WITH CUTOUT FOR DISCHARGE PIPING (GRATE TO BE REMOVABLE WITHOUT DISASSEMBLING DISCHARGE PIPING).

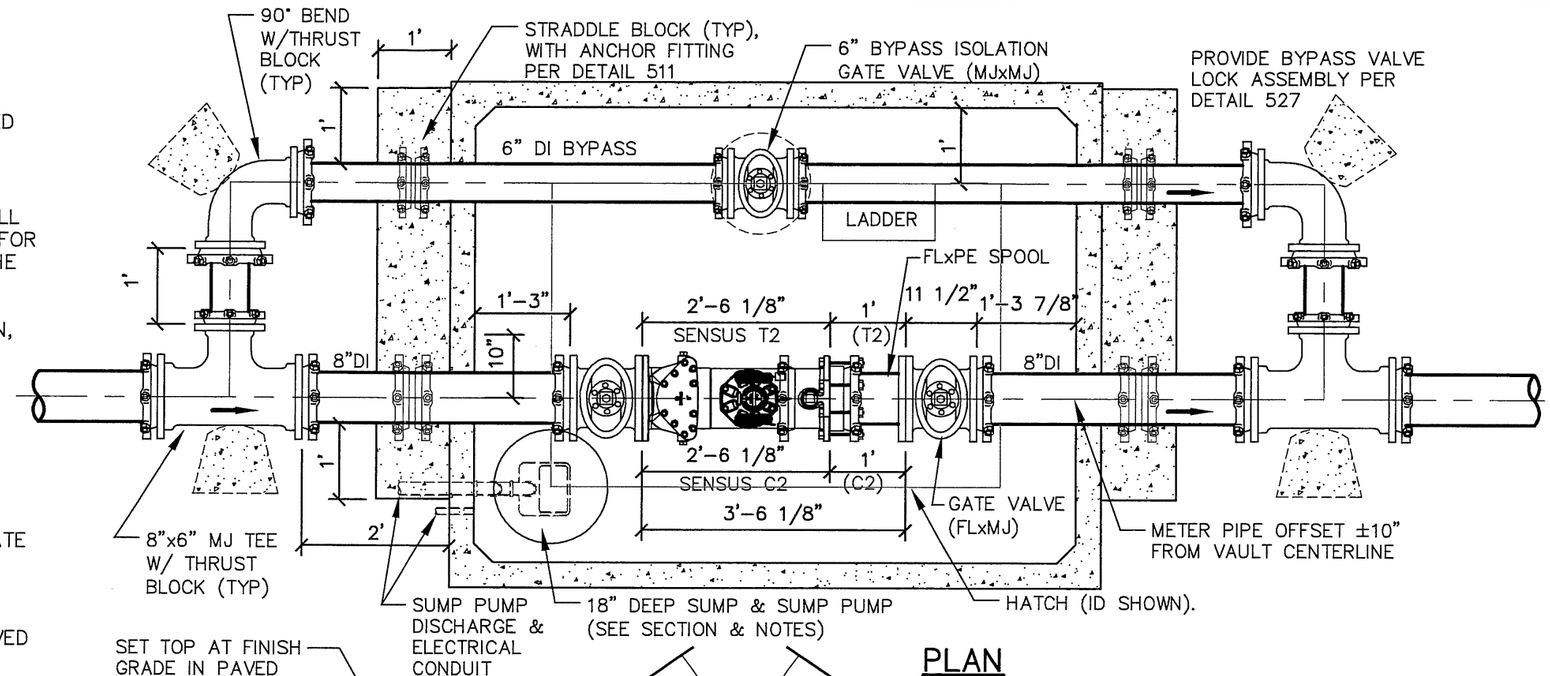

PLAN
NTS

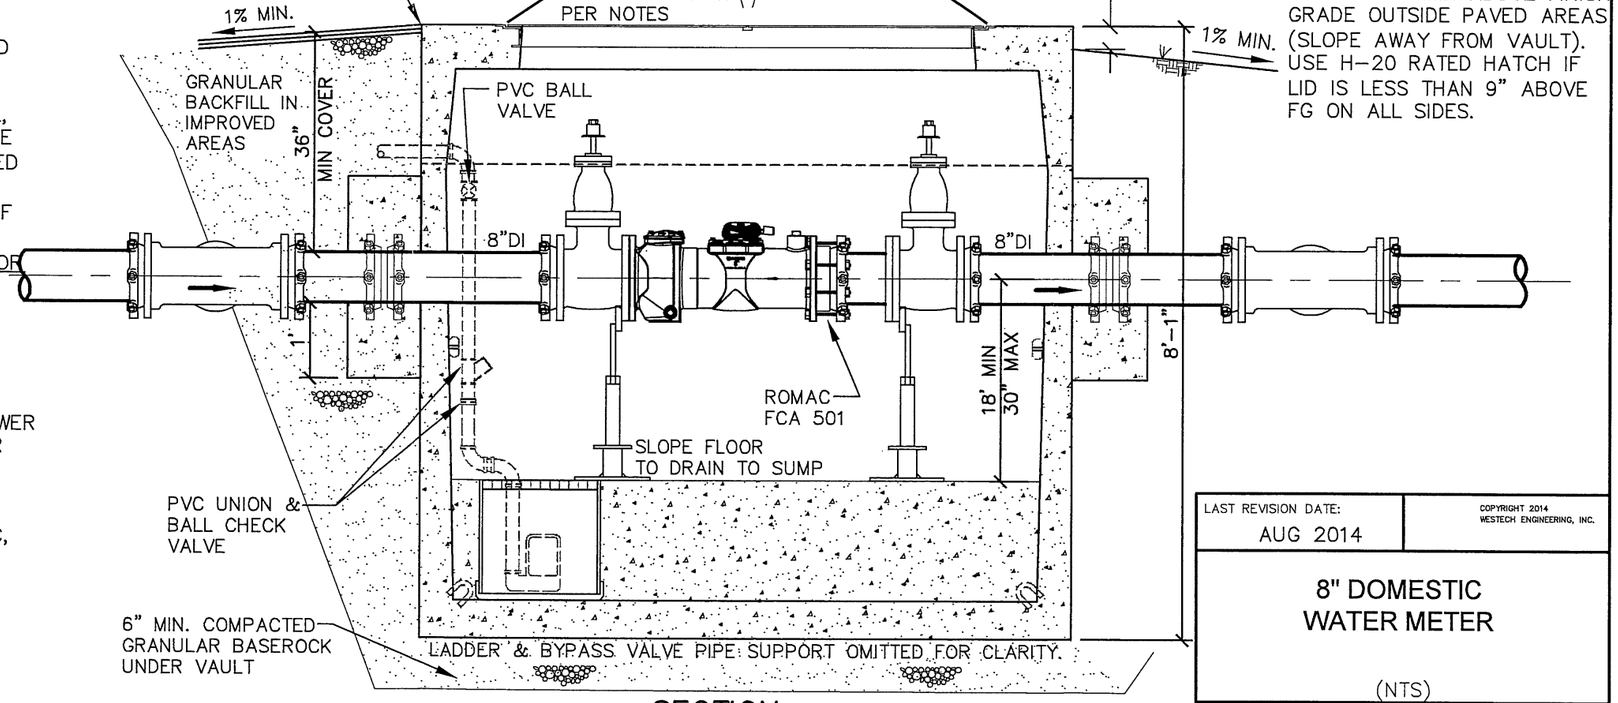

SECTION
NTS

LAST REVISION DATE: AUG 2014

8" DOMESTIC WATER METER

(NTS)

PHILOMATH, OR

DETAIL NO. 526

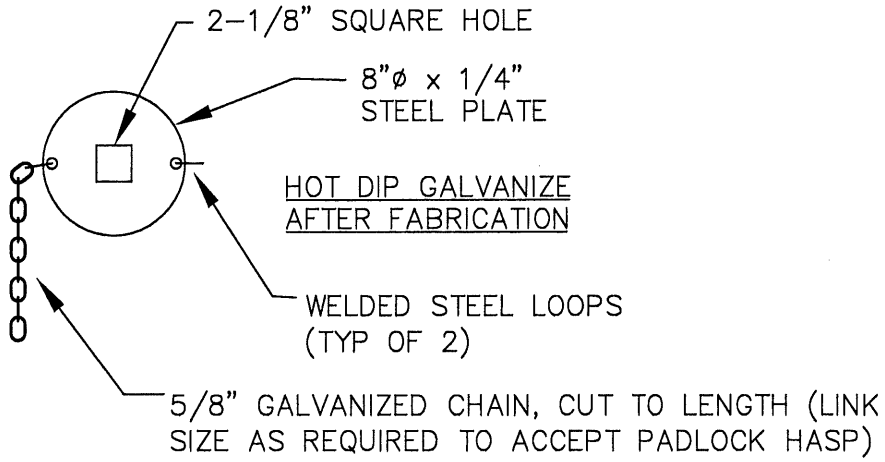

TOP VIEW

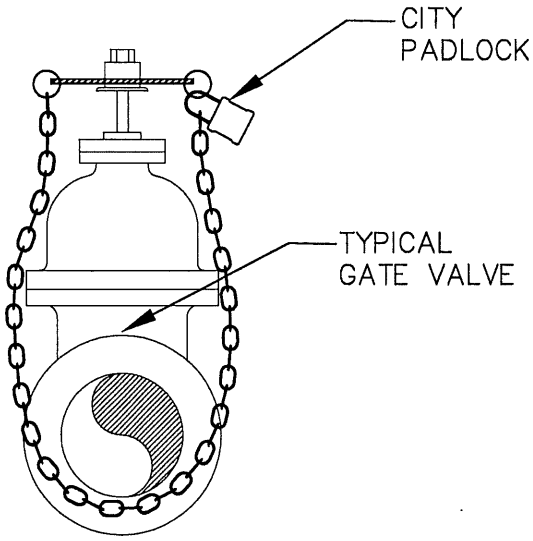

SIDE VIEW

NOTES:

1. UNLESS OTHERWISE REQUIRED BY PUBLIC WORKS, PROVIDE ONE LOCK ASSEMBLY PER VAULT.
2. VALVE LOCK ASSEMBLY TO BE HOT DIP GALVANIZED AFTER FABRICATION.

LAST REVISION DATE: AUG 2014	JO #
WATER METER VAULT BYPASS VALVE LOCK (NTS)	
PHILOMATH, OR	DETAIL NO. 527

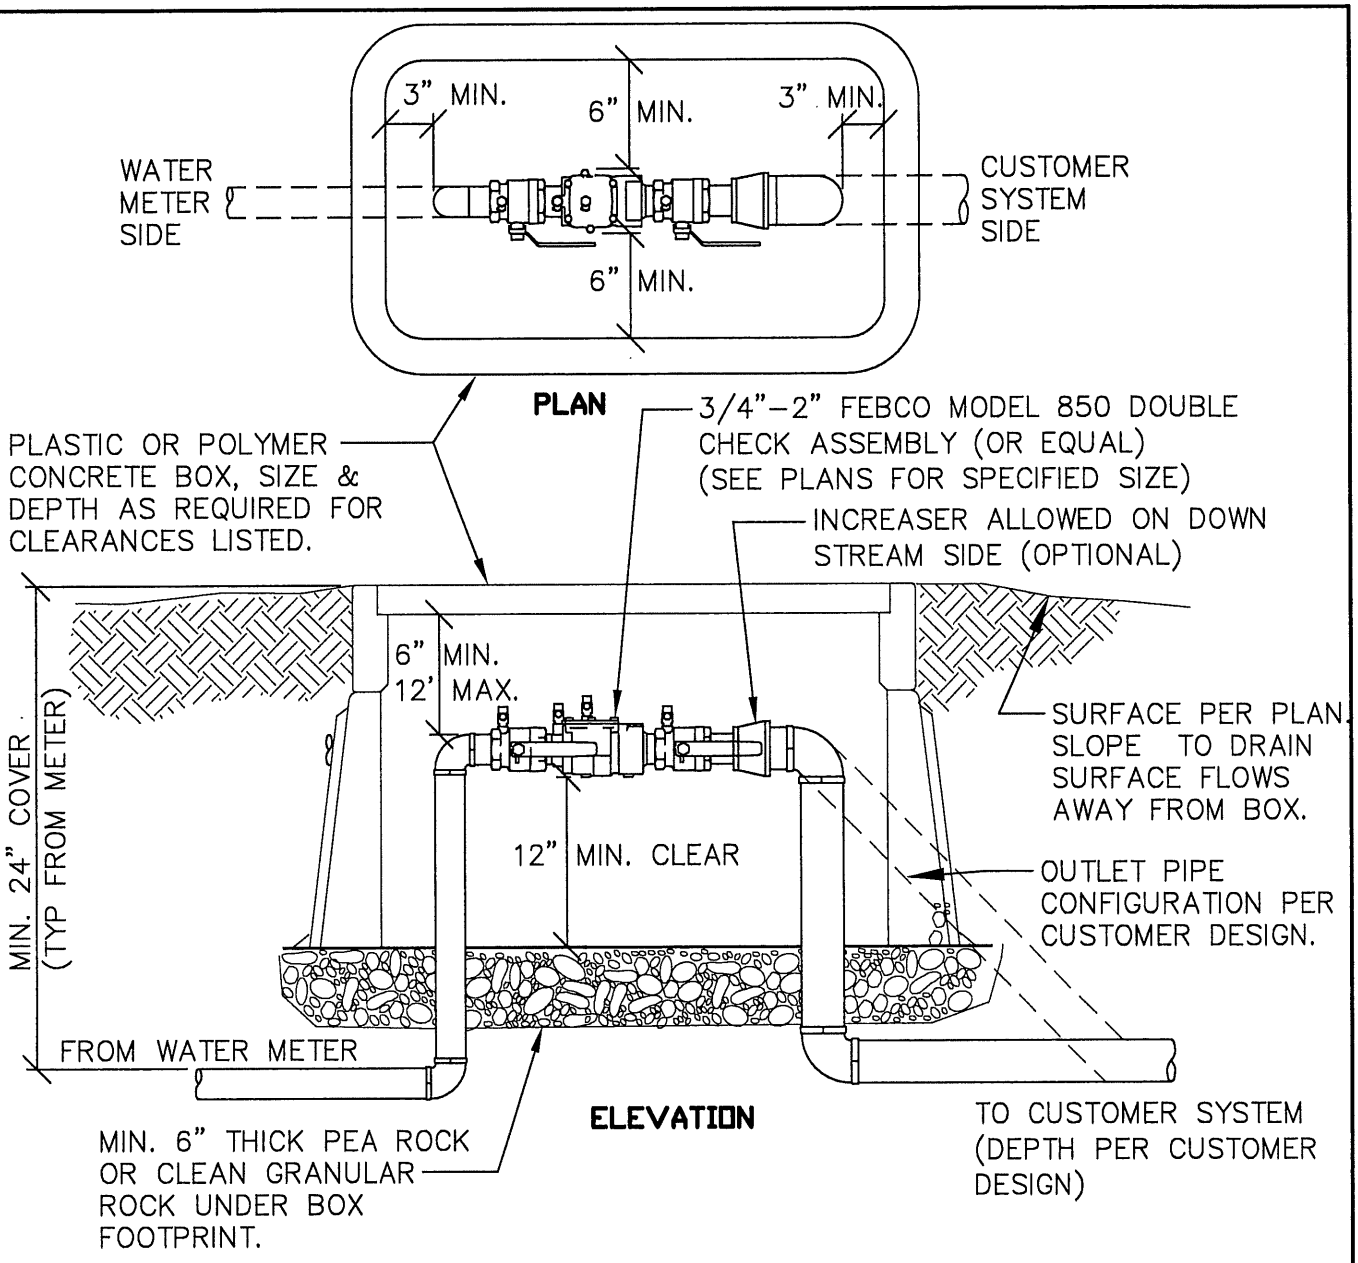

NOTES:

1. VERIFY THE ENCLOSURE/BOX DIMENSIONS & DEPTH ARE ADEQUATE FOR CLEARANCES SHOWN, BASED ON THE SIZE OF THE DCA AND FITTINGS ACTUALLY PROVIDED & INSTALLED.
2. ENCLOSURE/BOX SHALL BE CENTERED OVER THE COMPLETED DOUBLE CHECK ASSEMBLY.
3. PER OAR 333-61-0071, DCA SHALL NOT BE SUBJECT TO CONTINUOUS IMMERSION.
4. DCA's SHALL BE INSTALLED ABOVE THE 100 YEAR FLOOD LEVEL UNLESS OTHERWISE APPROVED IN WRITING BY THE PUBLIC WORKS DIRECTOR.
5. BYPASS LINES AROUND DOUBLE CHECK ASSEMBLIES ARE NOT ALLOWED.
6. DCA's SHALL BE PROVIDED WITH BRASS OR PLASTIC PLUGS IN ALL TEST PORTS.
7. DCA SHALL BE LOCATED ON PRIVATE PROPERTY, AND SHALL NOT BE INSTALLED IN SIDEWALKS OR AREAS SUBJECT TO VEHICULAR TRAFFIC.
8. THE PROPERTY OWNER IS RESPONSIBLE TO MAINTAIN A MINIMUM OF 3 FEET OF MAINTENANCE ACCESS WORKING CLEARANCE AROUND DCA ENCLOSURES/BOXES.
9. PRIOR TO REQUESTING APPROVAL OR FINAL INSPECTION BY THE CITY, CONTRACTOR SHALL HAVE DCA TESTED, AND COPIES OF TEST REPORTS PROVIDED TO PUBLIC WORKS.
10. PROPERTY OWNER SHALL BE RESPONSIBLE TO PROVIDE FREEZE PROTECTION DURING COLD WEATHER PERIODS AS NECESSARY.

LAST REVISION DATE:	JO #
AUG 2015	STANDARD

2" AND SMALLER DOUBLE CHECK VALVE ASSEMBLY (DCA)

(NTS)

PHILOMATH, OR	DETAIL NO. 531

PAD MOUNTED FIBERGLASS INSULATED ENCLOSURE W/HEATER, HOT BOX MODEL AS SHOWN ON TABLE (OR APPROVED EQUIVALENT). ANCHOR ENCLOSURE TO CONCRETE PAD PER MANUFACTURER'S REQUIREMENTS.

RPBA DIAMETER	HOT BOX MODEL
1"	HB1
1½"	HB1
2"	HB1.5

NOTE: VERIFY HB SIZE FOR OTHER MODEL RPBA DEVICES.

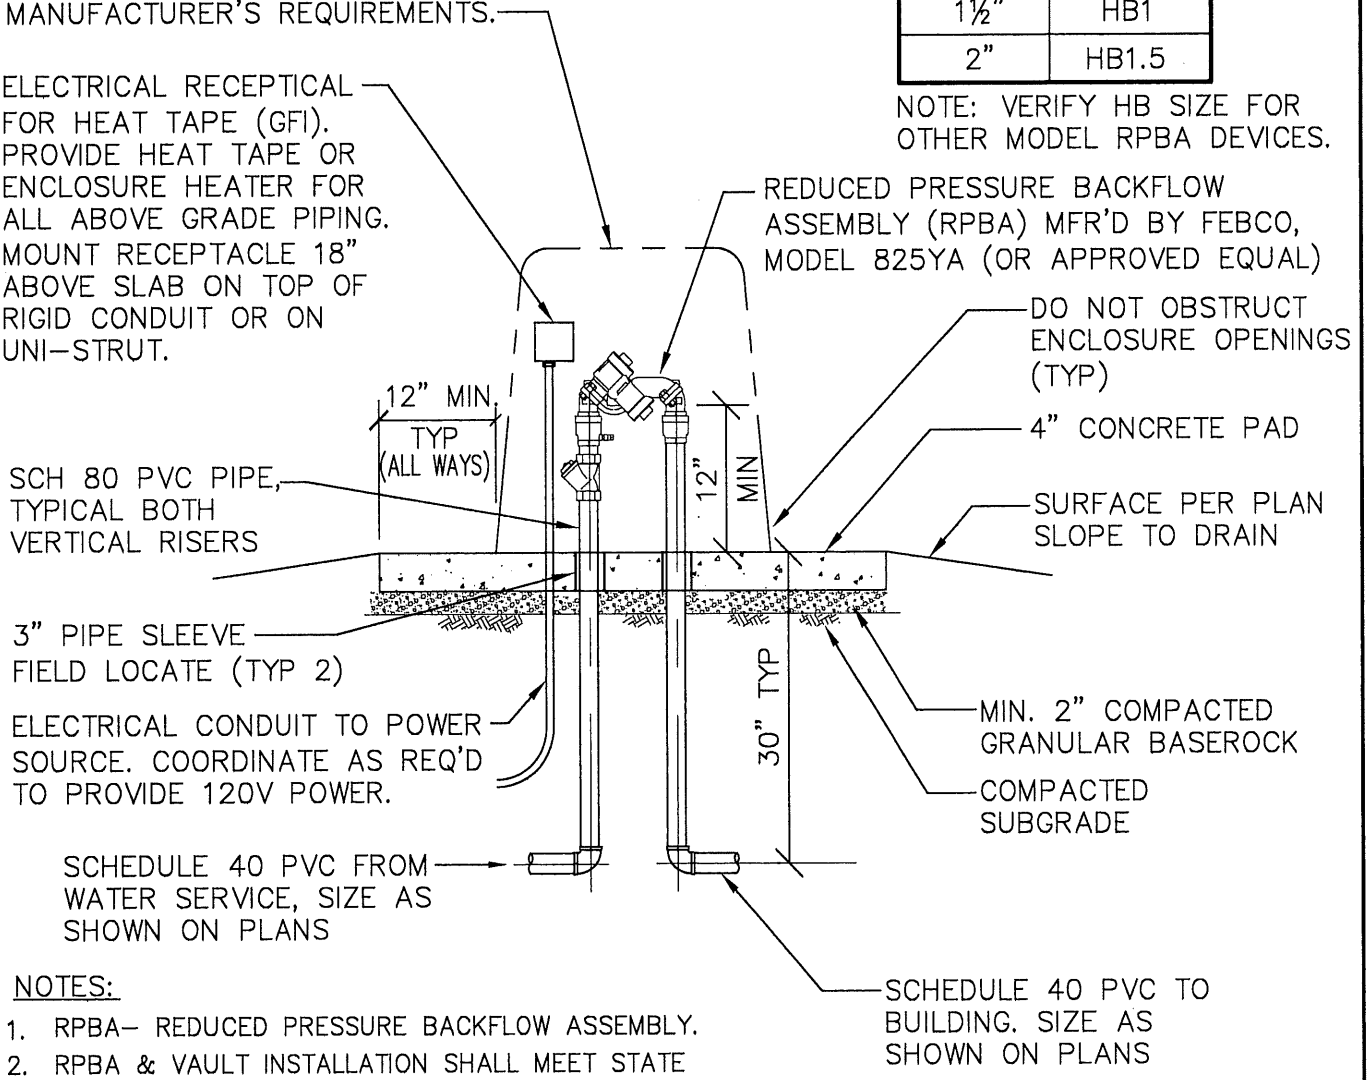

NOTES:

1. RPBA– REDUCED PRESSURE BACKFLOW ASSEMBLY.
2. RPBA & VAULT INSTALLATION SHALL MEET STATE OF OREGON, DEPARTMENT OF HUMAN RESOURCES, HEALTH DIVISION REQUIREMENTS.
3. CONTRACTOR SHALL HAVE RPBA TESTED AND CERTIFIED PRIOR TO APPROVAL BY THE CITY.
4. RPBA & VAULT SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
5. VAULTS SHALL HAVE A MINIMUM OF 3' CLEARANCE FROM ALL OTHER VAULTS OR STRUCTURES.
6. VERIFY ENCLOSURE DIMENSIONS ARE ADEQUATE FOR CLEARANCE BASED ON HEIGHT OF REDUCED PRESSURE ASSEMBLY.
7. ENCLOSURE SHALL BE CENTERED OVER THE COMPLETED REDUCED PRESSURE BACKFLOW ASSEMBLY.
8. POWER SHALL BE INSTALLED IN SCHEDULE 40 RIGID CONDUIT PER NEC REQUIREMENTS.
9. ALL CONCRETE SHALL HAVE 3,300 PSI COMPRESSIVE STRENGTH @ 28 DAYS.
10. HOT BOX DRAINAGE OPENINGS SHALL NOT BE OBSTRUCTED BY GRADING OR PLANTINGS.
11. RPBA SHALL BE INSTALLED A MIN. OF 12 INCHES ABOVE THE 100-YEAR FLOOD ELEVATION AS DETERMINED BY FEMA.

LAST REVISION DATE:	JO #
OCT 2014	STANDARD

2" AND SMALLER REDUCED PRESSURE BACKFLOW ASSEMBLY

(NTS)

PHILOMATH, OR	DETAIL NO. 541

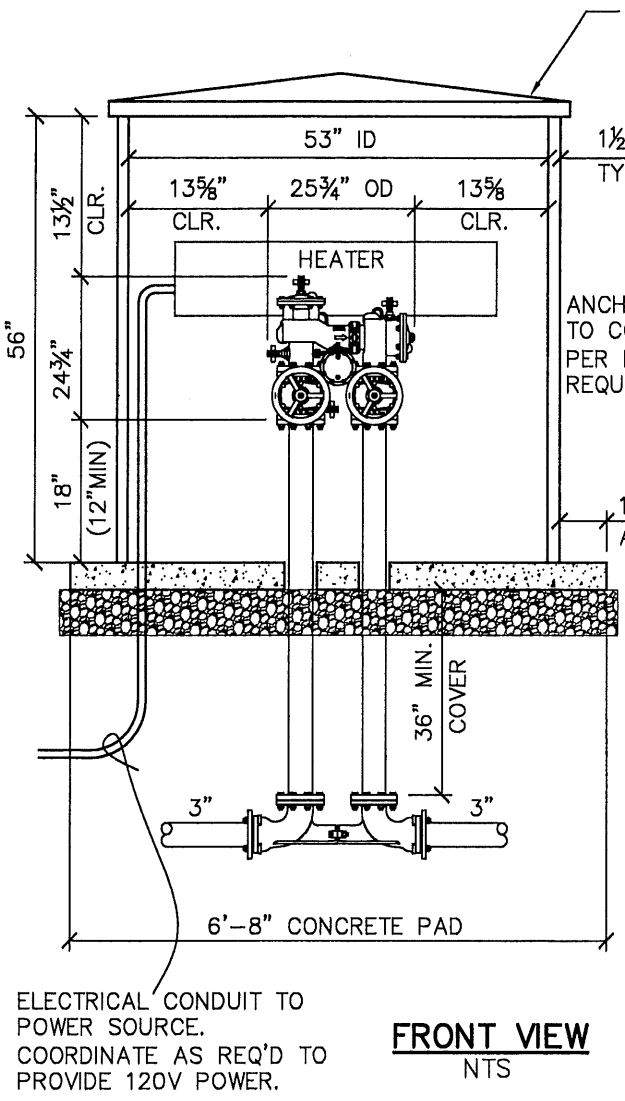

FRONT VIEW
NTS

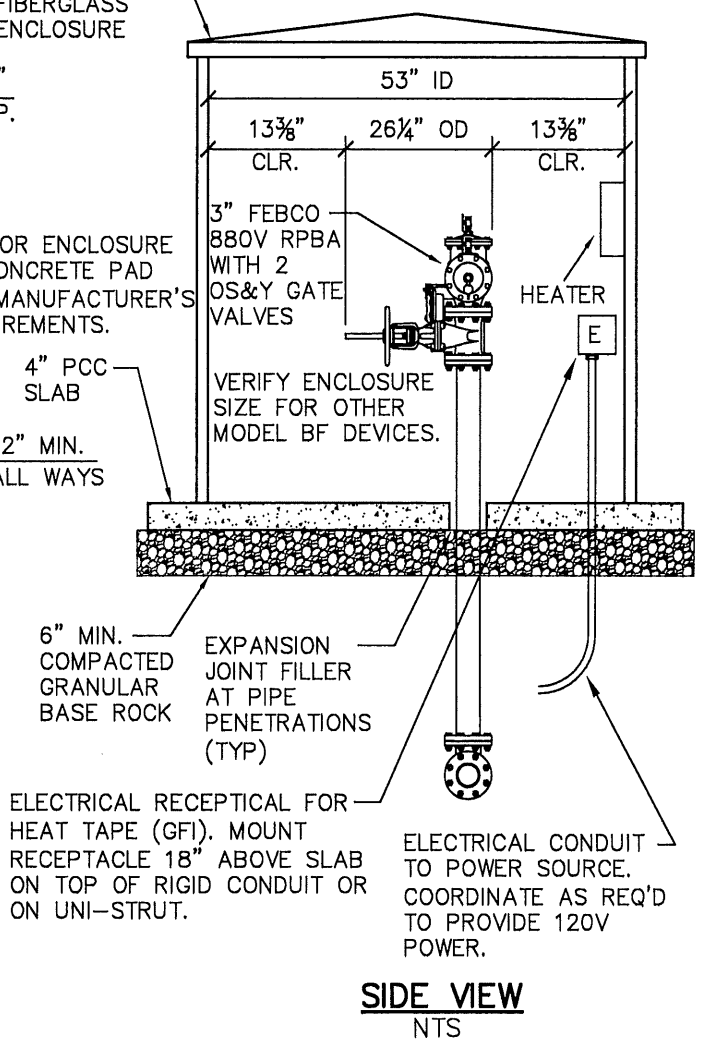

SIDE VIEW
NTS

NOTES:

1. RPBA– REDUCED PRESSURE BACKFLOW ASSEMBLY.
2. RPBA & VAULT INSTALLATION SHALL MEET STATE OF OREGON, DEPARTMENT OF HUMAN RESOURCES, HEALTH DIVISION REQUIREMENTS.
3. CONTRACTOR SHALL HAVE RPBA TESTED AND CERTIFIED PRIOR TO APPROVAL BY THE CITY.
4. RPBA & VAULT SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
5. VAULTS SHALL HAVE A MINIMUM OF 3' CLEARANCE FROM ALL OTHER VAULTS OR STRUCTURES.
6. VERIFY ENCLOSURE DIMENSIONS ARE ADEQUATE FOR CLEARANCE BASED ON HEIGHT OF REDUCED PRESSURE ASSEMBLY.
7. ENCLOSURE SHALL BE CENTERED OVER THE COMPLETED REDUCED PRESSURE BACKFLOW ASSEMBLY.
8. POWER SHALL BE INSTALLED IN SCHEDULE 40 RIGID CONDUIT PER NEC REQUIREMENTS.
9. ALL CONCRETE SHALL HAVE 3,300 PSI COMPRESSIVE STRENGTH @ 28 DAYS.
10. HOT BOX DRAINAGE OPENINGS SHALL NOT BE OBSTRUCTED BY GRADING OR PLANTINGS.
11. RPBA SHALL BE INSTALLED A MIN. OF 12 INCHES ABOVE THE 100-YEAR FLOOD ELEVATION AS DETERMINED BY FEMA.
12. FINISH GRADE TO SLOPE AWAY FROM VAULT AT MIN. SLOPE = 2%

LAST REVISION DATE: OCT 2014	JO #
3" REDUCED PRESSURE ASSEMBLY (NTS)	
PHILOMATH, OR	DETAIL NO. 543

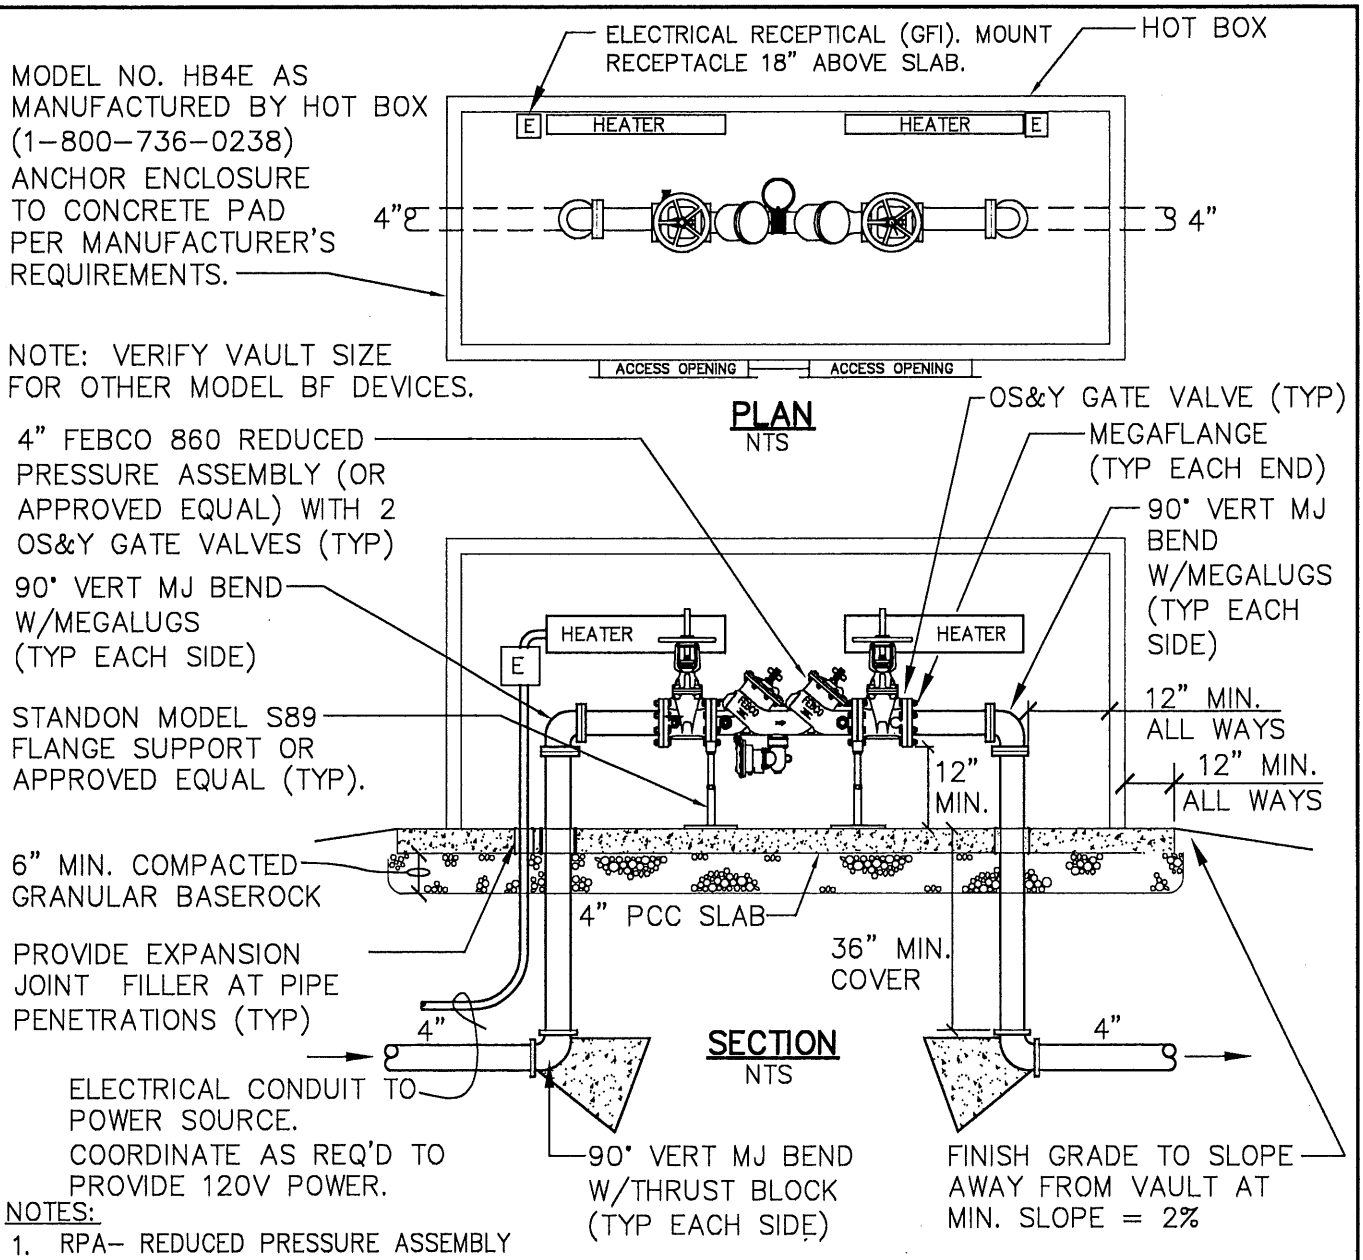

NOTES:

1. RPA- REDUCED PRESSURE ASSEMBLY
2. RPA & VAULT INSTALLATION SHALL MEET STATE OF OREGON, DEPARTMENT OF HUMAN RESOURCES, HEALTH DIVISION REQUIREMENTS.
3. CONTRACTOR SHALL HAVE RPA TESTED AND CERTIFIED PRIOR TO APPROVAL BY THE CITY.
4. RPA & VAULT SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
5. VAULTS SHALL HAVE A MINIMUM OF 3' CLEARANCE FROM ALL OTHER VAULTS OR STRUCTURES.
6. VERIFY ENCLOSURE DIMENSIONS ARE ADEQUATE FOR CLEARANCE BASED ON HEIGHT OF REDUCED PRESSURE ASSEMBLY.
7. ENCLOSURE SHALL BE CENTERED OVER THE COMPLETED REDUCED PRESSURE ASSEMBLY.
8. POWER SHALL BE INSTALLED IN SCHEDULE 40 RIGID CONDUIT PER NEC REQUIREMENTS.
9. 'E' INDICATES THE ELECTRICAL RECEPTACLE. IT SHALL BE MOUNTED A MIN. OF 18" ABOVE THE SLAB.
10. ALL CONCRETE SHALL HAVE 3,300 PSI COMPRESSIVE STRENGTH @ 28 DAYS.
11. HOT BOX DRAINAGE OPENINGS SHALL NOT BE OBSTRUCTED BY GRADING OR PLANTINGS.
12. RPA SHALL BE INSTALLED A MIN. OF 12 INCHES ABOVE THE 100-YEAR FLOOD ELEVATION AS DETERMINED BY FEMA.

LAST REVISION DATE:	JO #
OCT 2014	STANDARD

4" REDUCED PRESSURE ASSEMBLY

(NTS)

PHILOMATH, OR	DETAIL NO. 544

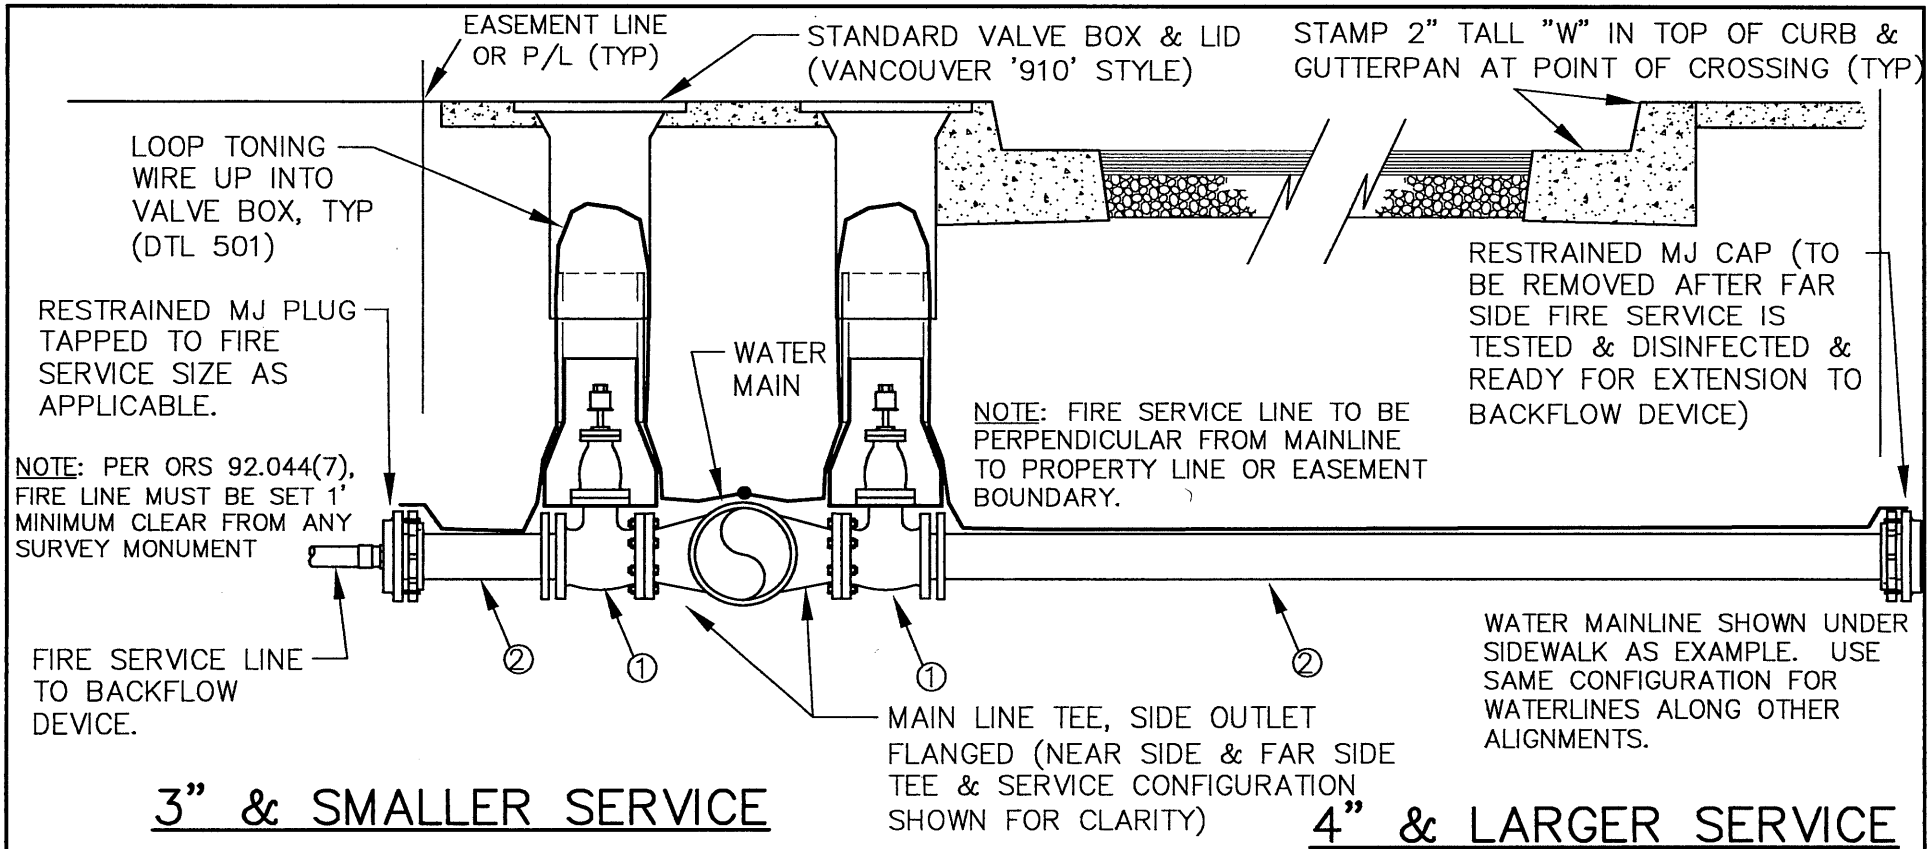

3" & SMALLER SERVICE

4" & LARGER SERVICE

FIRE SERVICE LINE CONNECTION REQUIREMENTS (1-1/2" AND LARGER SERVICE)

(NTS)

PHILOMATH, OR

DETAIL NO. 550

LAST REVISION DATE: SEPT 2015

MATERIALS

① FLG X MJ RESILIENT WEDGE GATE VALVE PER AWWA C-509. 4" DIA. OR FIRE SERVICE SIZE, WHICHEVER IS LARGER. EPOXY COATED PER AWWA C-550.

② CLASS 52 DUCTILE IRON PIPE REQUIRED WITHIN RIGHT-OF-WAY OR EASEMENT BOUNDARY, TYP. 4" DIA OR FIRE SERVICE SIZE, WHICHEVER IS LARGER.

NOTES

1. SUBSTITUTES FOR ANY MATERIAL SHOWN SHALL BE APPROVED BY THE CITY ENGINEER.
2. ALL PIPE AND STRUCTURE ZONES SHALL BE BACKFILLED USING 3/4" MINUS GRANULAR MATERIAL AND COMPACTED TO 95% MAX DENSITY AS DETERMINED BY ASHTO T-180.
3. FIRE SERVICE LINE BEYOND PROPERTY OR EASEMENT LINE TO BE NFPA & NSF 61 APPROVED.
4. CUSTOMER SHALL INSTALL AN APPROVED BACKFLOW PREVENTION DEVICE ON PRIVATE PROPERTY AT A LOCATION APPROVED BY PUBLIC WORKS.

PROVIDE BALL DRIP DRAIN VALVE TO DRAIN FDC, EITHER ON CHECK VALVE OR WITH HORIZONTAL TAPPING SADDLE

INSTALL "FORWARD FLOW TEST PORT" PER DTL 559 UNLESS ALT. LOCATION APPROVED.

4" FEBCO 856 DOUBLE CHECK DETECTOR ASSEMBLY WITH 2 OS&Y GATE VALVES, OR APPROVED EQUAL.

CAST-IN-PLACE CONCRETE THRUST COLLAR WITH RETAINER GLAND CENTERED IN CONCRETE (TYPICAL BOTH ENDS)

UTILITY VAULT 676-WA (5'6" x 6'0" ID) W/H-20 RATED LID, OR EQUIVALENT.

ELECTRICAL CONDUIT FOR SUMP PUMP

F.D.C. PER FIRE DEPT. REQUIREMENTS, LOCATE AS SHOWN ON PLANS.

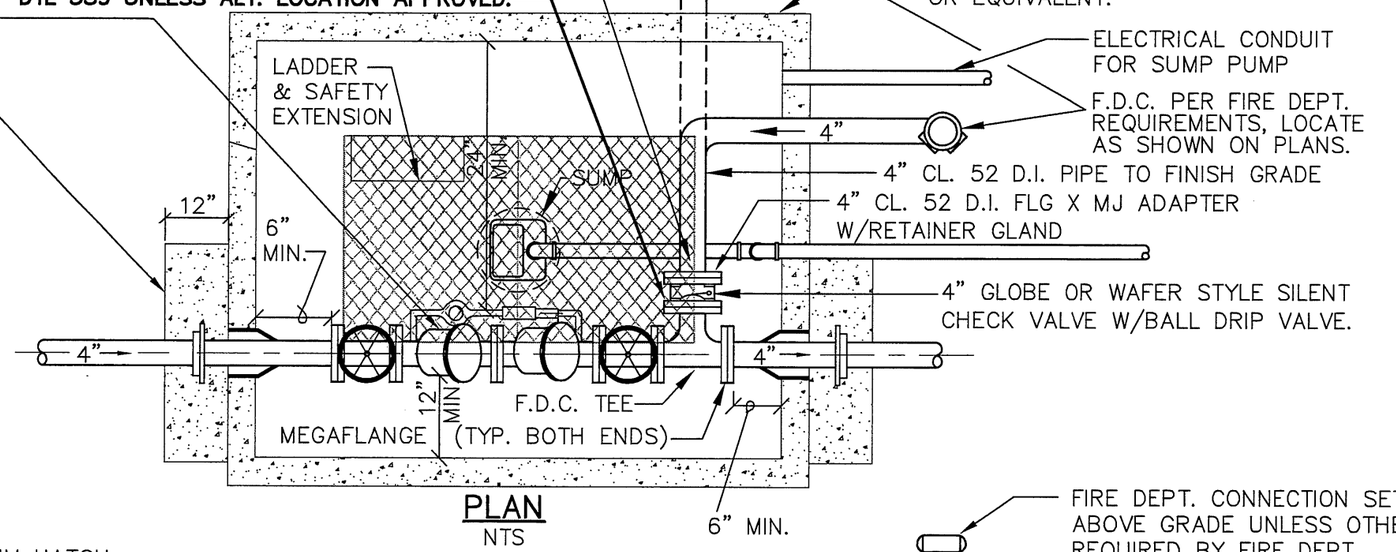

PLAN
NTS

NOTES:

1. DCDA- DOUBLE CHECK DETECTOR ASSEMBLY FDC-FIRE DEPARTMENT CONNECTION.
2. DCDA SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
3. DCDA & VAULT INSTALLATION SHALL MEET STATE OF OREGON, DEPARTMENT OF HUMAN RESOURCES, HEALTH DIVISION REQUIREMENTS.
4. CONTRACTOR SHALL HAVE DCDA TESTED AND CERTIFIED PRIOR TO ACCEPTANCE BY OWNER.
5. FDC SHALL NOT EXIT THROUGH THE TOP OF THE VAULT.
6. ALL PIPE OPENINGS SHALL BE SEALED WITH NON-SHRINK WATERTIGHT GROUT.
7. BENDS, CROSSES AND TEES SHALL NOT BE INSTALLED WITHIN 5 FEET OF THE OUTSIDE VAULT WALL.
8. ALL VAULTS SHALL MEET OR EXCEED ASTM C-857. ALL VAULT CONCRETE TO BE 4500 PSI @ 28 DAYS. REBAR TO BE ASTM A-615 GRADE 60.
9. SUMP PUMP WITH POWER SUPPLY SHALL BE INSTALLED UNLESS OTHERWISE APPROVED BY PUBLIC WORKS.
10. SUMP DISCHARGE SHALL BE PLUMBED TO FACE OF STREET CURB OR OTHER DISPOSAL POINT APPROVED BY LOCAL JURISDICTION (SEE OAR 333-061-0071.3.f).
11. SUMP PUMP POWER SHALL BE INSTALLED IN SCHEDULE 40 RIGID CONDUIT PER NEC REQUIREMENTS.
12. THRUST COLLAR CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
13. PROVIDE REMOTE READER (RADIO READ HEAD) FOR DETECTOR LOOP PER LOCAL JURISDICTION REQUIREMENTS, MOUNTED ON HINGE EDGE OF HATCH.
14. ALUMINUM ANGLE FRAME HATCH (3'0"x 5'6" MIN) SHALL BE BY SYRACUSE CASTINGS WEST OR APPROVED EQUAL (SAND BLASTED NON-SLIP).
    (1) TO BE 300 PSF PEDESTRIAN RATED EXKD-3666-RPC WHERE LID IS SET MIN. OF 9" ABOVE GRADE.
    (2) TO BE H-20 RATED ECHD-3666-RPC IF LID IS LESS THAN 9" ABOVE GRADE, OR IS IN TRAFFIC AREA.
15. OSHA APPROVED GALVANIZED STEEL LADDER & ALUMINUM LADDER SAFETY EXTENSION.

ALUMINUM HATCH (SEE NOTE 14)

SET TOP 1" MIN. ABOVE FG. OUTSIDE PAVED AREAS. USE H-20 RATED HATCH IF LID IS LESS THAN 9" ABOVE FG ON ALL SIDES.

SET TOP AT FINISH GRADE IN PAVED AREAS

UTILITY VAULT

GRANULAR BACKFILL IN IMPROVED AREAS

LADDER & SAFETY EXT (SEE NOTE 15)

CORE VAULT TO PIPE DIA +3" MIN, KOR-N-SEAL BOOT (TYP. BOTH ENDS)

OS&Y GATE VALVE (TYP)

2" TRUE UNION BALL VALVE

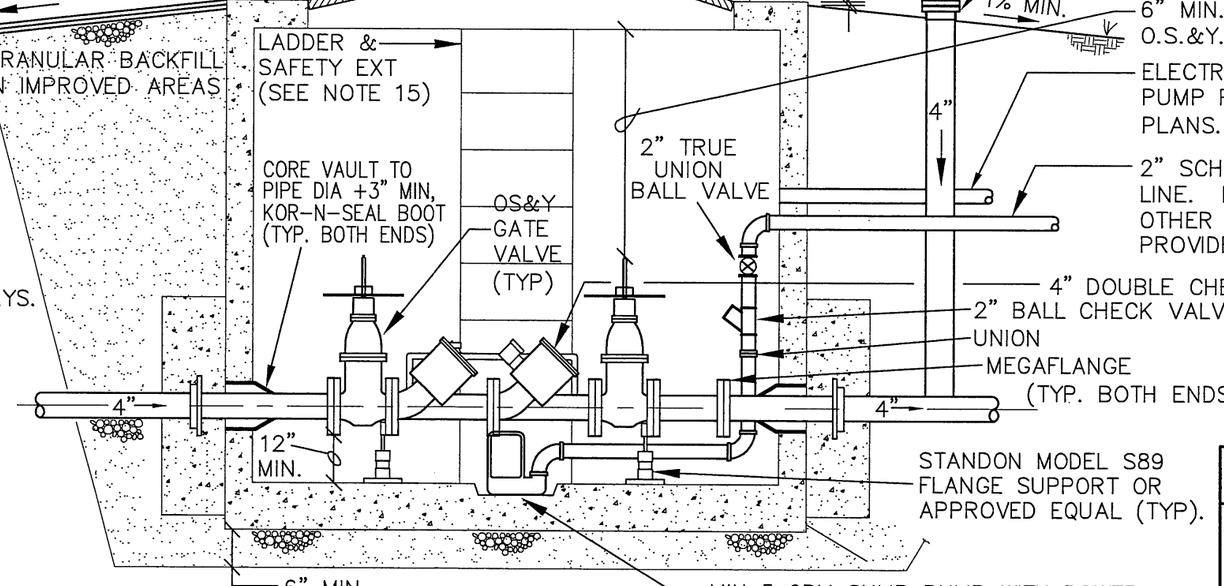

SECTION
NTS

STANDON MODEL S89 FLANGE SUPPORT OR APPROVED EQUAL (TYP).

MIN 5 GPM SUMP PUMP WITH POWER SUPPLY. CONTRACTOR TO COORDINATE WITH BUILDING CONTRACTOR TO CONNECT SUMP PUMP TO BUILDING POWER.

FIRE DEPT. CONNECTION SET MIN. 36" ABOVE GRADE UNLESS OTHERWISE REQUIRED BY FIRE DEPT.

4" SCH, 80 GALV. STEEL NIPPLE

4" GALV. STEEL COMPANION FLANGE

4" CL. 52 D.I. FLG X MJ ADAPTER W/RETAINER GLAND

1% MIN.

6" MIN. CLEARANCE WHEN O.S.&Y. VALVE IS FULLY OPEN

ELECTRICAL CONDUIT FOR SUMP PUMP POWER. SEE ELECTRICAL PLANS. PROVIDE MIN. 30" COVER.

4"

2" SCH. 40 PVC SUMP PUMP DISCHARGE LINE. PLUMB TO FACE OF CURB OR OTHER APPROVED DISPOSAL POINT. PROVIDE 30" MINIMUM COVER.

4" DOUBLE CHECK DETECTOR ASSY, WITH CITY APPR'D METER & REMOTE READ HEAD (BY HATCH OR OTHER LOCATION APPR'D BY PUBLIC WORKS)

2" BALL CHECK VALVE

UNION

MEGAFLANGE (TYP. BOTH ENDS)

LAST REVISION DATE: FEB 2016	JO # STANDARD
4" DOUBLE CHECK DETECTOR ASSEMBLY W/FDC (NTS)	
PHILOMATH, OR	DETAIL NO. 554

6" FEBCO 856 DOUBLE CHECK DETECTOR ASSEMBLY WITH 2 OS&Y GATE VALVES, OR APPROVED EQUAL.

CAST-IN-PLACE CONCRETE THRUST COLLAR WITH RETAINER GLAND CENTERED IN CONCRETE (TYPICAL BOTH ENDS)

NOTES:

1. DCDA- DOUBLE CHECK DETECTOR ASSEMBLY FDC-FIRE DEPARTMENT CONNECTION.
2. DCDA SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
3. DCDA & VAULT INSTALLATION SHALL MEET STATE OF OREGON, DEPARTMENT OF HUMAN RESOURCES, HEALTH DIVISION REQUIREMENTS.
4. CONTRACTOR SHALL HAVE DCDA TESTED AND CERTIFIED PRIOR TO ACCEPTANCE BY OWNER.
5. FDC SHALL NOT EXIT THROUGH THE TOP OF THE VAULT.
6. ALL PIPE OPENINGS SHALL BE SEALED WITH NON-SHRINK WATERTIGHT GROUT.
7. BENDS, CROSSES AND TEES SHALL NOT BE INSTALLED WITHIN 5 FEET OF THE OUTSIDE VAULT WALL.
8. ALL VAULTS SHALL MEET OR EXCEED ASTM C-857. ALL VAULT CONCRETE TO BE 4500 PSI @ 28 DAYS. REBAR TO BE ASTM A-615 GRADE 60.
9. SUMP PUMP WITH POWER SUPPLY SHALL BE INSTALLED UNLESS OTHERWISE APPROVED BY PUBLIC WORKS.
10. SUMP DISCHARGE SHALL BE PLUMBED TO FACE OF STREET CURB OR OTHER DISPOSAL POINT APPROVED BY LOCAL JURISDICTION (SEE OAR 333-061-0071.3.f).
11. SUMP PUMP POWER SHALL BE INSTALLED IN SCHEDULE 40 RIGID CONDUIT PER NEC REQMNTS.
12. THRUST COLLAR CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
13. PROVIDE REMOTE READER (RADIO READ HEAD) FOR DETECTOR LOOP PER LOCAL JURISDICTION REQUIREMENTS, MOUNTED ON HINGE EDGE OF HATCH.
14. ALUMINUM ANGLE FRAME HATCH (3'0"x 5'6" MIN) SHALL BE BY SYRACUSE CASTINGS WEST OR APPROVED EQUAL (SAND BLASTED NON-SLIP). (1) TO BE 300 PSF PEDESTRIAN RATED EXKD-3666-RPC WHERE LID IS SET MIN. OF 9" ABOVE GRADE. (2) TO BE H-20 RATED ECHD-3666-RPC IF LID IS LESS THAN 9" ABOVE GRADE, OR IS IN TRAFFIC AREA.
15. OSHA APPROVED GALVANIZED STEEL LADDER & ALUMINUM LADDER SAFETY EXTENSION.

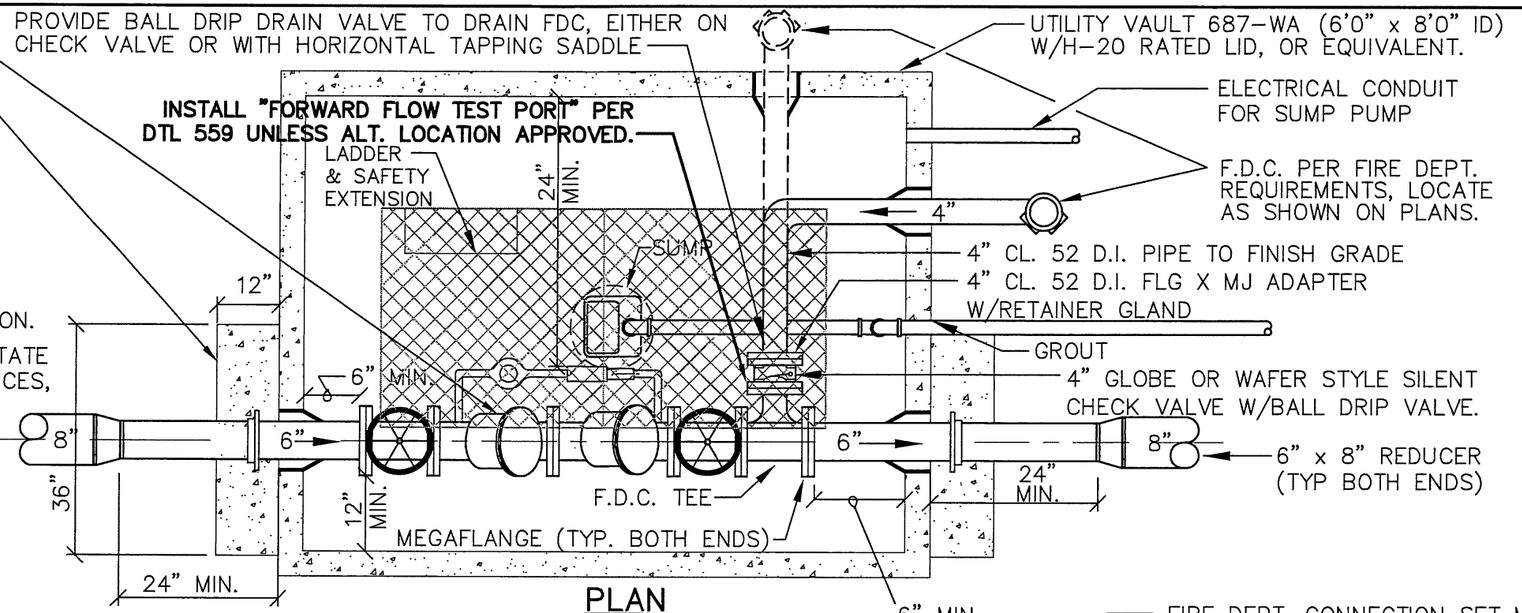

PLAN
NTS

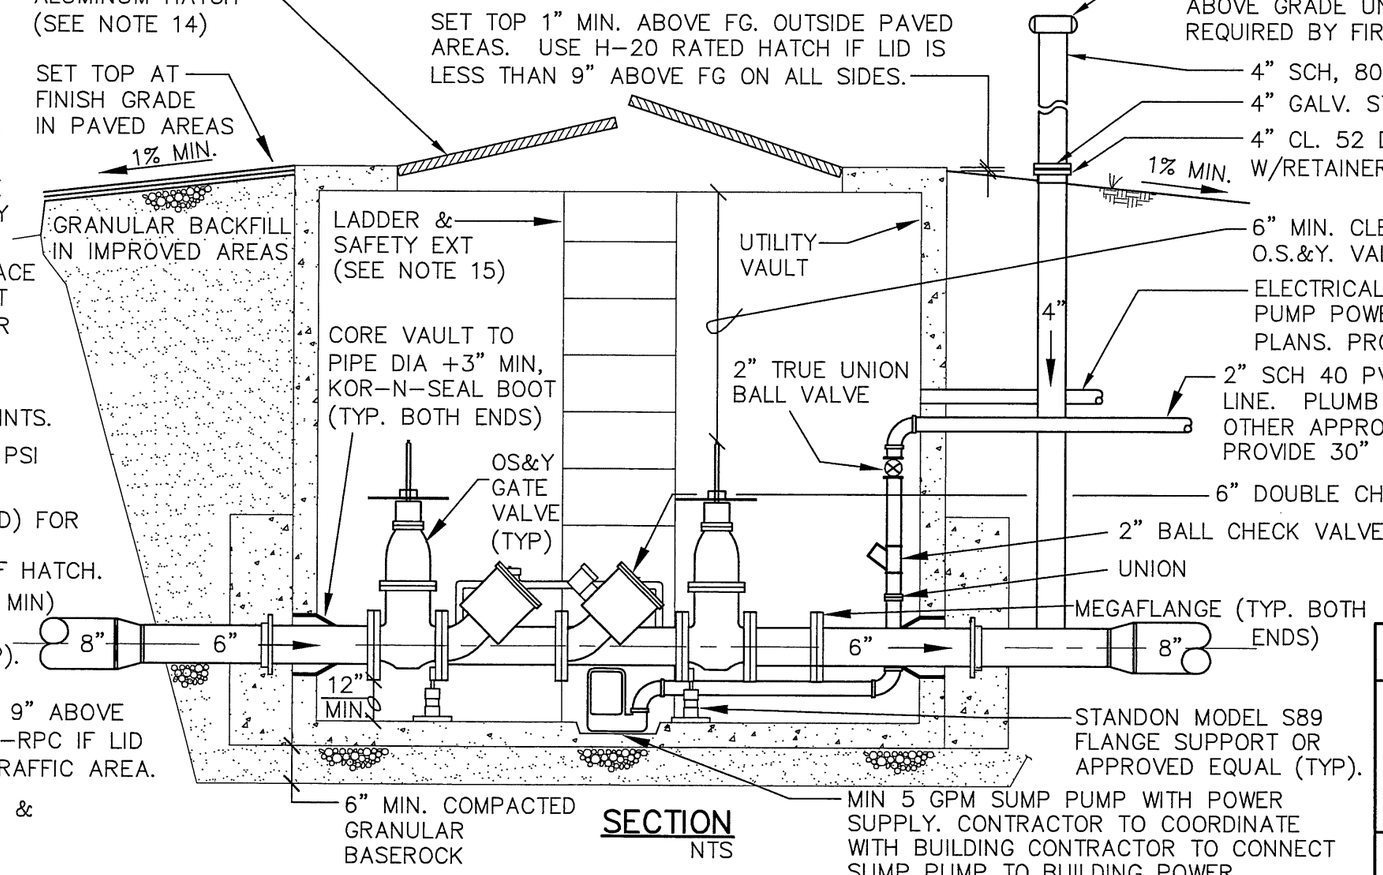

SECTION
NTS

LAST REVISION DATE: FEB 2016	JO # STANDARD
6" DOUBLE CHECK DETECTOR ASSEMBLY W/FDC (NTS)	
PHILOMATH, OR	DETAIL NO. 555

8" FEBCO 856 DOUBLE CHECK DETECTOR ASSEMBLY WITH 2 OS&Y GATE VALVES, OR APPROVED EQUAL.

CAST-IN-PLACE CONCRETE THRUST COLLAR WITH RETAINER GLAND CENTERED IN CONCRETE (TYPICAL BOTH ENDS)

NOTES:

1. DCDA- DOUBLE CHECK DETECTOR ASSEMBLY FDC-FIRE DEPARTMENT CONNECTION.
2. DCDA SHALL CONFORM TO REQUIREMENTS OF PUBLIC/PRIVATE AGENCIES HAVING JURISDICTION.
3. DCDA & VAULT INSTALLATION SHALL MEET STATE OF OREGON, DEPARTMENT OF HUMAN RESOURCES, HEALTH DIVISION REQUIREMENTS.
4. CONTRACTOR SHALL HAVE DCDA TESTED AND CERTIFIED PRIOR TO ACCEPTANCE BY OWNER.
5. FDC SHALL NOT EXIT THROUGH THE TOP OF THE VAULT.
6. ALL PIPE OPENINGS SHALL BE SEALED WITH KOH-N-SEAL RUBBER BOOTS, EXCEPT AS NOTED.
7. BENDS, CROSSES AND TEES SHALL NOT BE INSTALLED WITHIN 5 FEET OF THE OUTSIDE VAULT WALL.
8. ALL VAULTS SHALL MEET OR EXCEED ASTM C-857. ALL VAULT CONCRETE TO BE 4500 PSI @ 28 DAYS. REBAR TO BE ASTM A-615 GRADE 60.
9. SUMP PUMP WITH POWER SUPPLY SHALL BE INSTALLED UNLESS OTHERWISE APPROVED BY PUBLIC WORKS.
10. SUMP DISCHARGE SHALL BE PLUMBED TO FACE OF STREET CURB OR OTHER DISPOSAL POINT APPROVED BY LOCAL JURISDICTION (SEE OAR 333-061-0071.3.f).
11. SUMP PUMP POWER SHALL BE INSTALLED IN SCHEDULE 40 RIGID CONDUIT PER NEC REQMNTS.
12. THRUST COLLAR CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
13. PROVIDE REMOTE READER (RADIO READ HEAD) FOR DETECTOR LOOP PER LOCAL JURISDICTION REQUIREMENTS, MOUNTED ON HINGE EDGE OF HATCH.
14. ALUMINUM ANGLE FRAME HATCH (3'0"x 5'6" MIN) SHALL BE BY SYRACUSE CASTINGS WEST OR APPROVED EQUAL (SAND BLASTED NON-SLIP). (1) TO BE 300 PSF PEDESTRIAN RATED EXKD-3666-RPC WHERE LID IS SET MIN. OF 9" ABOVE GRADE. (2) TO BE H-20 RATED ECHD-3666-RPC IF LID IS LESS THAN 9" ABOVE GRADE, OR IS IN TRAFFIC AREA.
15. OSHA APPROVED GALVANIZED STEEL LADDER & ALUMINUM LADDER SAFETY EXTENSION.

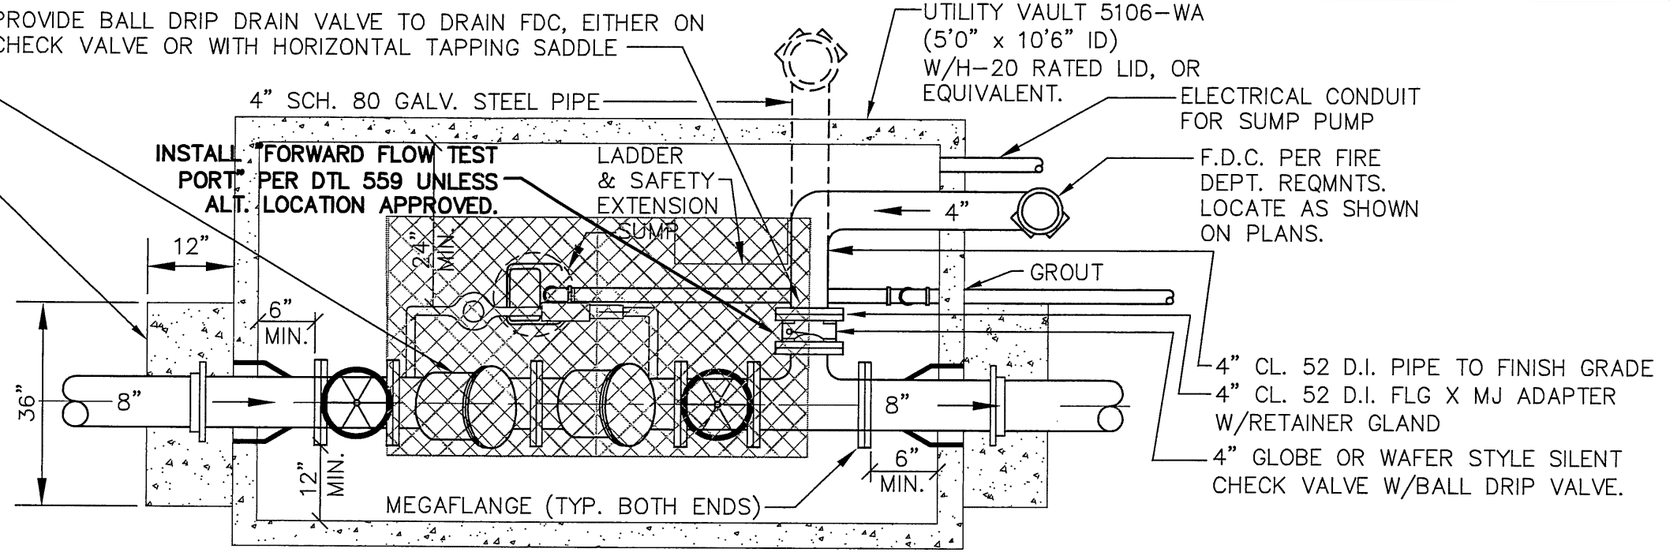

PLAN
NTS

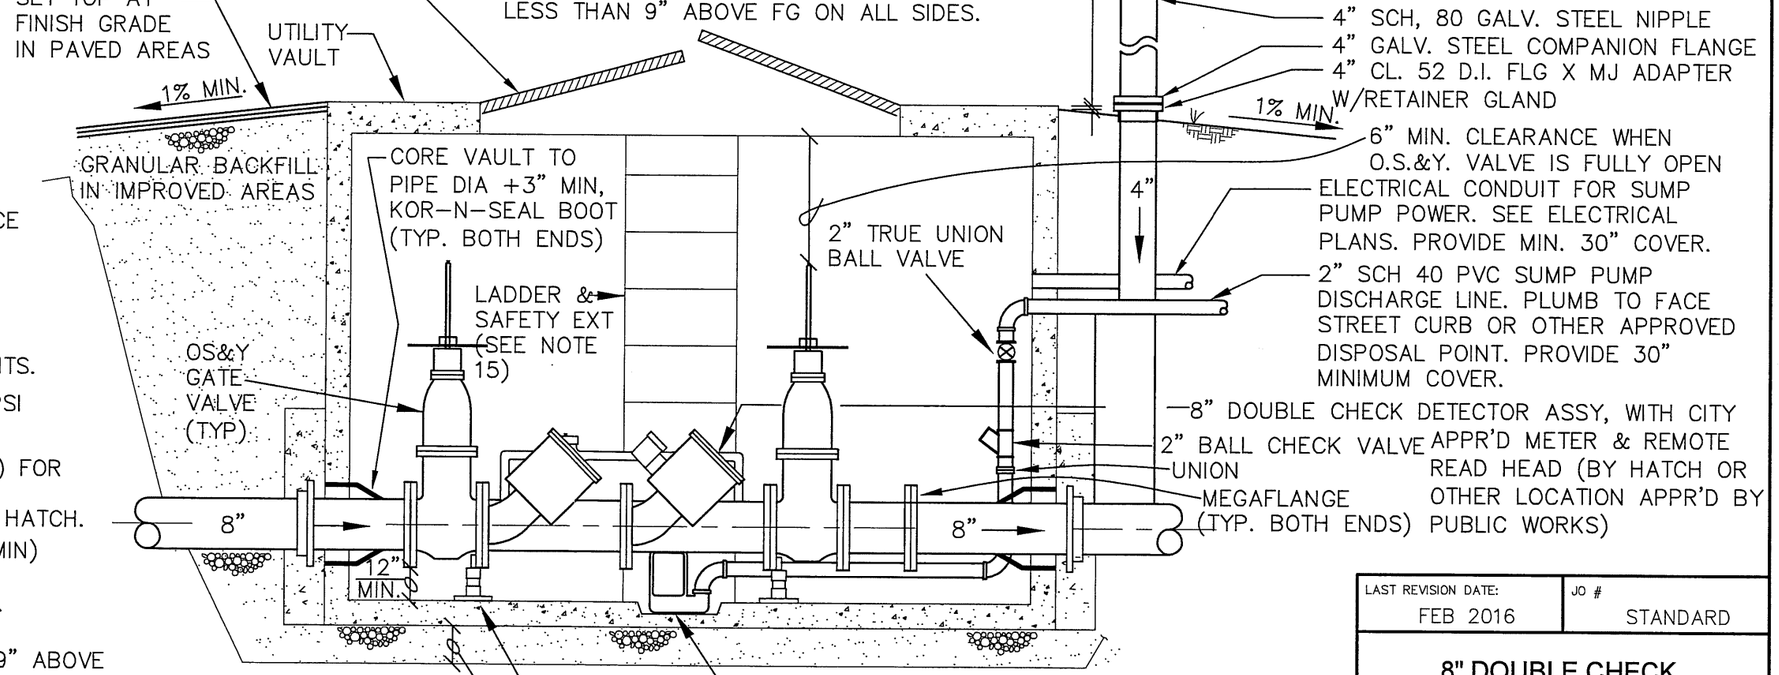

SECTION
NTS

LAST REVISION DATE: FEB 2016	JO # STANDARD
8" DOUBLE CHECK DETECTOR ASSEMBLY W/FDC (NTS)	
PHILOMATH, OR	DETAIL NO. 556

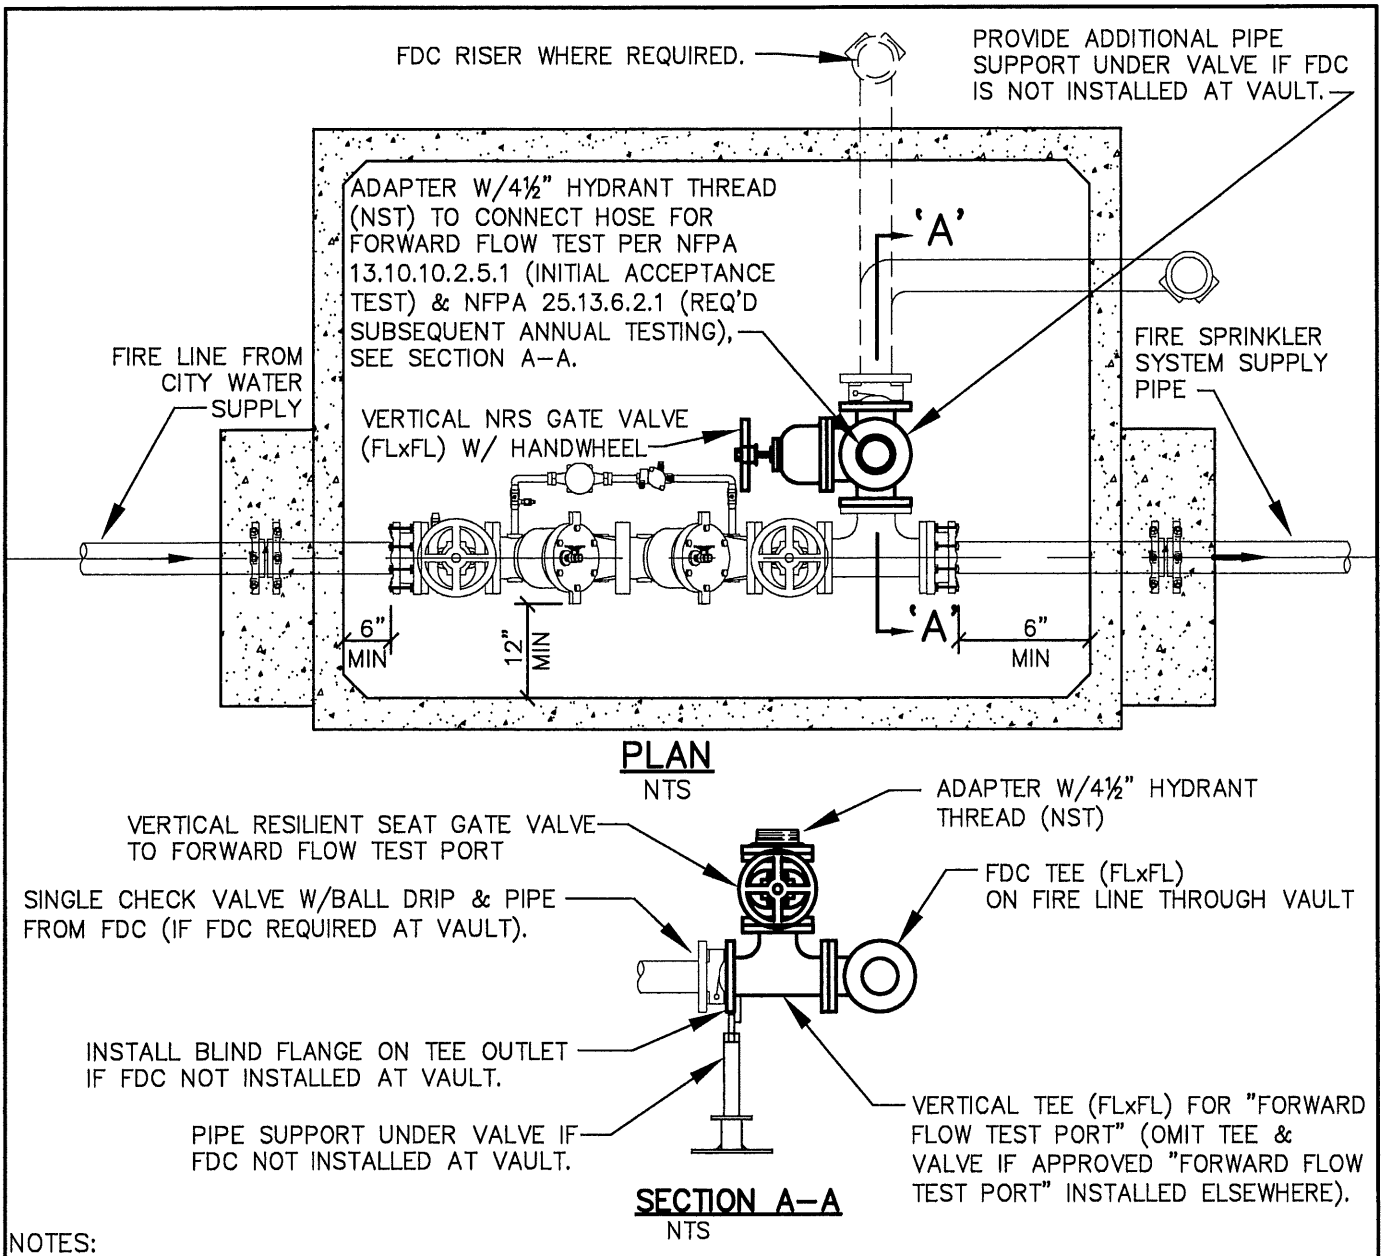

NOTES:

1. THE "FORWARD FLOW TEST PORT" SHALL BE INSTALLED IN THE DCDA VAULT AS SHOWN AND SPECIFIED BY THIS DETAIL, UNLESS AN ALTERNATE PERMANENT "FORWARD FLOW TEST PORT" LOCATION IS APPROVED IN WRITING BY THE OWNER'S REPRESENTATIVE AND AN AUTHORIZED FIRE DEPT REPRESENTATIVE, OR IF A PRIVATE FIRE HYDRANT DOWNSTREAM OF THE DCDA VAULT IS DESIGNATED AS THE REQUIRED "FORWARD FLOW TEST PORT".

2. CONTRACTOR IS RESPONSIBLE FOR COORDINATING WITH THE FIRE SPRINKLER SYSTEM DESIGNER/ INSTALLER TO VERIFY THE FLOWRATE REQUIRED FOR THE "FORWARD FLOW TEST" OF THE BACKFLOW DEVICE, AND SHALL COORDINATE TO ENSURE THAT ALL HOSE & FLOW MEASUREMENT EQUIPMENT (HOSE MONSTER OR EQUAL) IS PROVIDED AS REQUIRED TO CONDUCT THE ACCEPTANCE "FORWARD FLOW TEST" AS REQUIRED BY NFPA 13.10.10.2.5.1.

3. ALL COMPONENTS OF THE FORWARD FLOW TEST PORT (EXCLUDING THE FIRE HOSES & FLOW MEASUREMENT EQUIPMENT) SHALL REMAIN IN PLACE TO ALLOW SUBSEQUENT "FORWARD FLOW TESTS" TO BE CONDUCTED WITHOUT ANY SYSTEM MODIFICATIONS (IE. ANNUAL FLOW TESTS AS REQUIRED PER NFPA 25.13.6.2.1).

4. CONFORM TO ALL OTHER REQUIREMENTS OF APPLICABLE DOUBLE CHECK DETECTOR ASSEMBLY DETAIL(S), NOTES & SPECIFICATIONS.

LAST REVISION DATE: FEB 2016	JO #

4" FORWARD FLOW TEST PORT INSIDE DCDA VAULT (FOR NFPA 13 & 25 TESTS)

(NTS)

PHILOMATH, OR	DETAIL NO. 559

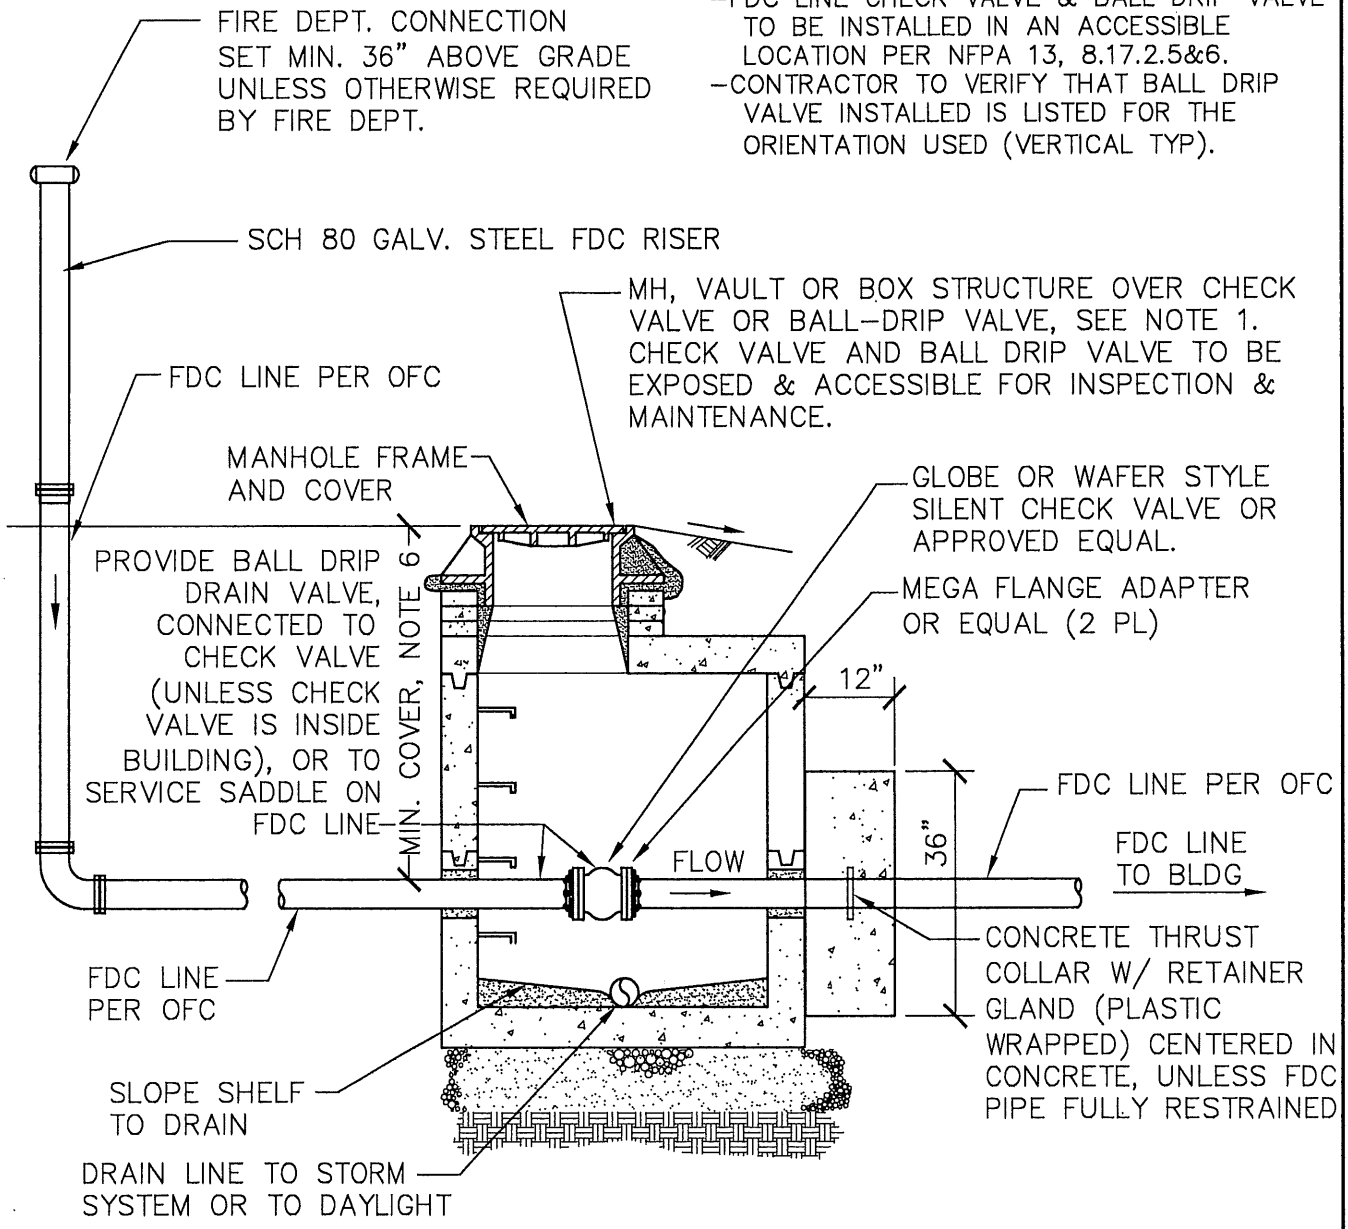

NOTES:

1. INSTALL 48" PRECAST MANHOLE PER DETAIL 402, UNLESS OTHER APPROVED VAULT OR BOX IS SHOWN OR NOTED ON DWGS.
2. ALL PIPE OPENINGS SHALL BE SEALED WITH NON-SHRINK WATERTIGHT GROUT.
3. WHERE REQUIRED, THRUST COLLAR CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
4. IF AN FDC LINE CHECK VALVE IS PROVIDED INSIDE BUILDING, AN EXTERIOR FDC LINE CHECK VALVE IS NOT REQUIRED UNLESS OTHERWISE DIRECTED IN WRITING BY FIRE CODE OFFICIAL. BALL DRIP DRAIN VALVE SHALL BE INSTALLED ON CHECK VALVE OR AT LOW POINT ON FDC LINE (DETAIL 562) TO DRAIN FDC LINE BETWEEN CHECK VALVE & FDC RISER.
5. PER NFPA 13, A10.4.1, 36" MIN COVER REQUIRED FOR "WET" FDC LINES (ANY PORTION OF FDC LINE WHICH REMAINS FILLED WHEN NOT IN USE). COVER MAY BE REDUCED TO 12" MIN ON "DRY" FDC LINE WHICH IS DRAINED COMPLETELY WHEN NOT IN USE.
6. THIS DETAIL DOES NOT SUPERCEDE REQUIREMENTS UNDER THE OREGON FIRE CODE, NFPA STANDARDS OR DIRECTION FROM FIRE CHIEF.

LAST REVISION DATE:	JO #
DEC 2013	STANDARD

BELOW GRADE CHECK VALVE & BALL DRIP VALVE, IN CLOSE BOTTOM DRAIN STRUCT

(NTS)

PHILOMATH, OR	DETAIL NO. 560

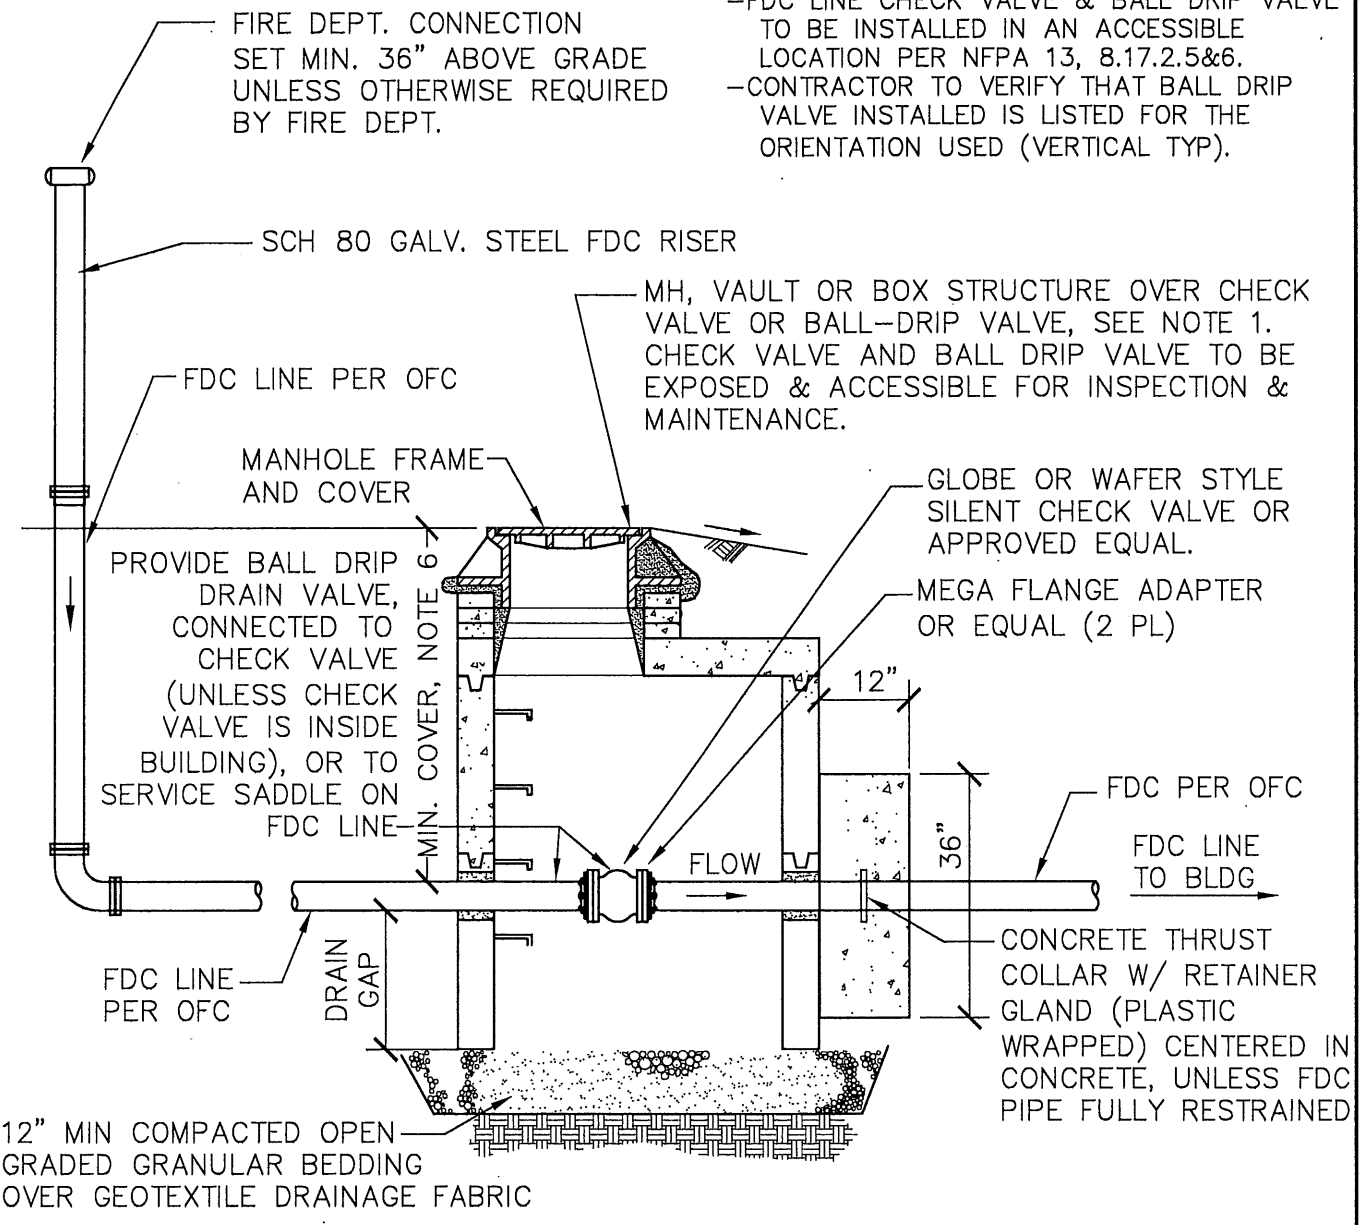

NOTES:

1. INSTALL 48" PRECAST MANHOLE PER DETAIL 402, UNLESS OTHER APPROVED VAULT OR BOX IS SHOWN OR NOTED ON DWGS.
2. ALL PIPE OPENINGS SHALL BE SEALED WITH NON-SHRINK WATERTIGHT GROUT.
3. WHERE REQUIRED, THRUST COLLAR CONCRETE SHALL BE 3300 PSI @ 28 DAYS.
4. IF AN FDC LINE CHECK VALVE IS PROVIDED INSIDE BUILDING, AN EXTERIOR FDC LINE CHECK VALVE IS NOT REQUIRED UNLESS OTHERWISE DIRECTED IN WRITING BY FIRE CODE OFFICIAL. BALL DRIP DRAIN VALVE SHALL BE INSTALLED ON CHECK VALVE OR AT LOW POINT ON FDC LINE (DETAIL 562) TO DRAIN FDC LINE BETWEEN CHECK VALVE & FDC RISER.
5. PER NFPA 13, A10.4.1, 36" MIN COVER REQUIRED FOR "WET" FDC LINES (ANY PORTION OF FDC LINE WHICH REMAINS FILLED WHEN NOT IN USE). COVER MAY BE REDUCED TO 12" MIN ON "DRY" FDC LINE WHICH IS DRAINED COMPLETELY WHEN NOT IN USE.
6. THIS DETAIL DOES NOT SUPERCEDE REQUIREMENTS UNDER THE OREGON FIRE CODE, NFPA STANDARDS OR DIRECTION FROM FIRE CHIEF.

LAST REVISION DATE:	JO #
DEC 2013	STANDARD

BELOW GRADE CHECK VALVE & BALL DRIP VALVE, IN OPEN BOTTOM DRAIN STRUCTURE

(NTS)

PHILOMATH, OR	DETAIL NO. 561

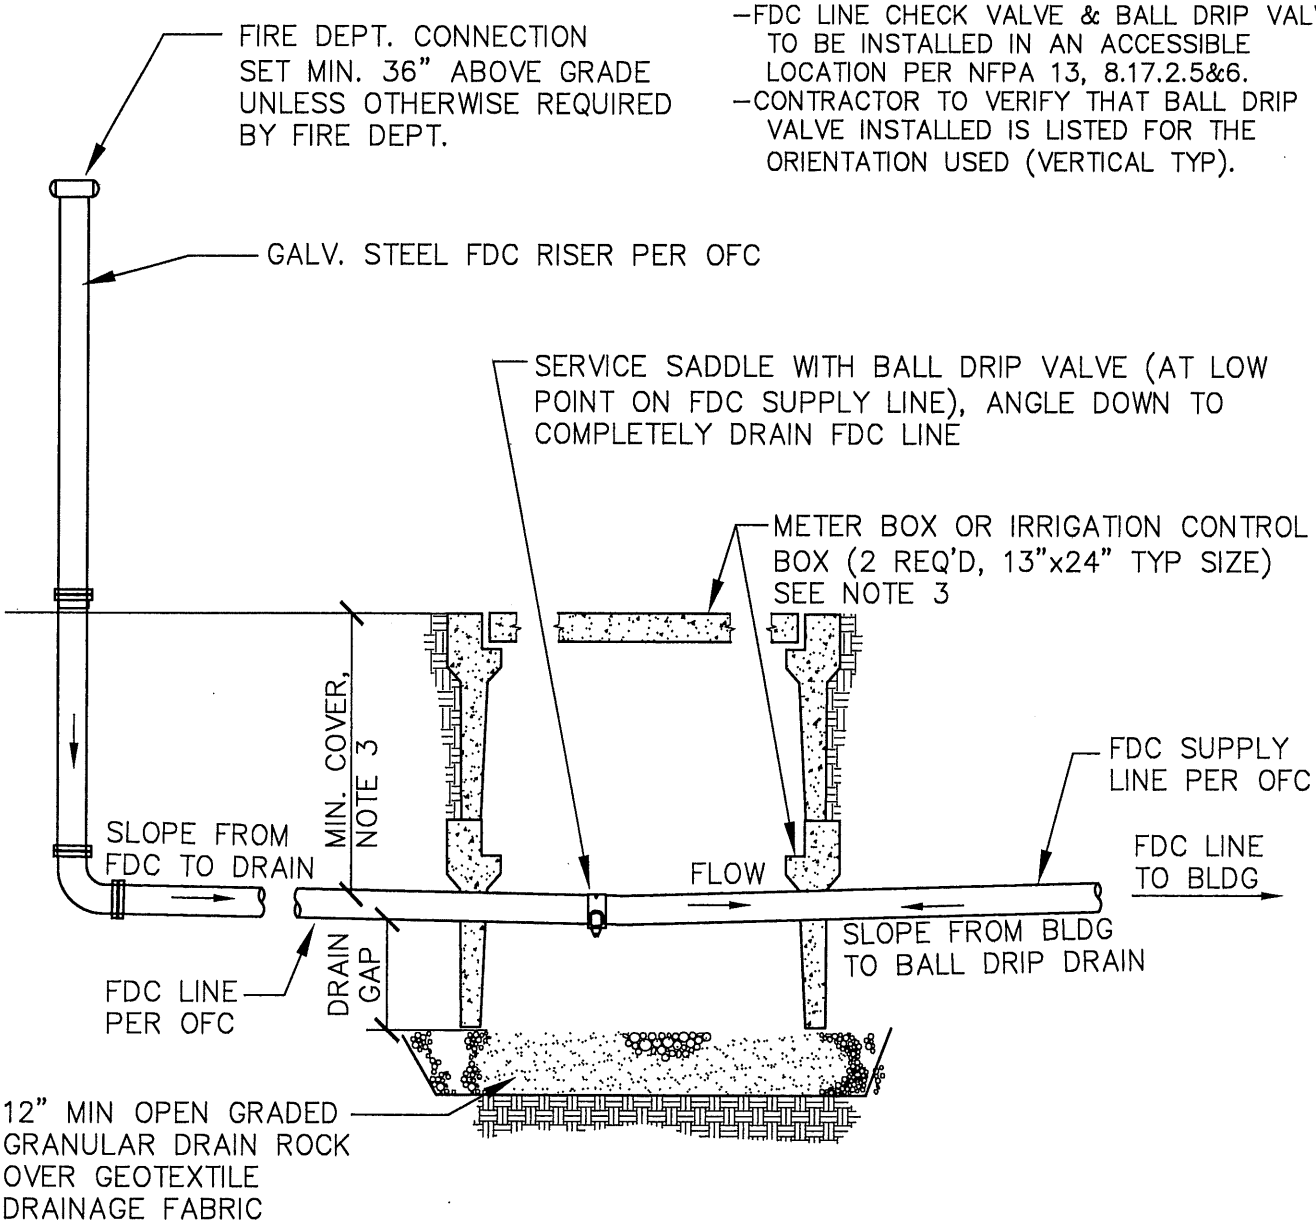

NOTES:

1. INSTALL BALL-DRIP DRAIN VALVE & BOX AT LOW POINT IN FDC LINE PROFILE (IE. BALL DRIP VALVE SHALL BE CONFIGURED TO DRAIN ENTIRE FDC PIPE BETWEEN FDC RISER & BUILDING WHEN FDC IS NOT IN USE).
2. CONFIGURATION SHOWN IS BASED ON FDC LINE CHECK VALVE INSIDE BUILDING (IE. FDC LINE "DRY" WHEN NOT IN USE).
3. UNLESS OTHERWISE REQUIRED TO ADDRESS UTILITY CONFLICTS OR OTHER ISSUES, COVER DEPTH FOR "DRY" FDC LINE SHALL BE 12" MIN AT ALL LOCATIONS.
4. BALL DRIP VALVE SHALL BE ACCESSIBLE IN BOX FOR INSPECTION & MAINTENANCE AS SHOWN (PROVIDE LARGER BOXES AS NECESSARY TO ACCOMPLISH THIS).
5. THIS DETAIL DOES NOT SUPERCEDE REQUIREMENTS UNDER THE OREGON FIRE CODE, NFPA STANDARDS OR DIRECTION FROM FIRE CHIEF.

LAST REVISION DATE:	JO #
OCT 2013	STANDARD

FDC LINE BALL DRIP DRAIN VALVE (CHECK VALVE IN BLDG) OPEN BOTTOM DRAIN STRUCT

(NTS)

PHILOMATH, OR	DETAIL NO. 562

WATERLINE PRESSURE TEST REPORT

Project Location:	Project Name:	Date:
Inspector: (Print)	**Waterline to be tested.** From Station:	To Station:
Verify that all in-line valves, including hydrant mainline valves, are open? Yes / No		
Verify that all corp stops are open? Yes / No		
Verify that pressure gauge is mounted at high point of line to be tested? Yes / No If no, correct for elevation difference *(ie. add 0.433 psi per foot elevation difference).*		
System Static Pressure (psi):	Starting Pressure (psi): (greater of 150 psi or 1.5 times static)	Ending Pressure (psi):
Test Length: (2 hours minimum)	Starting Time:	Ending Time:
Volume Required to Reach Initial Test Pressure (gal):	Allowable Leakage (gal): (2 times table value below)	Measured Leakage (gal):
TEST RESULTS: Pass / Fail		

ALLOWABLE LEAKAGE PER 1,000 FEET OF PIPELINE - *gph*

Test Pressure ***psi***	**NOMINAL PIPE DIAMETER - *in.***									
	3	**4**	**6**	**8**	**10**	**12**	**14**	**16**	**18**	**20**
200	0.32	0.43	0.64	0.85	1.06	1.28	1.48	1.70	1.91	2.12
175	0.30	0.40	0.59	0.80	0.99	1.19	1.39	1.59	1.79	1.98
150	0.28	0.37	0.55	0.74	0.92	1.10	1.29	1.47	1.66	1.84

If the pipeline under test contains various diameters, the allowable leakage shall be the sum of the allowable leakage for each size. No additional leakage allowance will be given for fire hydrant assemblies or valves.

Allowable leakage based on : $L = SD(P)^{1/2}/133{,}200$
Where:
L = allowable leakage, in gallons per hour
S = length of pipe tested, in feet
D = nominal diameter of the pipe, in inches
P = test pressure during the leakage test, in psig
Regardless of leakage, maximum pressure drop during test period shall not exceed 5 psi/hour.

TEST PROCEDURE

1. Apply hydrostatic pressure by pumping water from an auxiliary supply basin. Accurately determine the amount of water required to reach the initial test pressure by refilling the supply basin with a calibrated container following pressurization of pipeline.
2. Monitor test pressure for 2 hour period.
3. At the completion of the test period, re-pressurize the pipeline by pumping water from the auxiliary supply basin. Accurately determine the amount of water required to reach the test pressure by refilling the supply basin with a calibrated container following pressurization of pipeline. If the measured leakage is less than the allowable leakage, the test is successful.

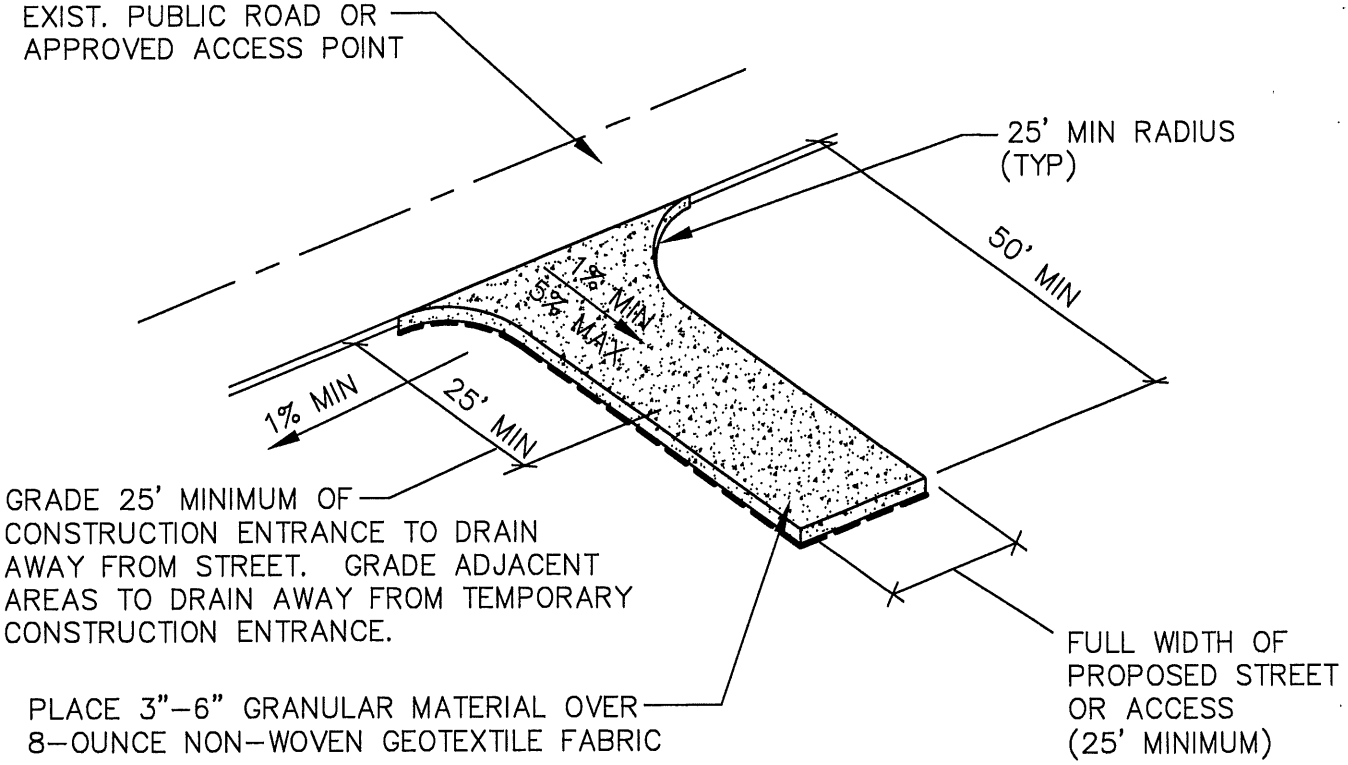

DRY WEATHER ACCESS

14–INCH MIN. DEPTH OVER COMPACTED SUBGRADE & FABRIC

WET WEATHER ACCESS

24–INCH MIN. DEPTH OVER UNDISTURBED SUBGRADE & FABRIC

CONSTRUCTION NOTES:

1. THE AREA OF THE CONSTRUCTION ENTRANCE SHALL BE STRIPPED OF ALL TOPSOIL, VEGETATION, ROOTS, AND OTHER NON–COMPACTABLE MATERIAL.
2. SUBGRADE SHALL BE COMPACTED AND PROOFROLLED PRIOR TO PLACEMENT OF GRANULAR MATERIAL. FAILURE TO PASS PROOFROLL WILL REQUIRE USE OF WET WEATHER SECTION.
3. FAILURE OR PUMPING OF THE DRY WEATHER SECTION WILL REQUIRE REMOVAL OF THE GRANULAR MATERIAL AND INSTALLATION OF THE WET WEATHER SECTION.

MAINTENANCE NOTES:

1. THE ENTRANCE SHALL BE MAINTAINED IN A CONDITION THAT WILL PREVENT TRACKING OR FLOW OF SEDIMENT ONTO PUBLIC RIGHT–OF–WAY. THIS MAY REQUIRE PERIODIC TOP DRESSING WITH 3"–6" INCH STONE AS CONDITIONS DEMAND, AND REPAIR AND/OR CLEAN–OUT OF STRUCTURES USED TO TRAP SEDIMENT.
2. ALL MATERIALS SPILLED, DROPPED, WASHED OR TRACKED FROM VEHICLES ONTO ROADWAYS OR INTO STORM DRAINS MUST BE REMOVED IMMEDIATELY.
3. ALL TRUCKS TRANSPORTING SATURATED SOILS SHALL BE WELL SEALED. WATER DRIPPAGE FROM TRUCKS MUST BE REDUCED TO 1 GALLON PER HOUR PRIOR TO LEAVING THE SITE.

LAST REVISION DATE: MAY 2013	JO # STANDARD
TEMPORARY CONSTRUCTION ENTRANCE (NTS)	
PHILOMATH, OR	DETAIL NO. 610

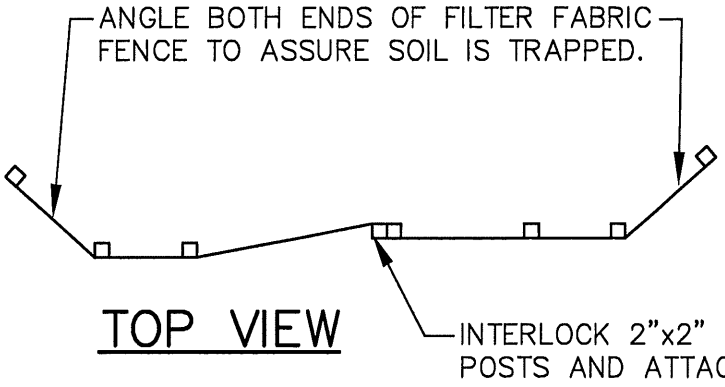

TOP VIEW

SILT FENCE NOTES:

1. BURY BOTTOM OF FILTER FABRIC 6" VERTICALLY BELOW FINISHED GRADE.
2. TRENCH TO BE DUG WITH DITCH-WITCH, BY HAND OR OTHER METHOD AS REQUIRED TO MINIMIZE WIDTH.
3. BACKFILL & COMPACT NATIVE SOIL IN TRENCH AFTER FENCE INSTALLATION.
4. STITCHED LOOPS TO BE INSTALLED TO THE UPHILL SIDE OF THE FENCE.

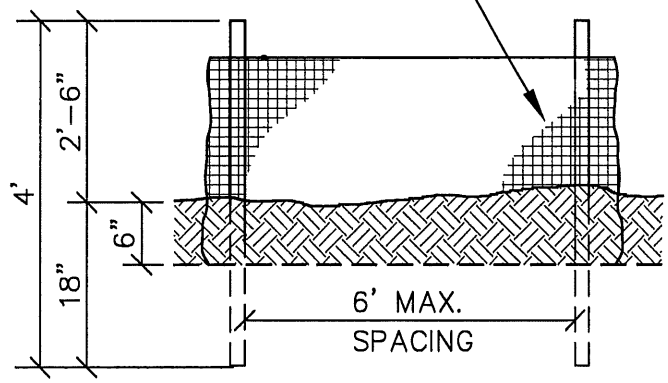

FRONT VIEW

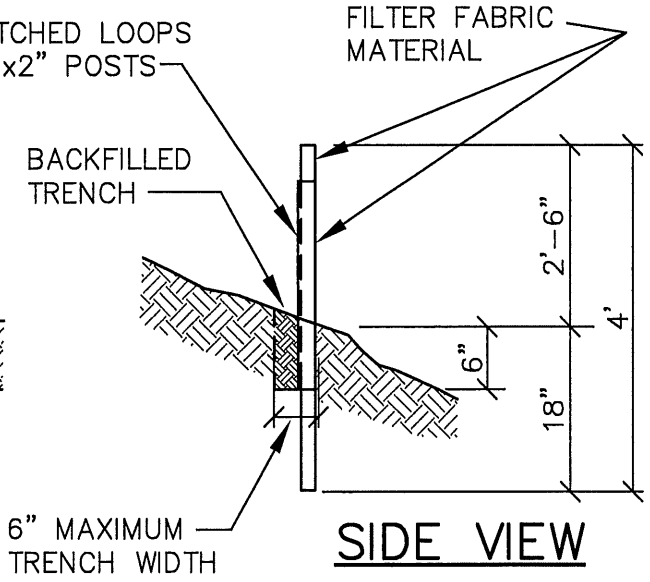

SIDE VIEW

MAINTENANCE NOTES:

1. SEDIMENT BARRIERS SHALL BE MAINTAINED UNTIL UP-SLOPE AREA IS PERMANENTLY STABILIZED.
2. AT NO TIME SHALL MORE THAN ONE FOOT OF SEDIMENT BE ALLOWED TO ACCUMULATE BEHIND SEDIMENT FENCES OR BIOFILTER BAGS.
3. NEW SEDIMENT BARRIERS SHALL BE INSTALLED UPHILL AS REQUIRED TO CONTROL SEDIMENT TRANSPORT.

LAST REVISION DATE: APRIL 2014	JO # STANDARD
SEDIMENT BARRIERS (NTS)	
PHILOMATH, OR	DETAIL NO. 611

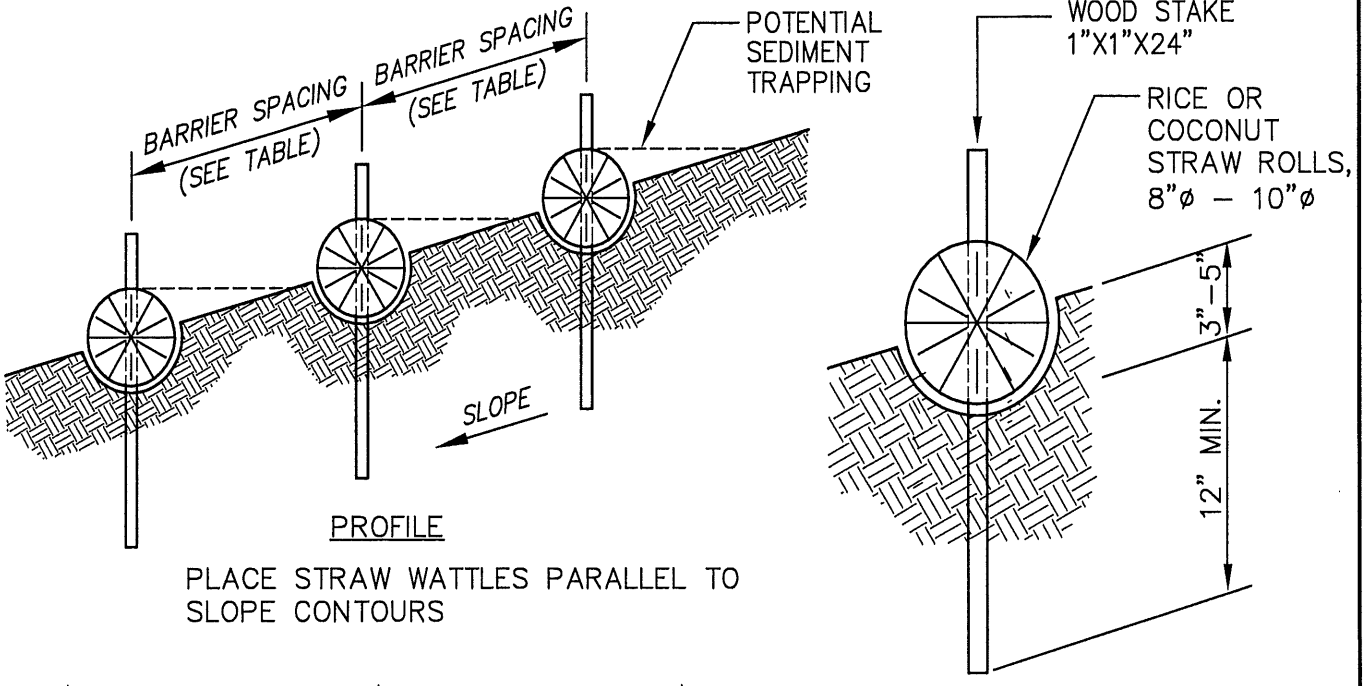

PROFILE

PLACE STRAW WATTLES PARALLEL TO SLOPE CONTOURS

SECTION

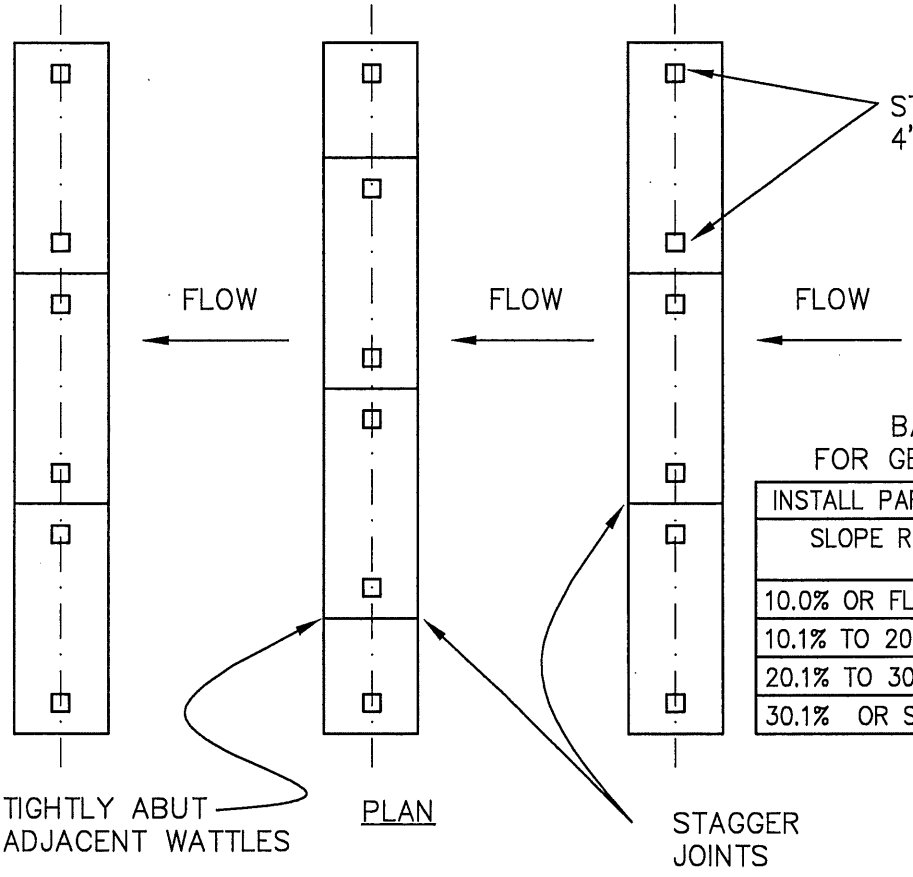

PLAN

BARRIER SPACING FOR GENERAL APPLICATION

INSTALL PARALLEL TO CONTOURS AS FOLLOWS	
SLOPE RATIO	MAXIMUM SPACING ON SLOPE BETWEEN WATTLES
10.0% OR FLATTER	50' O.C.
10.1% TO 20.0%	25' O.C.
20.1% TO 30.0%	10' O.C.
30.1% OR STEEPER	5' O.C.

NOTES:

1. ALL MATERIAL SHALL CONFORM TO OSSC (ODOT/APWA) SPECIFICATIONS, CURRENT EDITION.
2. SEDIMENT BARRIERS SHALL BE MAINTAINED UNTIL UP–SLOPE AREA IS PERMANENTLY STABILIZED.
3. AT NO TIME SHALL SEDIMENT BE ALLOWED TO ACCUMULATE ABOVE THE TOP OF THE STRAW WATTLE.
4. NEW SEDIMENT BARRIERS SHALL BE INSTALLED UPHILL AS REQUIRED TO CONTROL SEDIMENT TRANSPORT.

LAST REVISION DATE: JUNE 2015	JO # STANDARD
STRAW WATTLE SEDIMENT BARRIER (NTS)	
PHILOMATH, OR	DETAIL NO. 612

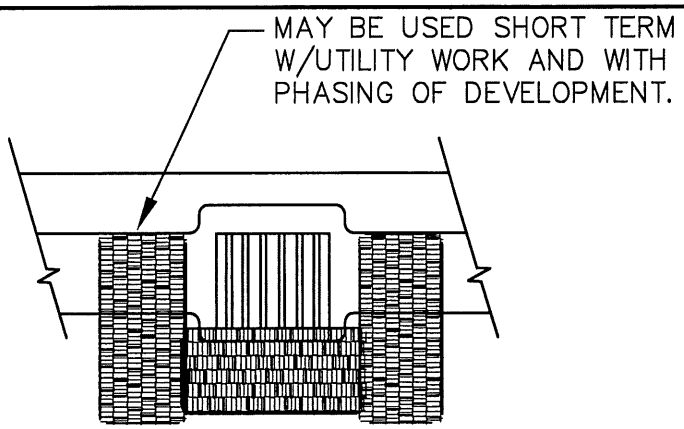

CURB INLET C.B.

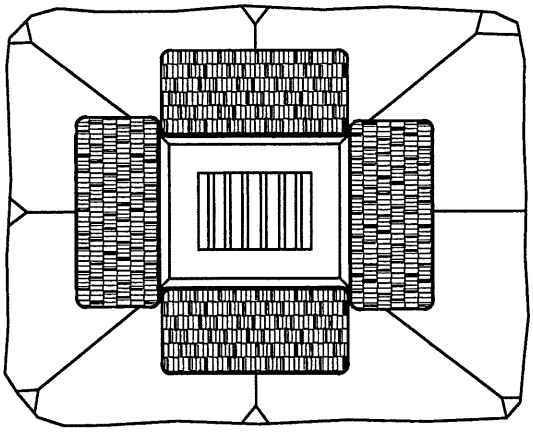

AREA DRAIN

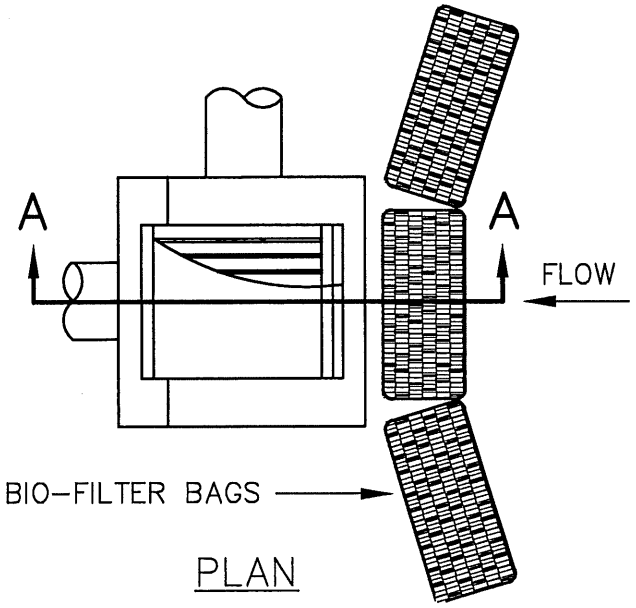

PLAN

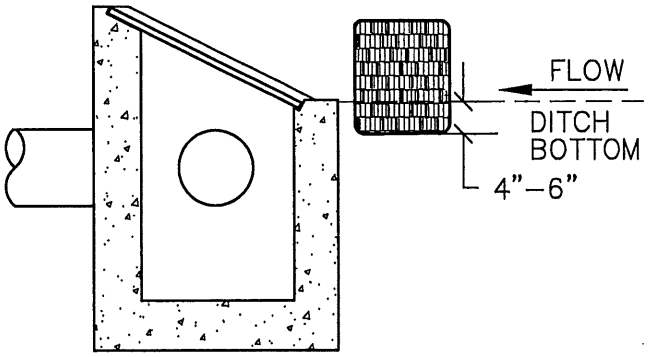

SECTION A-A

DITCH INLET C.B.

MAINTENANCE NOTES:

1. SEDIMENT BARRIERS SHALL BE MAINTAINED UNTIL UP-SLOPE AREA IS PERMANENTLY STABILIZED.
2. AT NO TIME SHALL MORE THAN ONE FOOT OF SEDIMENT BE ALLOWED TO ACCUMULATE BEHIND SEDIMENT FENCES OR BIOFILTER BAGS.
3. NEW SEDIMENT BARRIERS SHALL BE INSTALLED UPHILL AS REQUIRED TO CONTROL SEDIMENT TRANSPORT.

LAST REVISION DATE:	JO #
APRIL 2014	STANDARD
INLET SEDIMENT CONTROL (NTS)	
PHILOMATH, OR	DETAIL NO. 613

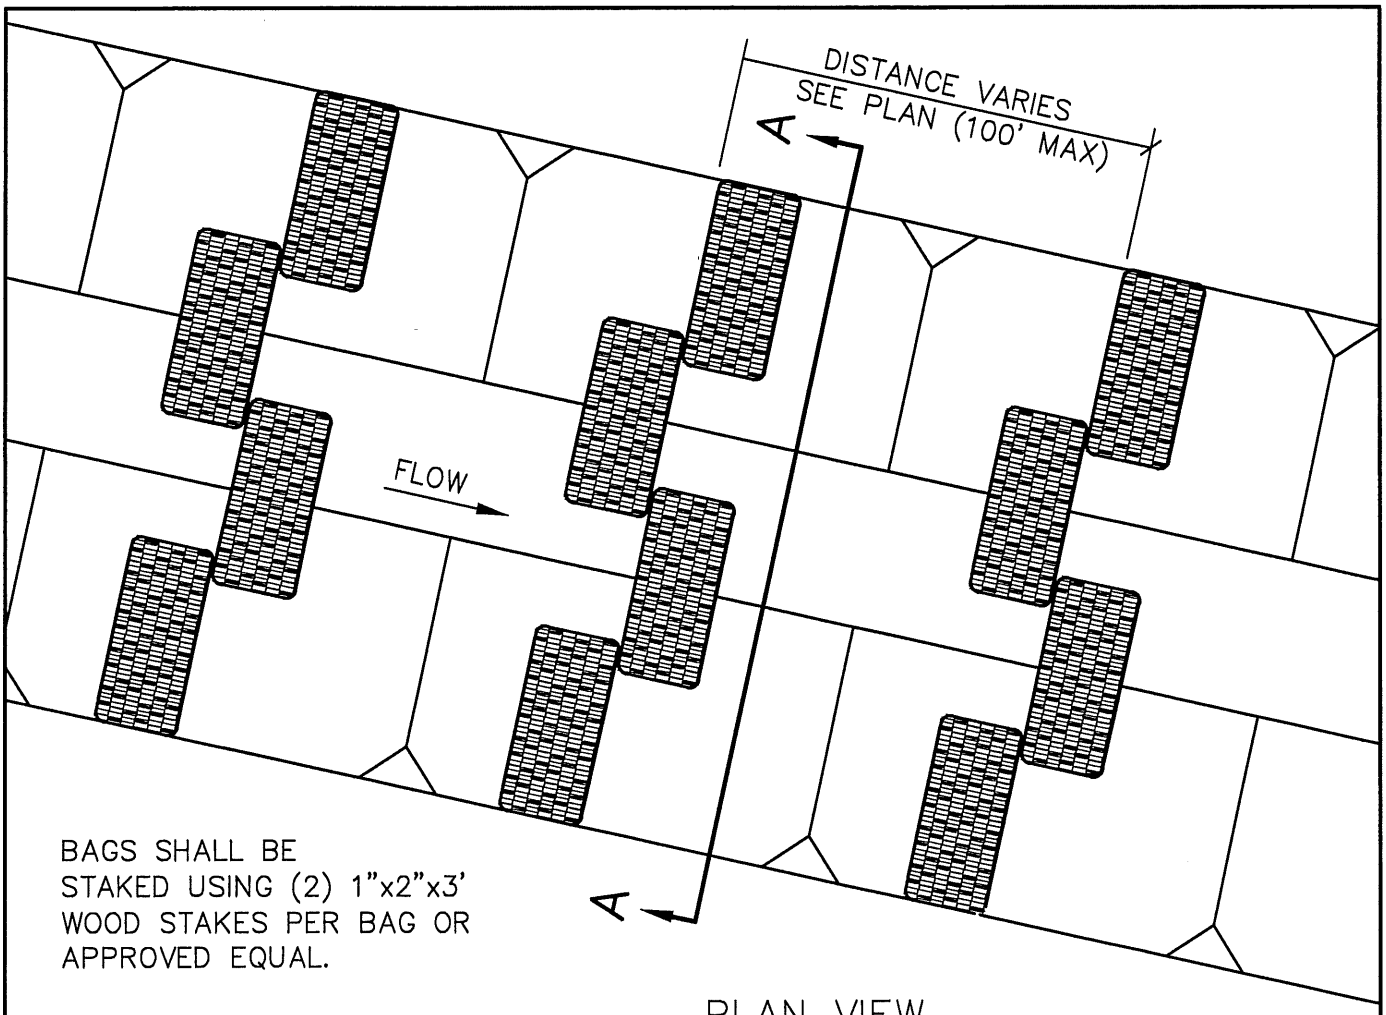

BAGS SHALL BE STAKED USING (2) 1"x2"x3' WOOD STAKES PER BAG OR APPROVED EQUAL.

PLAN VIEW

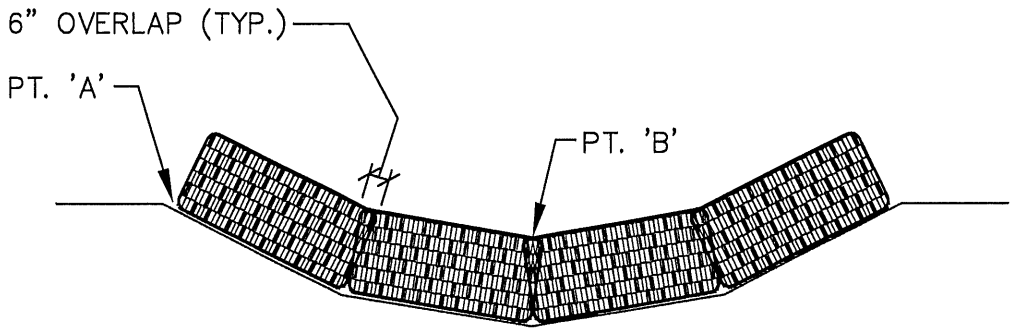

SECTION A–A

MAINTENANCE NOTES:

1. SEDIMENT BARRIERS SHALL BE MAINTAINED UNTIL UP–SLOPE AREA IS PERMANENTLY STABILIZED.
2. AT NO TIME SHALL MORE THAN ONE FOOT OF SEDIMENT BE ALLOWED TO ACCUMULATE BEHIND BIOFILTER BAGS.
3. NEW SEDIMENT BARRIERS SHALL BE INSTALLED UPHILL AS REQUIRED TO CONTROL SEDIMENT TRANSPORT.
4. PT. 'A' SHALL BE 6" MIN. HIGHER THAN PT. 'B'.

LAST REVISION DATE: APRIL 2014	JO # STANDARD
DITCH AND SWALE EROSION PROTECTION (NTS)	
PHILOMATH, OR	DETAIL NO. 614

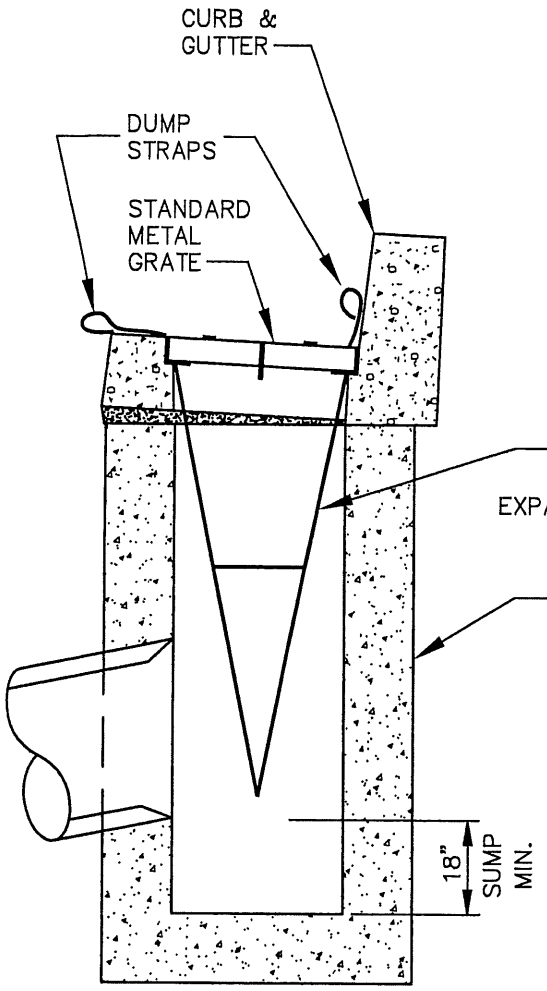

INSTALLATION DETAIL

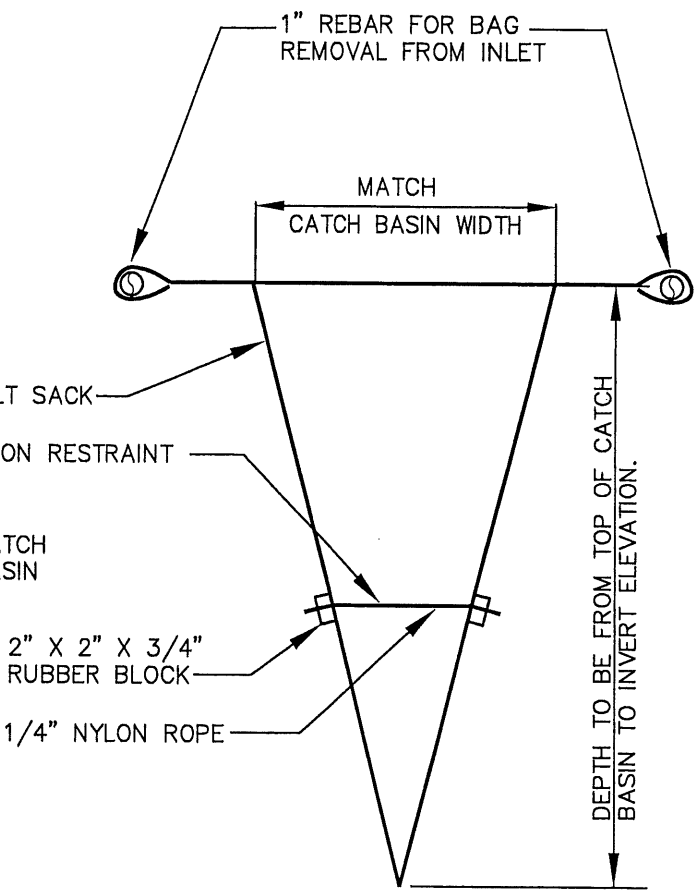

BAG DETAIL

NOTES:

1. EMPTY SILT SACK AS NECESSARY.
2. SILTSACK SEDIMENT CONTROL DEVICE AS MANUFACTURED BY ACF ENVIRONMENTAL AND SUPPLIED BY ACF WEST (503) 771-5115 OR APPROVED EQUAL.

LAST REVISION DATE: OCT 2006	
SILT SACK INLET DETAIL (NTS)	
PHILOMATH, OR	DETAIL NO. 615